Best Practices for Data Center Energy Efficiency Workshop

Data Center Dynamics, Mumbai, India

May 25, 2012

Presented by:
Dale Sartor, P.E.
Applications Team Leader, Building Technologies
Lawrence Berkeley National Laboratory

(Version: 4/29/12)

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Download Presentation

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

This Presentation is Available for download at:

http://datacenterworkshop.lbl.gov/

Agenda

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Introduction
- Performance metrics and benchmarking
- IT equipment and software efficiency
- Use IT to save IT (monitoring and dashboards)
- Data center environmental conditions
- Airflow management
- Cooling systems
- Electrical systems
- Resources
- Workshop summary

Challenging Conventional Wisdom: Game Changers

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Conventional Approach

- Data centers need to be cool and controlled to tight humidity ranges
- Data centers need raised floors for cold air distribution
- Data centers require highly redundant building infrastructure

Need Holistic Approach

- IT and Facilities Partnership

Introduction

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Workshop Learning Objectives

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Provide background on data center efficiency
- Raise awareness of efficiency opportunities
- Develop common understanding between IT and Facility staff
- Review of data center efficiency resources
- Group interaction for common issues and solutions

High Tech Buildings are Energy Hogs

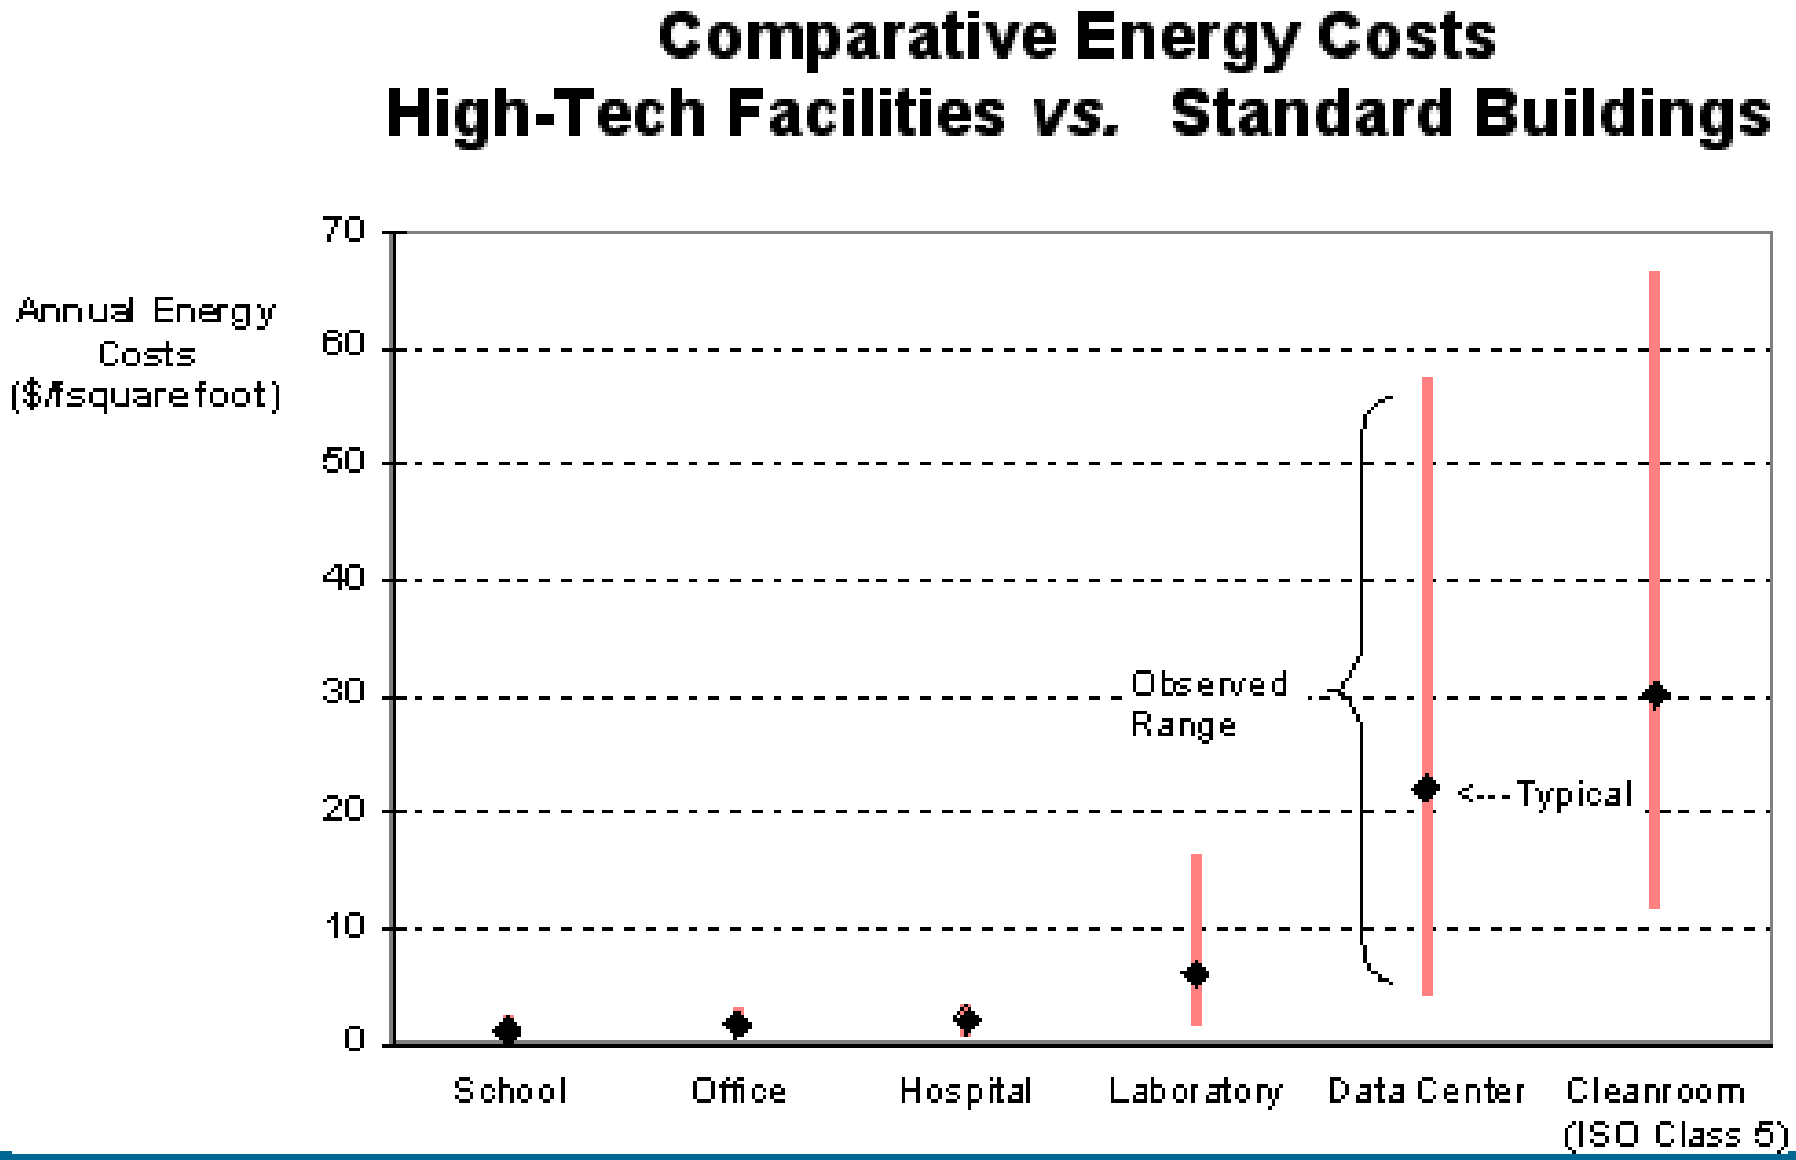

Data Center Energy

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Data centers are energy intensive facilities
  - 10 to 100 times more energy intensive than an office
  - Server racks now designed for more than 25+ kW
  - Surging demand for data storage
  - 1.5% of US Electricity consumption
  - Projected to double in next 5 years
  - Power and cooling constraints in existing facilities

World Data Center Electricity Use - 2000 and 2005

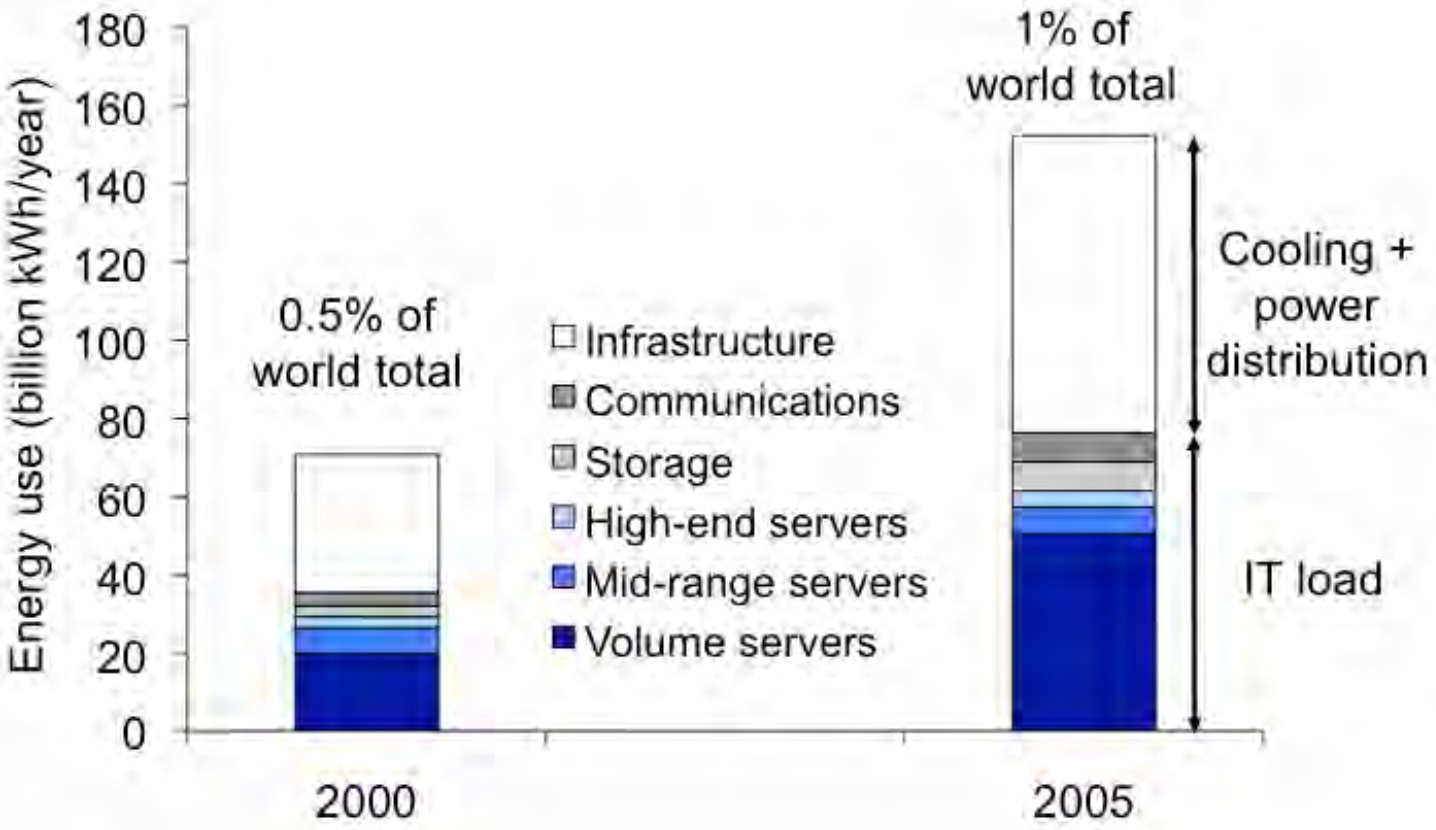

Source: Koomey 2008

How Much is 152B kWh?

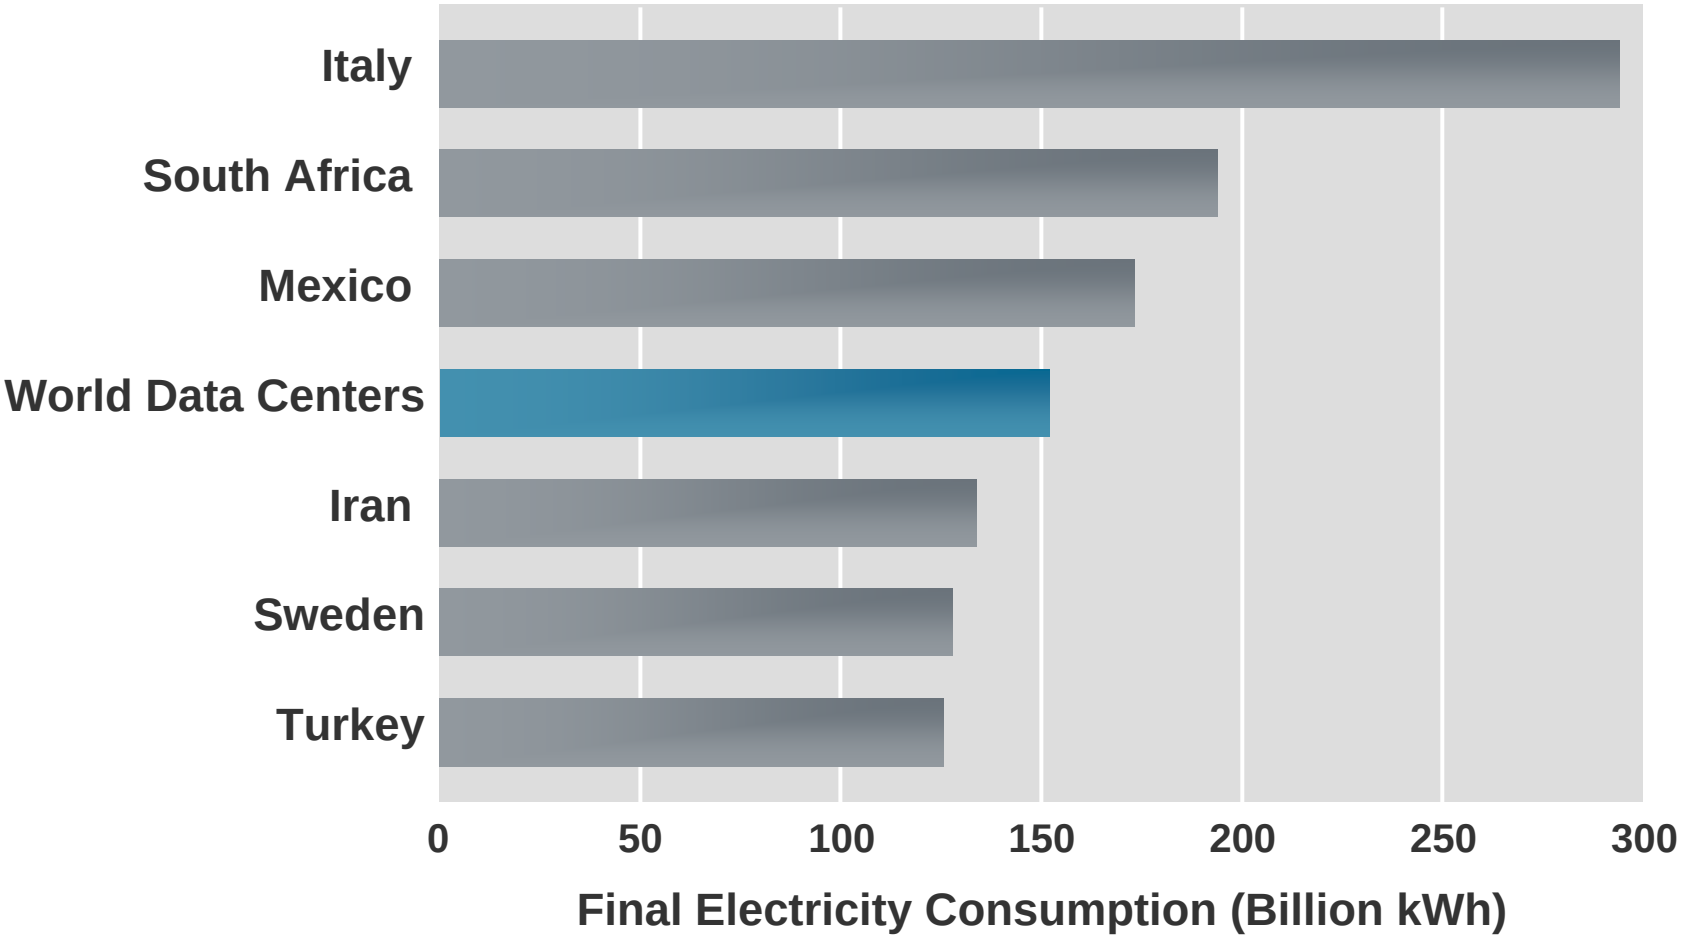

Source for country data in 2005: International Energy Agency, *World Energy Balances* (2007 edition)

Aggressive Programs Make a Difference

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Energy efficiency programs have helped keep per capita electricity consumption in California flat over the past 30 years

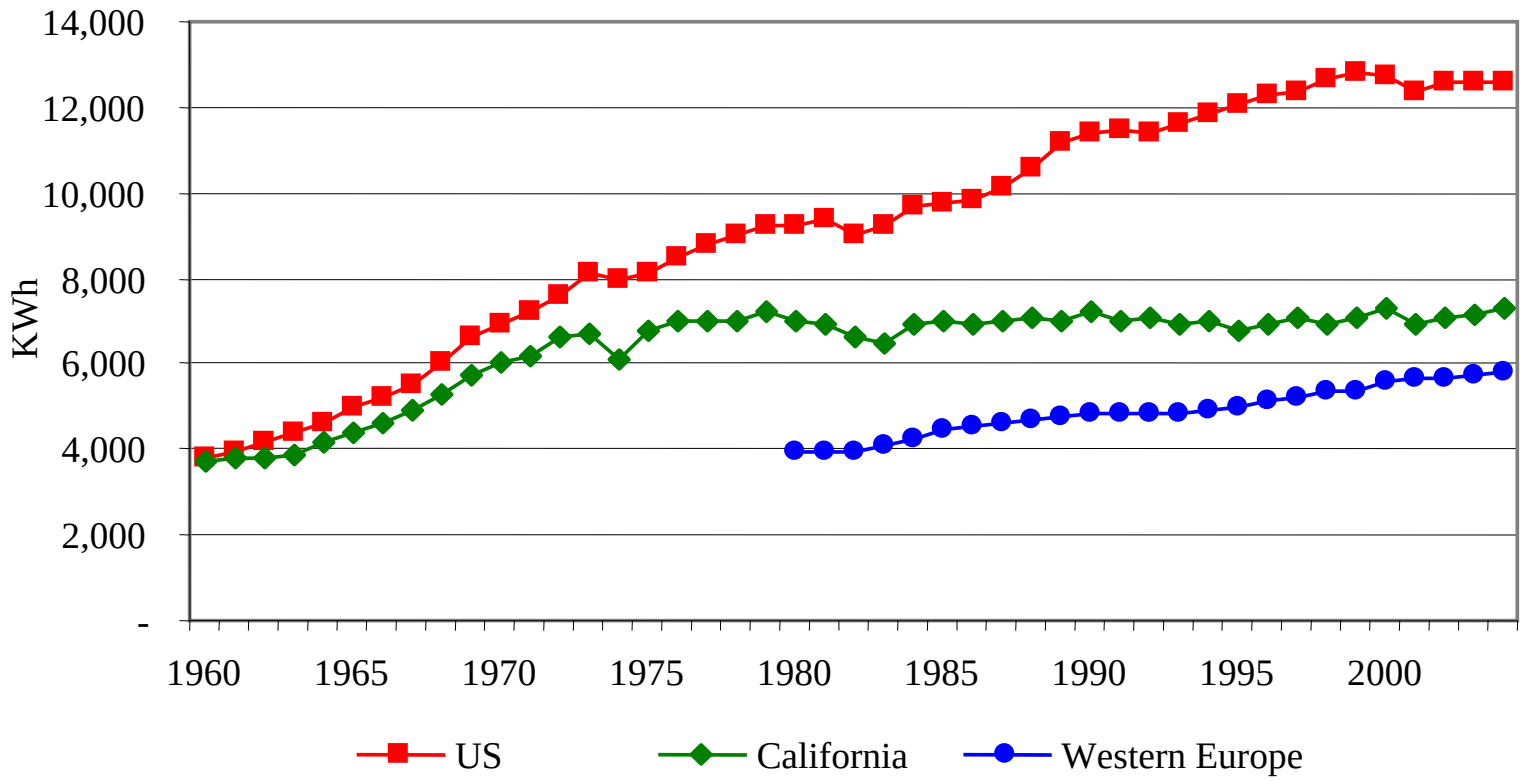

Projected Data Center Energy Use

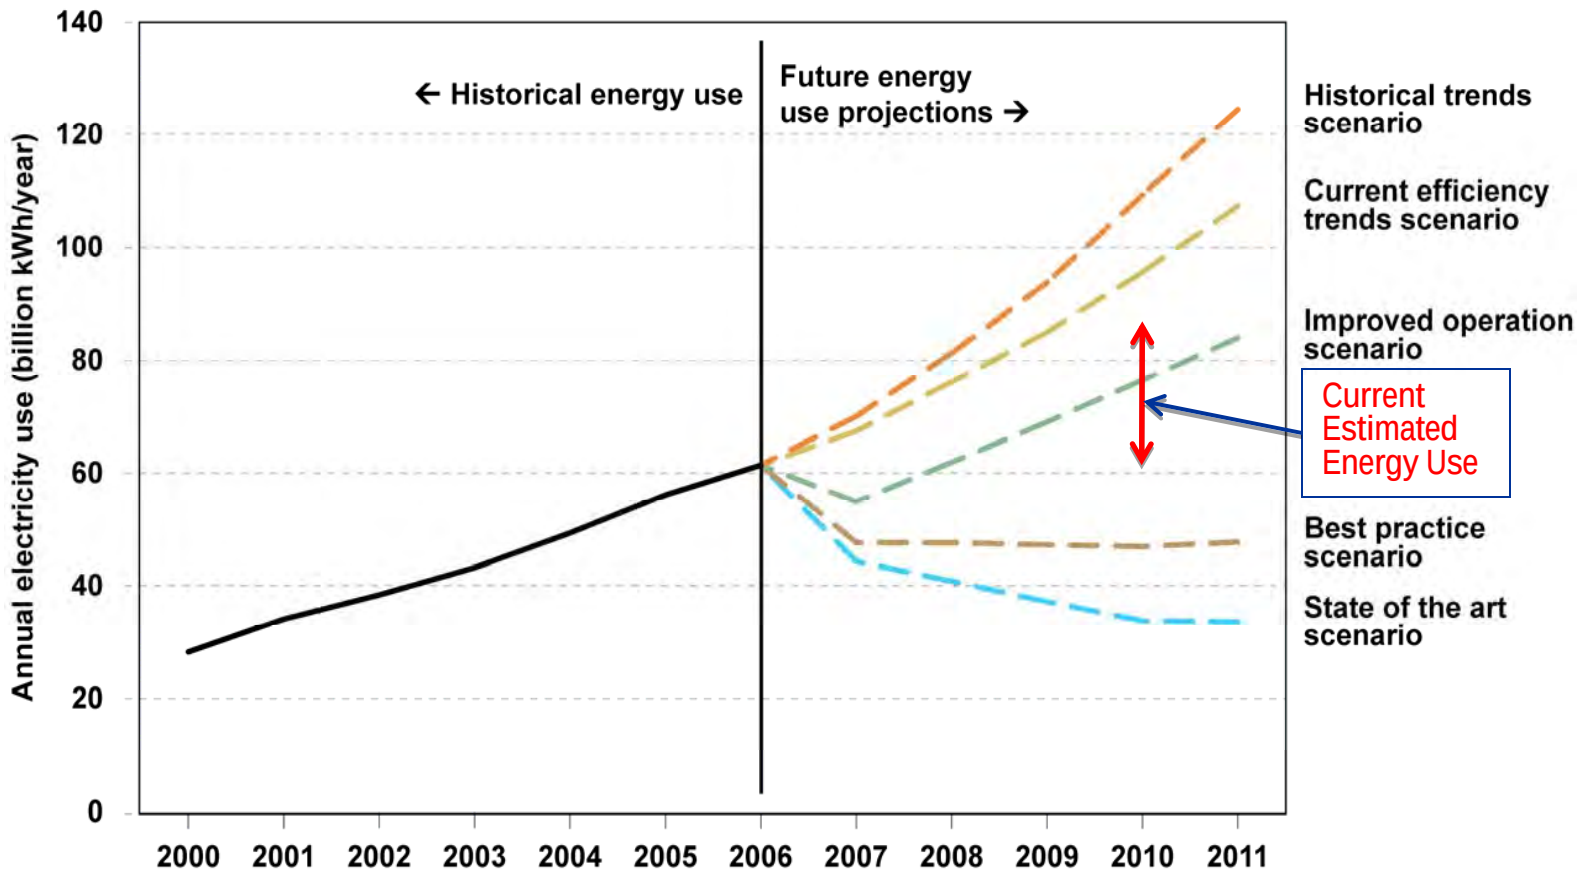

EPA Report to Congress 2008

The Rising Cost of Ownership

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- From 2000 – 2006, computing performance increased 25x but energy efficiency only 8x
  - Amount of power consumed per $1,000 of servers purchased has increased 4x
- Cost of electricity and supporting infrastructure now surpassing capital cost of IT equipment
- Perverse incentives -- IT and facilities costs separate

Source: The Uptime Institute, 2007

LBNL operates large systems along with legacy systems

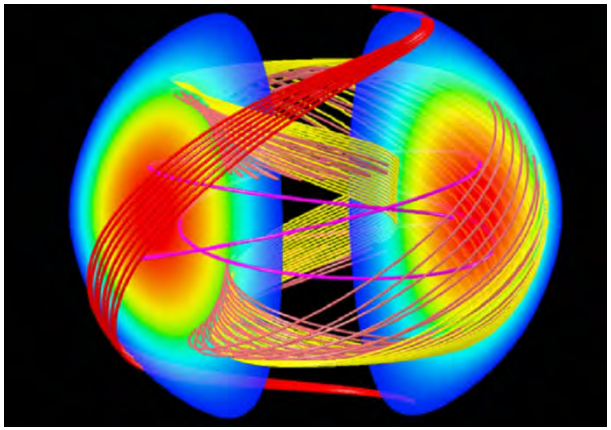

We also research energy efficiency opportunity and work on various deployment programs

LBNL Feels the Pain!

LBNL Super Computer Systems Power

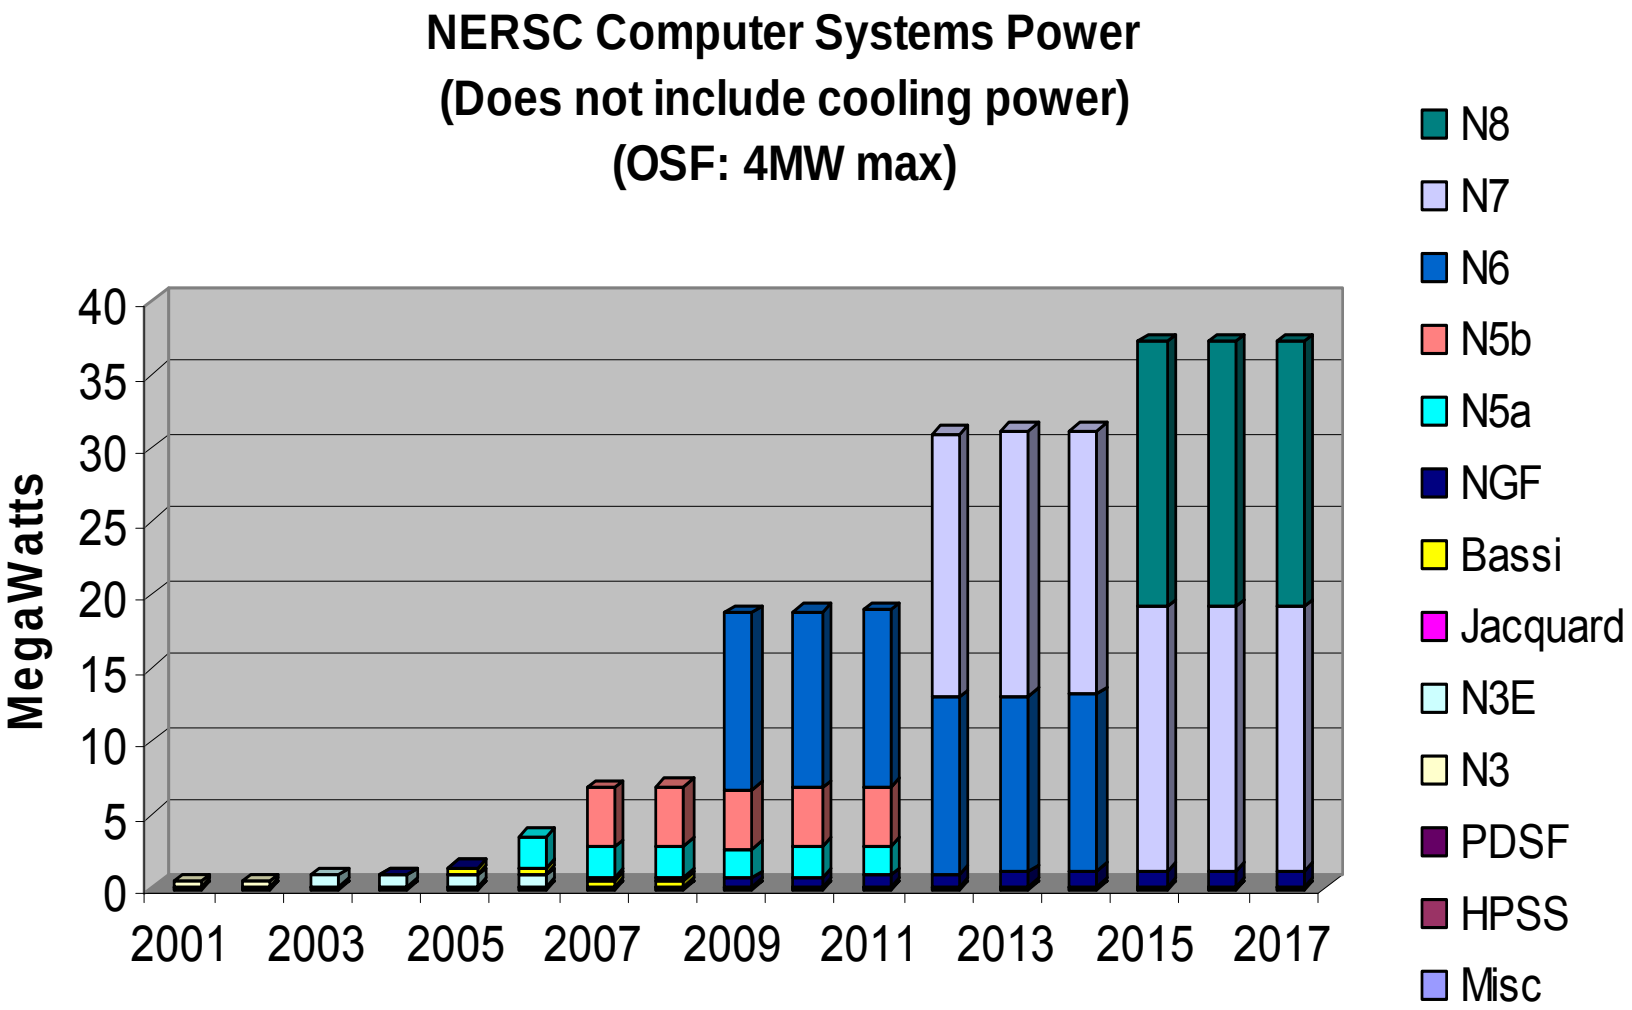

Data Center Energy Efficiency = 15% (or less)

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Energy Efficiency = Useful computation / Total Source Energy

Typical Data Center Energy End Use

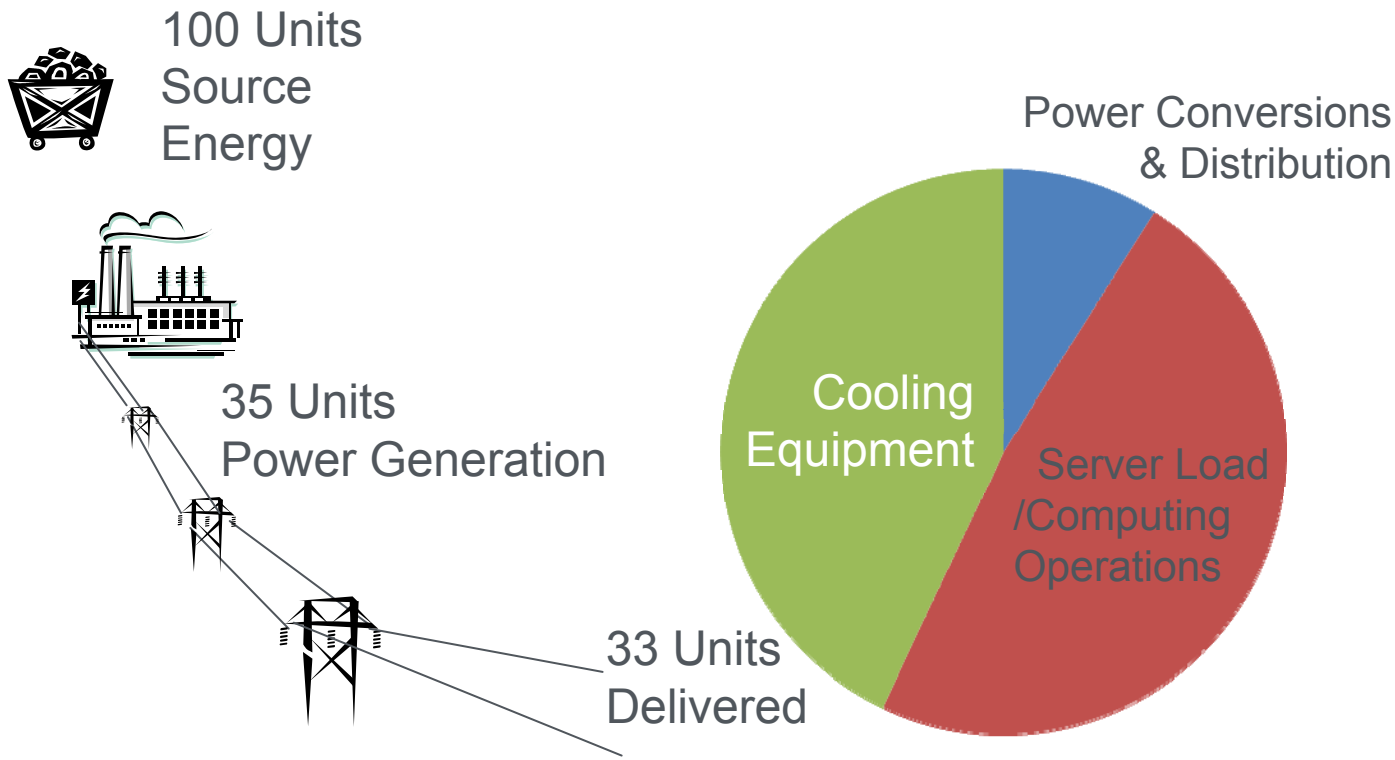

Energy Efficiency Opportunities

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

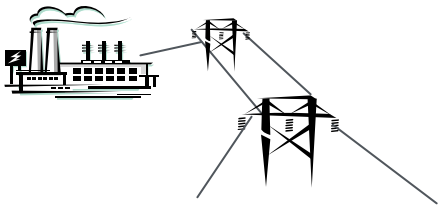

- Server innovation
- Virtualization
- High efficiency power supplies
- Load management

- Better air management
- Move to liquid cooling
- Optimized chilled-water plants
- Use of free cooling
- Heat recovery

Power Conversion & Distribution → Server Load/ Computing Operations → Cooling Equipment

- High voltage distribution
- High efficiency UPS
- Efficient redundancy strategies
- Use of DC power

On-site Generation

- On-site generation Including fuel cells and renewable sources
- CHP applications (Waste heat for cooling)

Potential Benefits of Data Center Energy Efficiency

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- 20-40% savings typical
- Aggressive strategies can yield 50+% savings
- Extend life and capacity of infrastructures

Questions?

Performance metrics and benchmarking

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Electricity Use in Data Centers

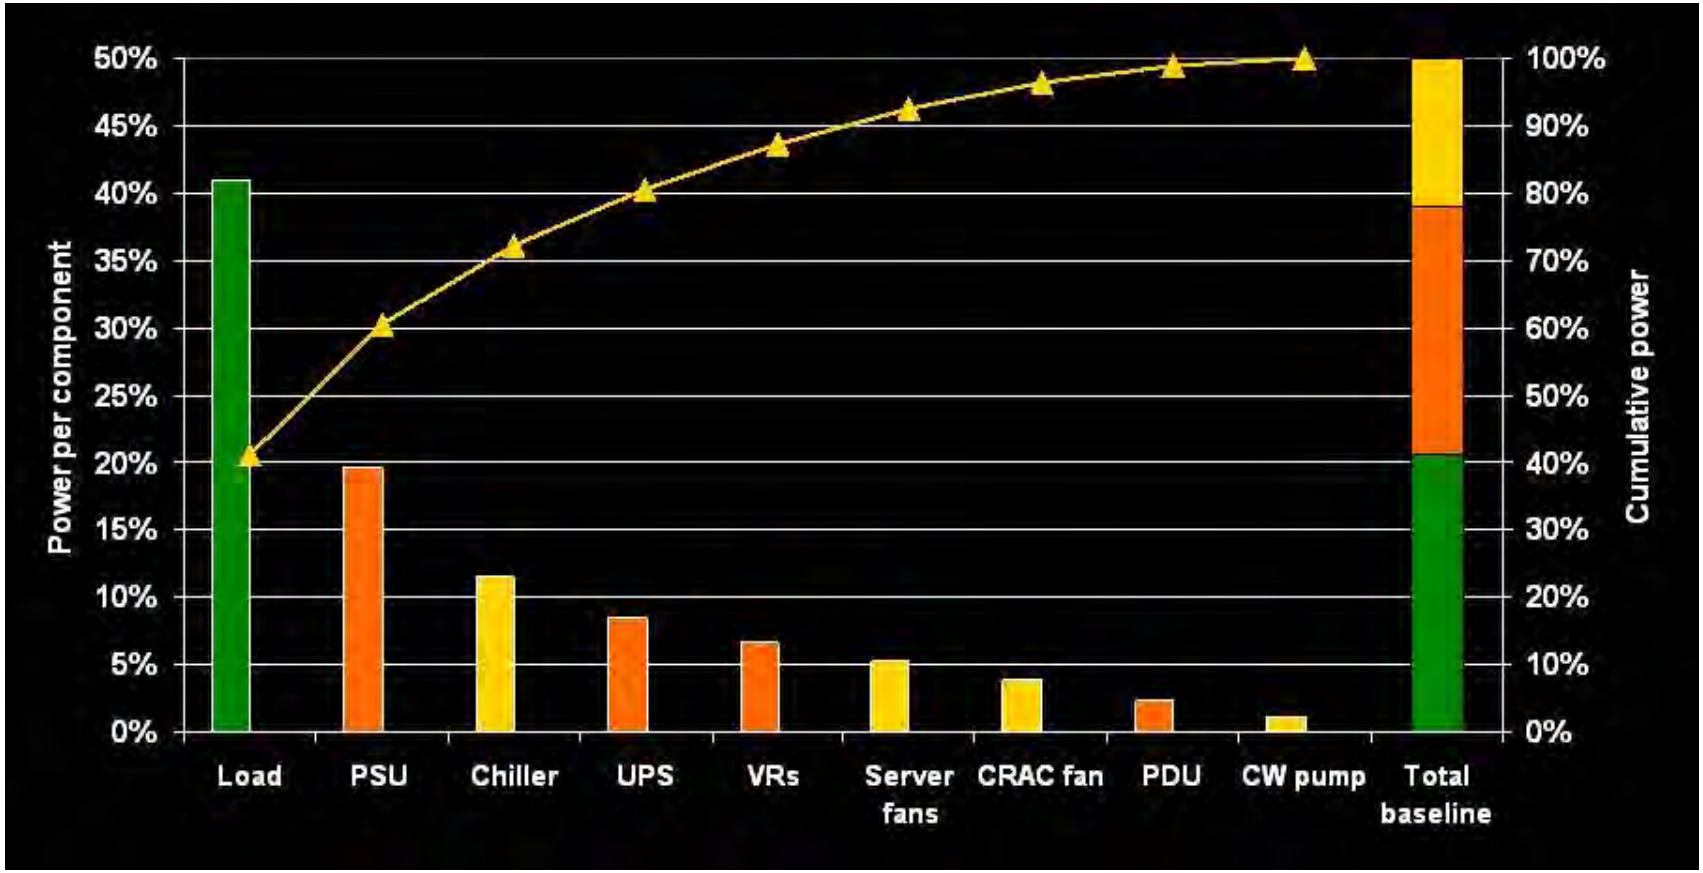

Courtesy of Michael Patterson, Intel Corporation

Benchmarking for Energy Performance Improvement:

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Energy benchmarking can allow comparison to peers and help identify best practices
- LBNL conducted studies of over 30 data centers:
  - Wide variation in performance
  - Identified best practices
- Can't manage what isn't measured

Your Mileage Will Vary

The relative percentages of the energy doing computing varies considerably.

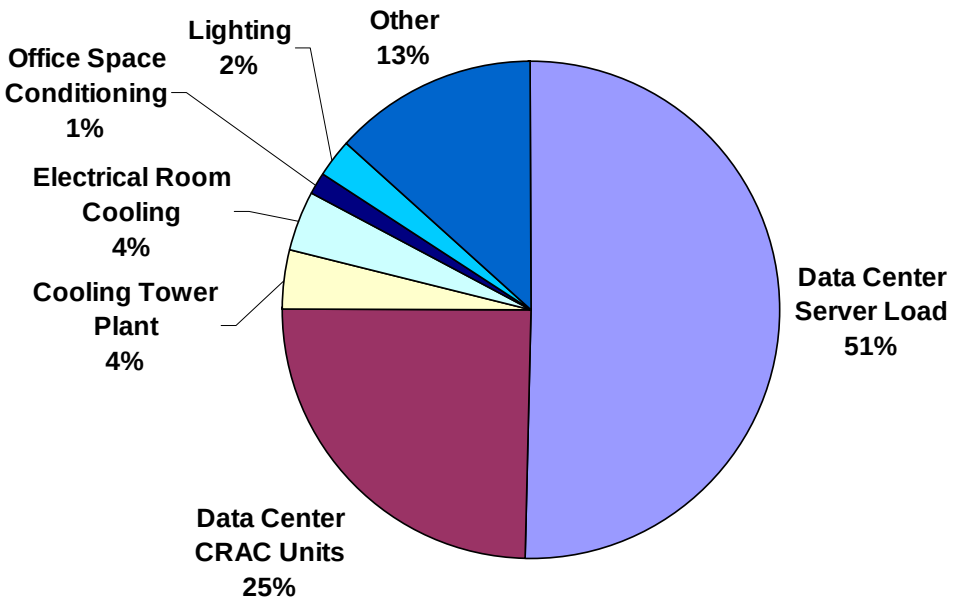

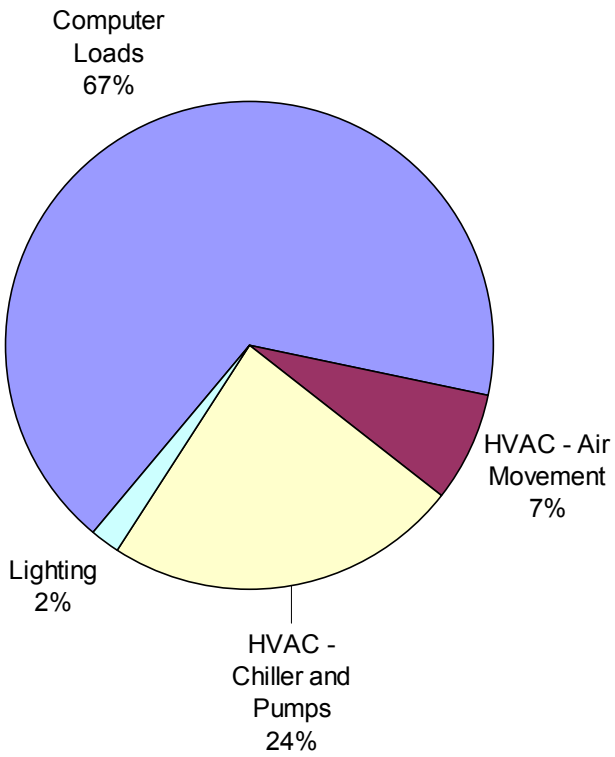

Benchmarks Obtained by LBNL

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

High Level Metric: Power Utilization Effectiveness (PUE) = Total Power/IT Power

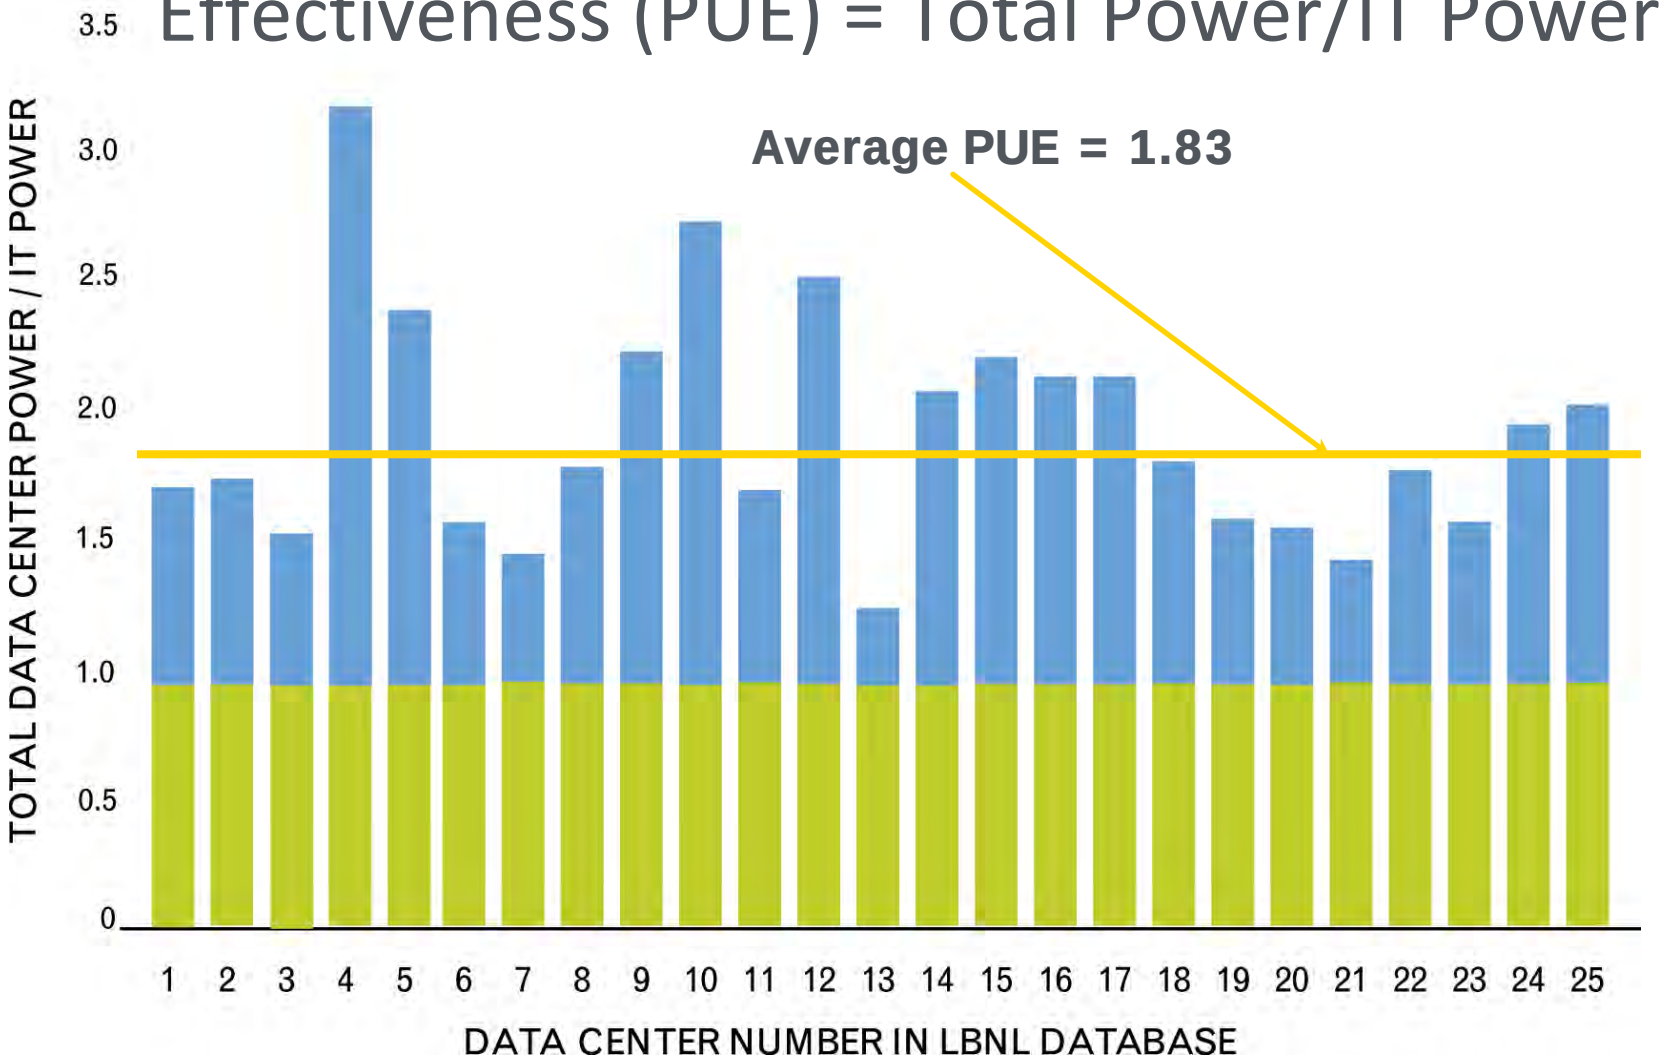

PUE for India Data Centers

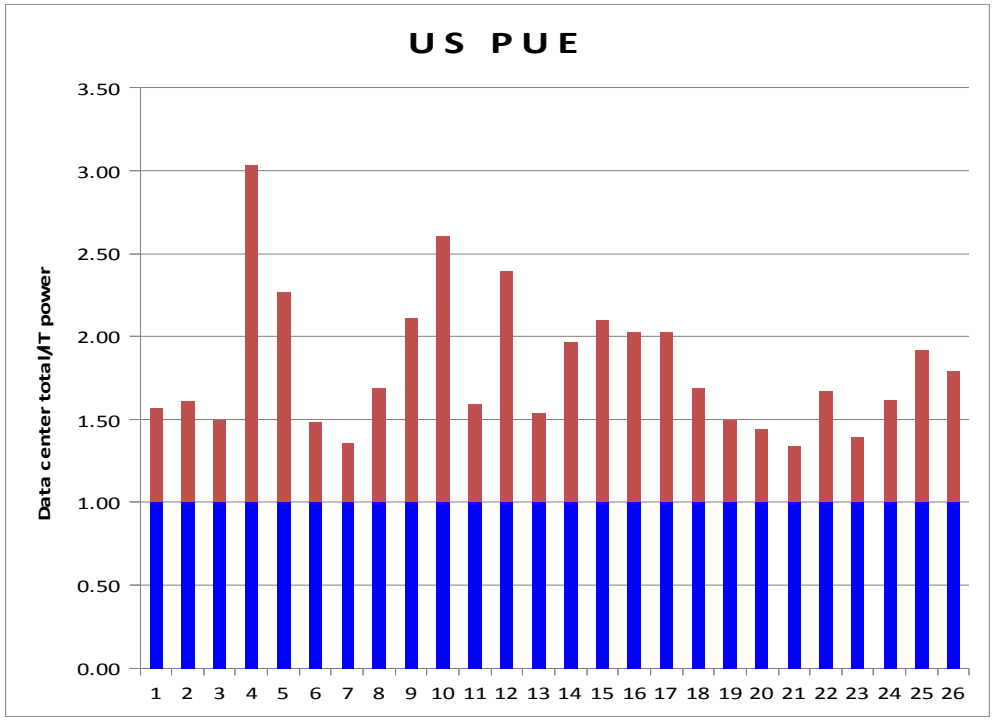

Indian Data Center Benchmarking Sources – Thanks to:

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Intel
- Hewlett Packard
- APC
- Maruti
- Texas Instruments

More Needed!

Energy Metrics and Benchmarking

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- **Key Metrics:**
  - **PUE and partial PUEs (e.g. HVAC, Electrical distribution)**
  - **Utilization**
  - **Energy Reuse (ERF)**
- **The future: Computational Metrics (e.g. peak flops per Watt; transactions/Watt)**

Other Data Center Metrics:

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Watts per square foot, Watts per rack
- Power distribution: UPS efficiency, IT power supply efficiency
  - Uptime: IT Hardware Power Overhead Multiplier (ITac/ITdc)
- HVAC
  - Fan watts/cfm
  - Pump watts/gpm
  - Chiller plant (or chiller or overall HVAC) kW/ton
- Air Management
  - Rack cooling index (fraction of IT within recommended temperature range)
  - Return temperature index (RAT-SAT)/ITΔT
- Lighting watts/square foot

Metrics & Benchmarking

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Power Usage Effectiveness

$$PUE = \frac{Total\ Facility\ Power}{IT\ Equipment\ Power}$$

Standard	Good	Better
2.0	1.4	1.1

Airflow Efficiency

$$\frac{\text{Total Fan Power (W)}}{\text{Total Fan Airflow (cfm)}}$$

Standard	Good	Better
1.25W/cfm	0.75 W/cfm	0.5 kW/cfm

Cooling System Efficiency

$$\frac{\text{Average Cooling System Power (kW)}}{\text{Average Cooling Load (ton)}}$$

Standard	Good	Better
1.1 kW/ton	0.8 kW/ton	0.6 kW/ton

Questions?

IT Equipment and Software Efficiency

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

IT Server Performance - Saving a Watt…

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

The value of one watt saved at the IT equipment

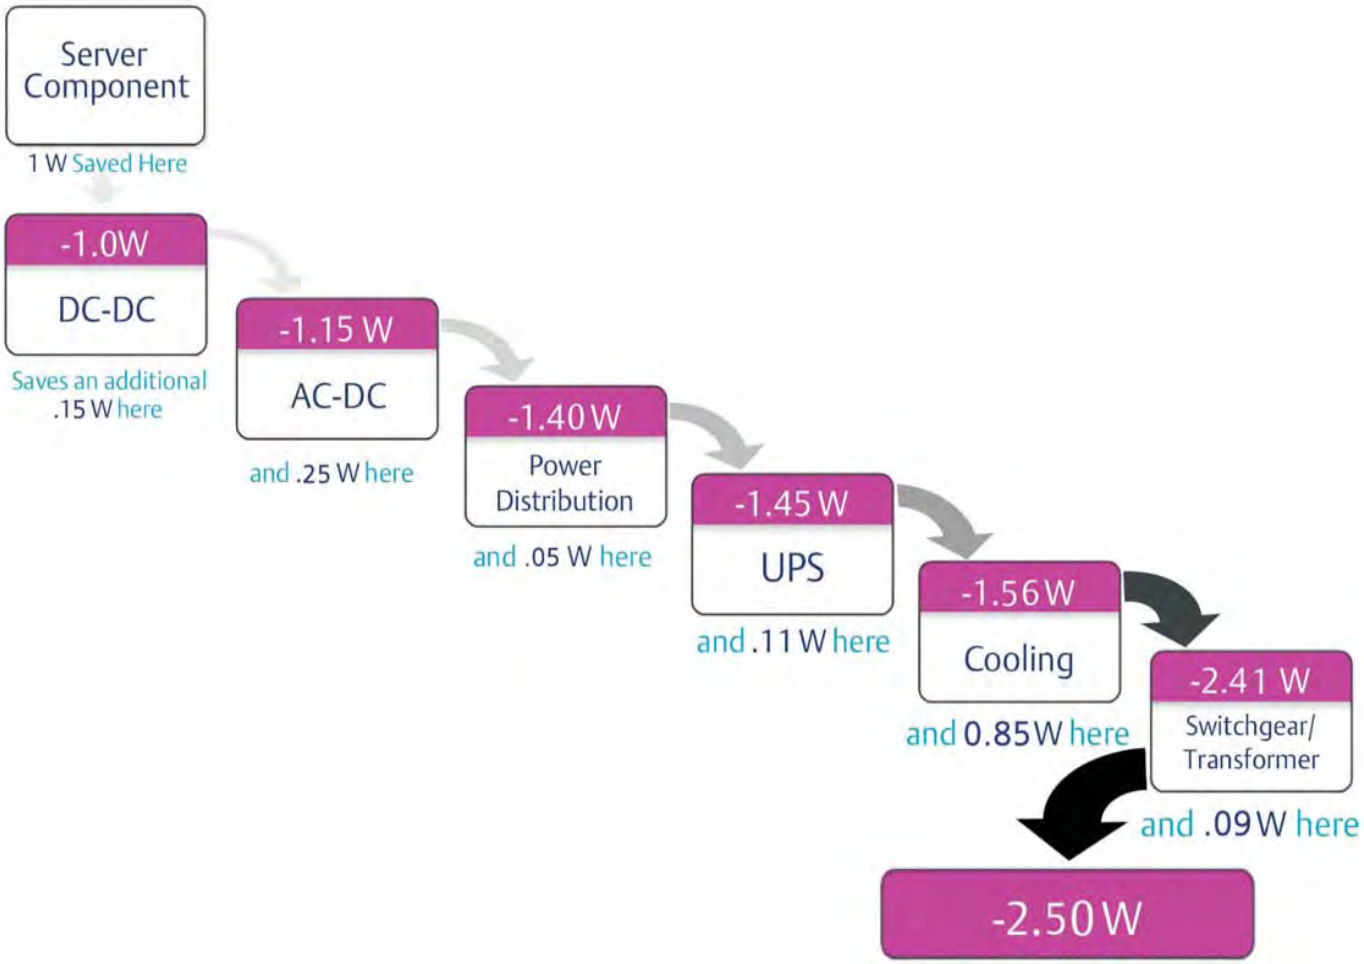

Moore's Law

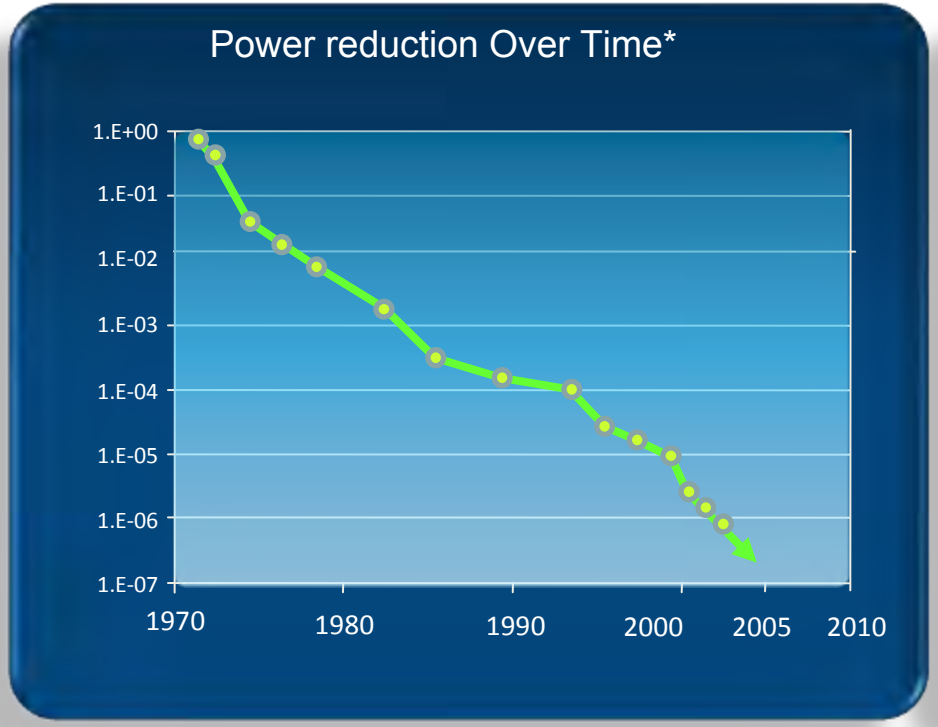

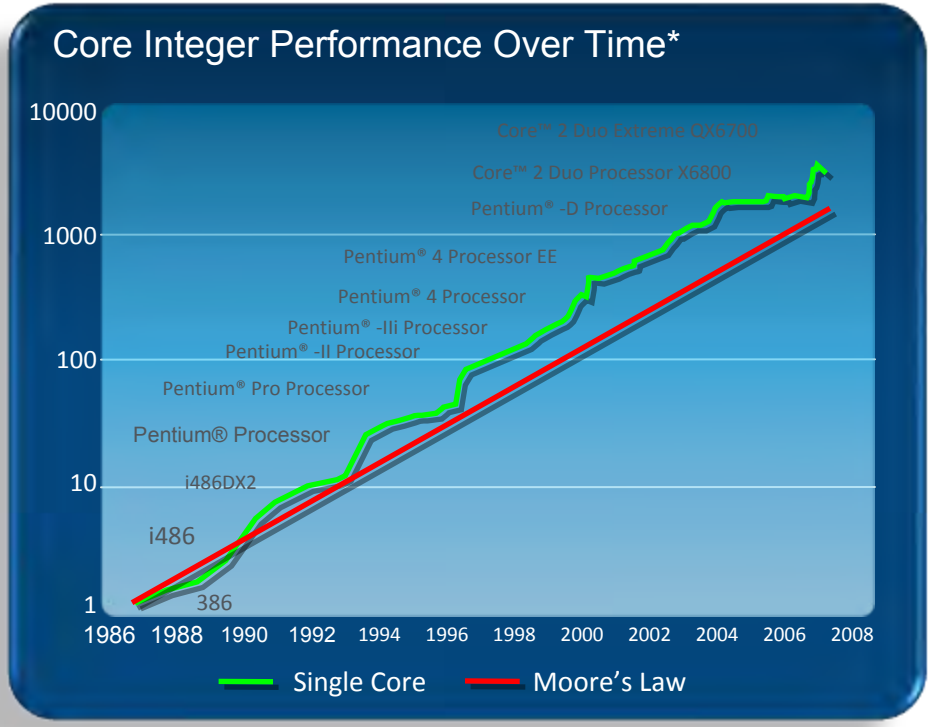

- Every year Moore's Law is followed, smaller, more energy-efficient transistors result
- Miniaturization provides 1 million times reduction in energy/transistor size over 30+ years.
- Benefits: Smaller, faster transistors => faster AND more energy-efficient chips.

Source: Intel Corp.

Source: Intel Corporate Technology Group

IT Equipment Age and Performance

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

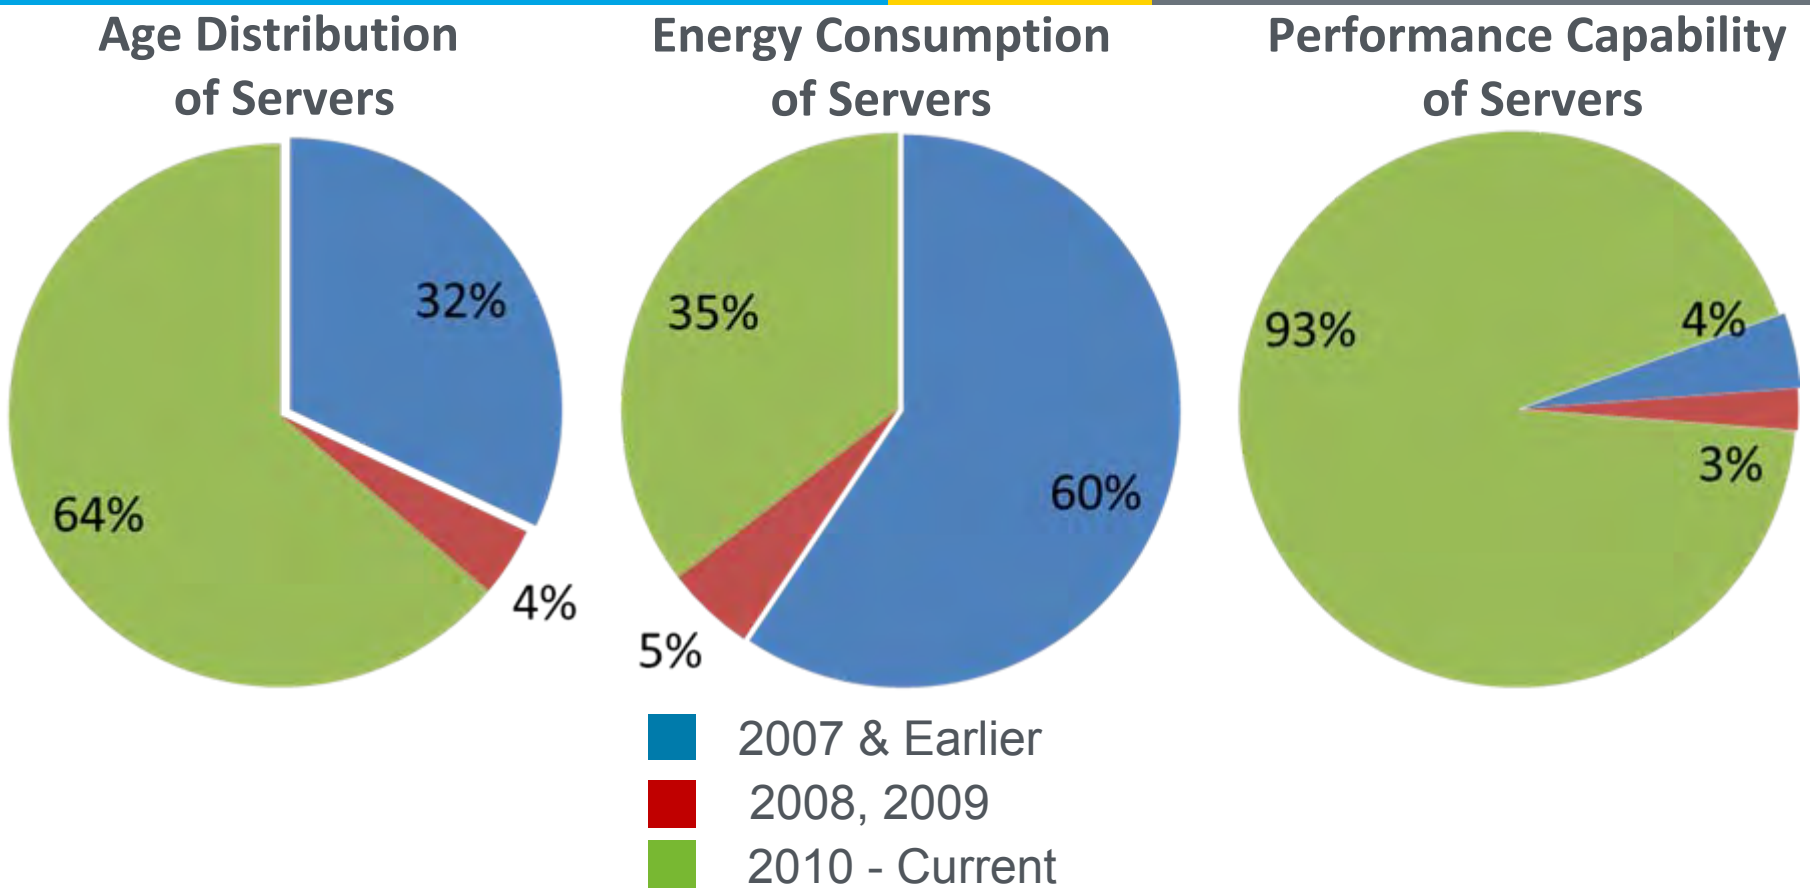

Old Servers consume 60% of Energy, but deliver only 4% of Performance Capability.

Data collected recently at a Fortune 100 company; courtesy of John Kuzma and William Carter, Intel

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

IT Energy Use Patterns: Servers

Idle servers consume as much as 50-60% of power @ full load as shown in SpecPower Benchmarks.

Performance			Power	
Target Load	Actual Load	ssj_ops	Average Active Power (W)	Performance to Power Ratio
100%	99.2%	308,022	269	1,144
90%	90.2%	280,134	264	1,063
80%	80.0%	248,304	256	971
70%	69.9%	217,096	247	877
60%	60.1%	186,594	238	785
50%	49.6%	154,075	227	680
40%	39.9%	123,805	215	575
30%	29.9%	92,944	203	459
20%	20.1%	62,364	189	330
10%	10.0%	31,049	174	178
Active Idle		0	160	0
			Σ ssj_ops / Σ power =	**698**

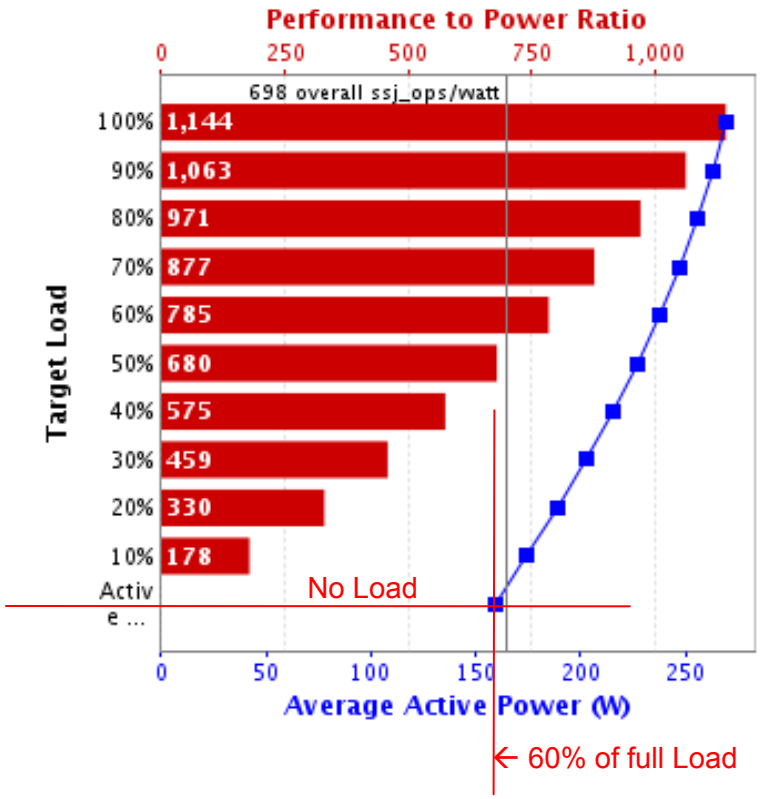

Decommission Unused Servers

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

PHYSICALLY RETIRE AN INEFFICIENT OR UNUSED SYSTEM

- **Uptime Institute reported 15-30% of servers are on but not being used**
- **Decommissioning goals include:**
  - Regularly inventory and monitor
  - Consolidate/retire poorly utilized hardware

Virtualize and Consolidate Servers and Storage

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Run many “virtual” machines on a single “physical” machine
- Developed in the 1960s to achieve better efficiency
- Consolidate underutilized physical machines, increasing utilization
- Energy saved by shutting down underutilized machines

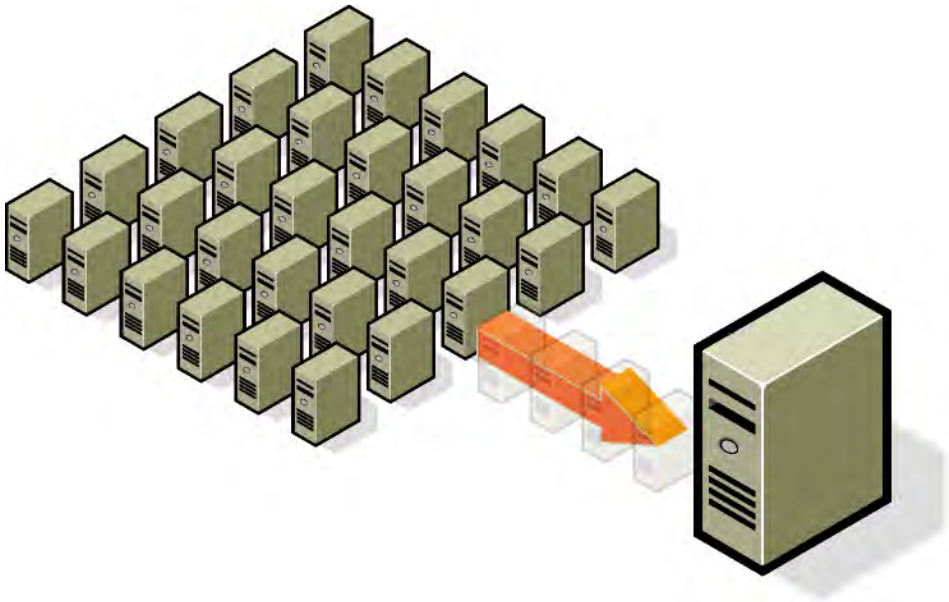

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Virtualization: Workload provisioning

Server Consolidation

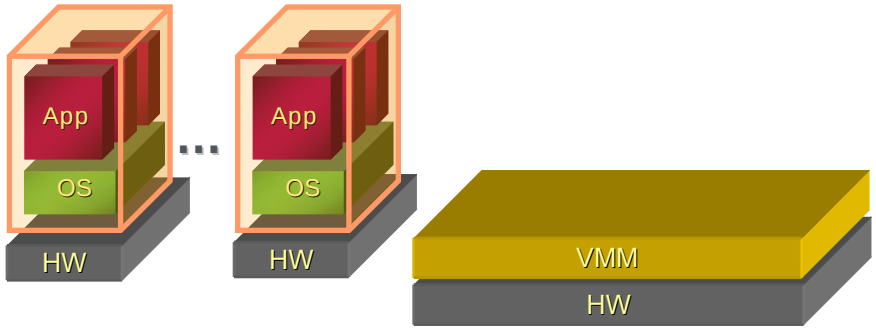

10:1 in many cases

R&D Production

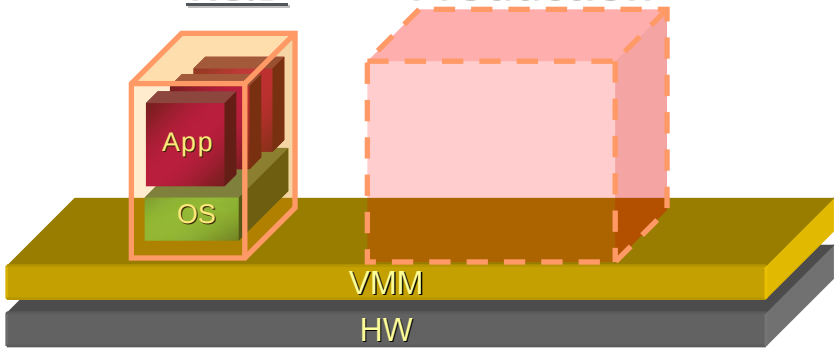

Enables rapid deployment, reducing number of idle, staged servers

Disaster Recovery

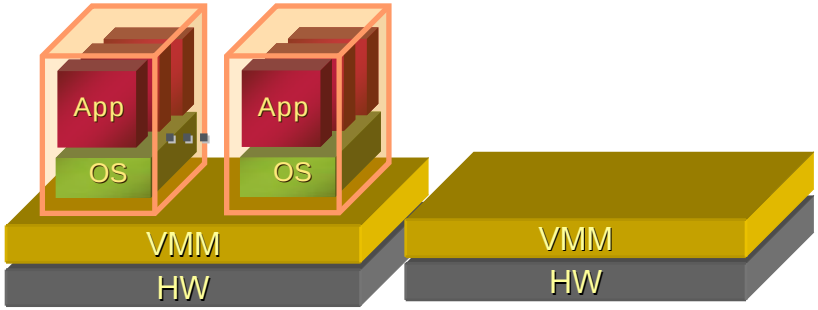

- Upholding high-levels of business continuity
  - One Standby for many production servers

Dynamic Load Balancing

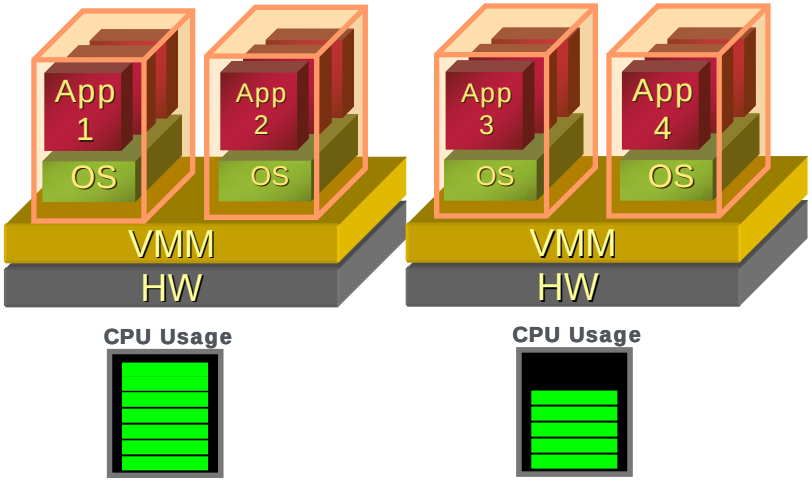

Balancing utilization with head room

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Vertualized cloud computing can provide…

- Dynamically scalable resources over the internet
- Can be internal or external
- Can balance different application peak loads
- Typically achieves high utilization rates

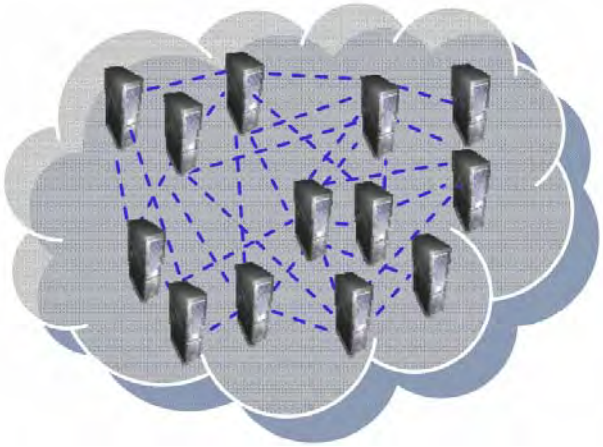

Storage Systems and Energy

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Power roughly linear to storage modules
- Storage redundancy significantly increases energy
- Consider lower energy hierarchal storage
- Storage De-duplication - Eliminate unnecessary copies

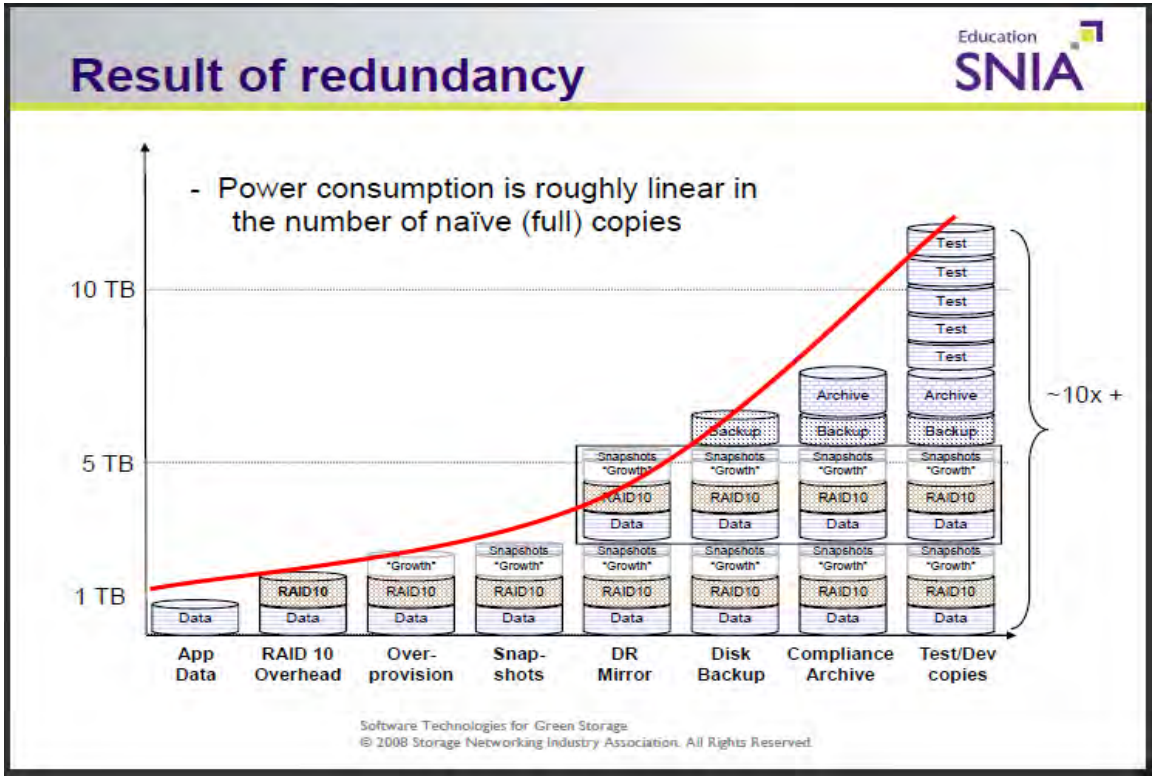

Use Efficient Power Supplies

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

LBNL/EPRI measured power supply efficiency

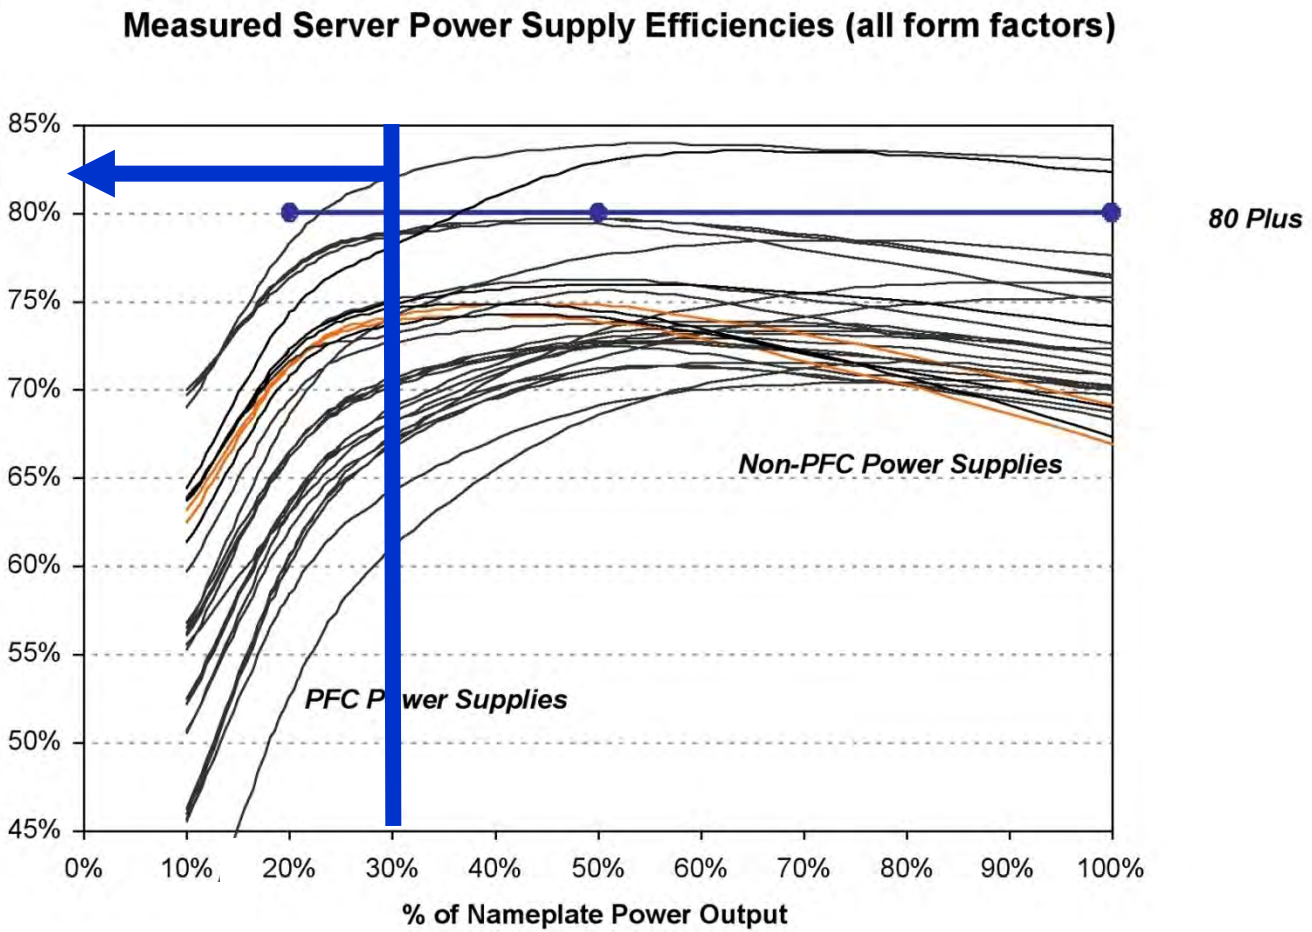

Use Efficient Power Supplies

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Power Supply Units

- Most efficient in the mid-range of performance curves
- Right-size for load
- Power supply redundancy puts operation lower on the curve
- Use Energy Star or Climate Savers power supplies

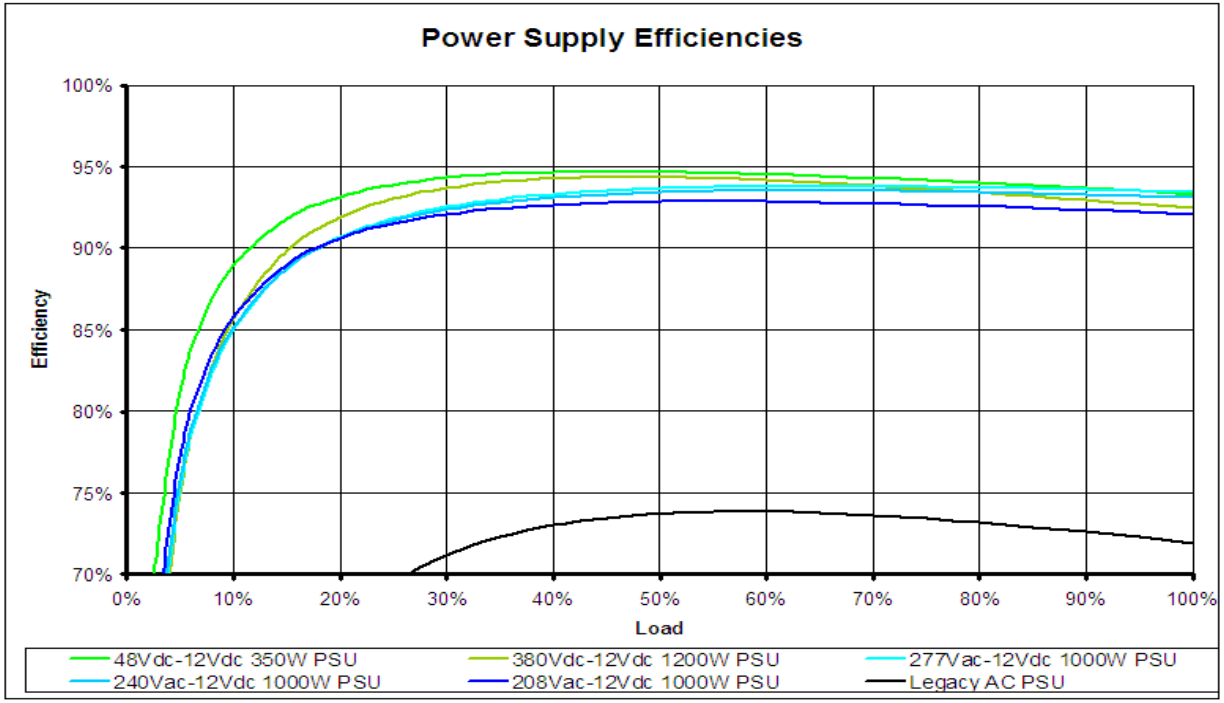

Source: The Green Grid

80 PLUS Certification Levels

Level of Certification	Efficiency at Rated Load					
	115V Internal Non-Redundant			230V Internal Redundant		
	20%	50%	100%	20%	50%	100%
80 PLUS	80%	80%	80%	n/a	n/a	n/a
80 PLUS Bronze	82%	85%	82%	81%	85%	81%
80 PLUS Silver	85%	88%	85%	85%	89%	85%
80 PLUS Gold	87%	90%	87%	88%	92%	88%
80 PLUS Platinum	n/a	n/a	n/a	90%	94%	91%

Use Efficient Power Supplies

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Power supply savings add up…

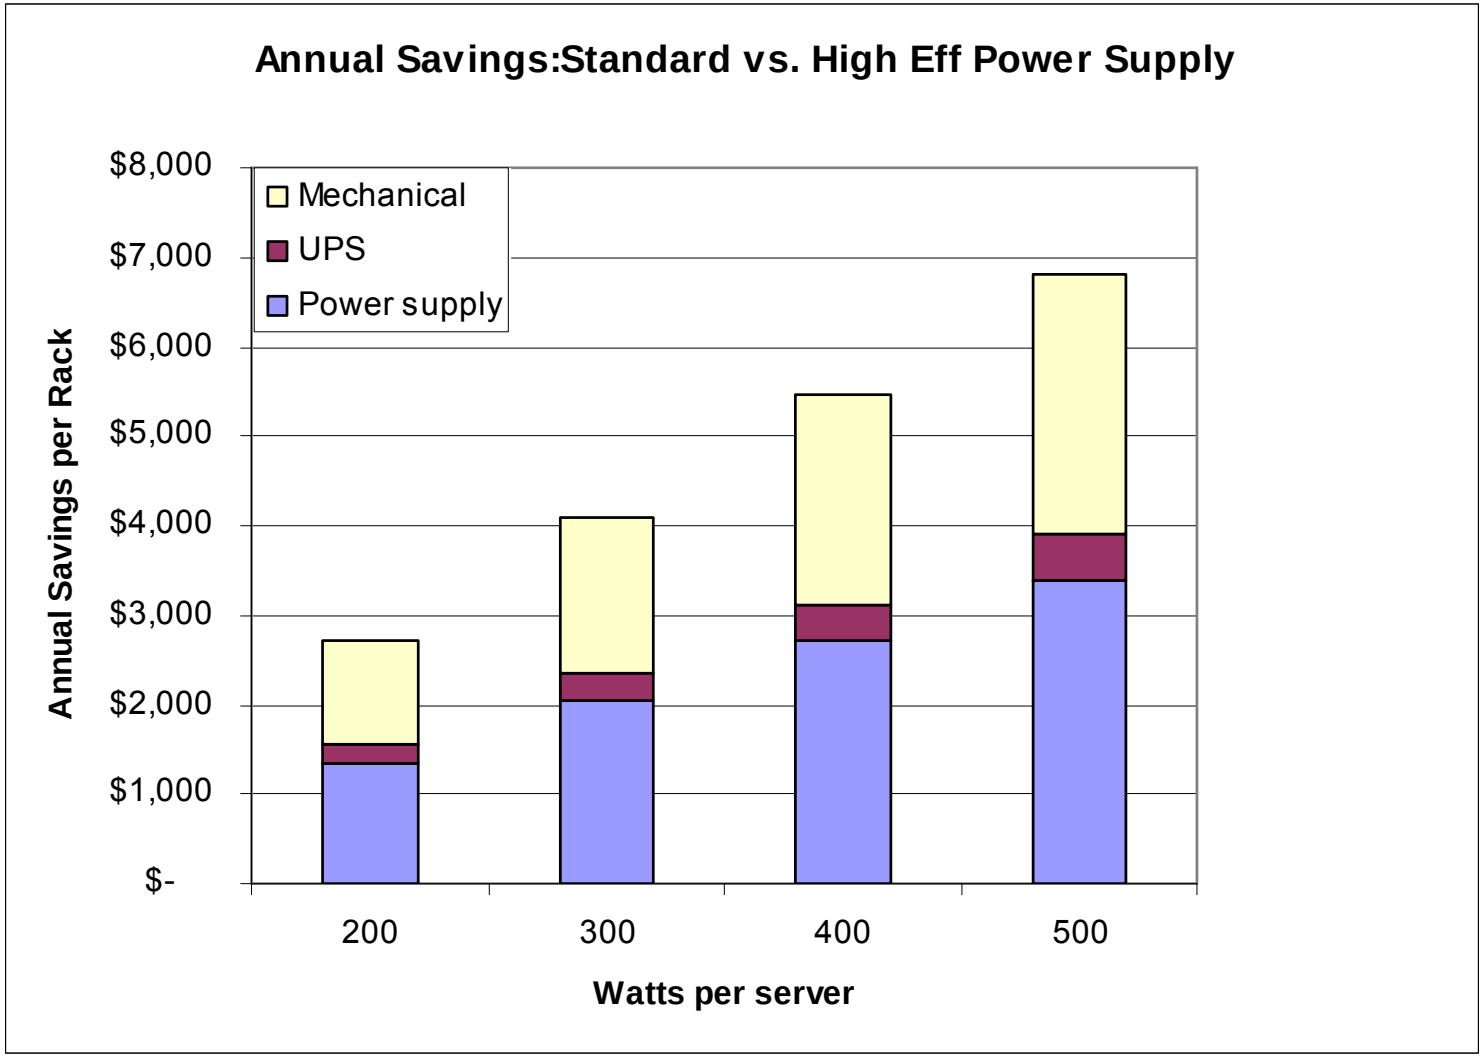

IT System Efficiency Summary…

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Servers

- Enable *power management capabilities*!
- Use EnergyStar® Servers

Power Supplies

- Reconsider Redundancy
- Use 80 PLUS or Climate Savers products

Storage Devices

- Take superfluous data offline
- Use thin provisioning technology

Consolidation

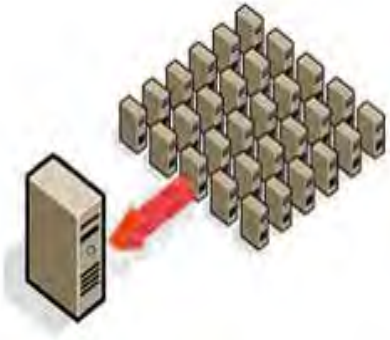

- Use virtualization
- Consider cloud services

References and Resources

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Server System Infrastructure

Managing Component Interfaces

- www.ssiforums.org
- www.80plus.org
- www.climatesaverscomputing.org
- http://tc99.ashraetcs.org/

80 PLUS

climate savers computing

ASHRAE

American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.

ASHRAE Technical Committee 9.9

Questions?

Using IT to Manage IT

Innovative Application of IT in Data Centers for Energy Efficiency

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Use IT to Manage IT Energy

Using IT to Save Energy in IT:

- Most operators lack “visibility” into their data center environment.
- An operator can’t manage what they don’t measure.
- Goals:
  - Provide the same level of monitoring and visualization of the physical space that exists for monitoring the IT environment.
  - Measure and track performance metrics.
  - Spot problems before they result in high energy cost or down time.

The Importance of Visualization

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- IT Systems & network administrators have tools for visualization.
- Useful for debugging, benchmarking, capacity planning, forensics.
- Data center facility managers have had comparatively poor visualization tools.

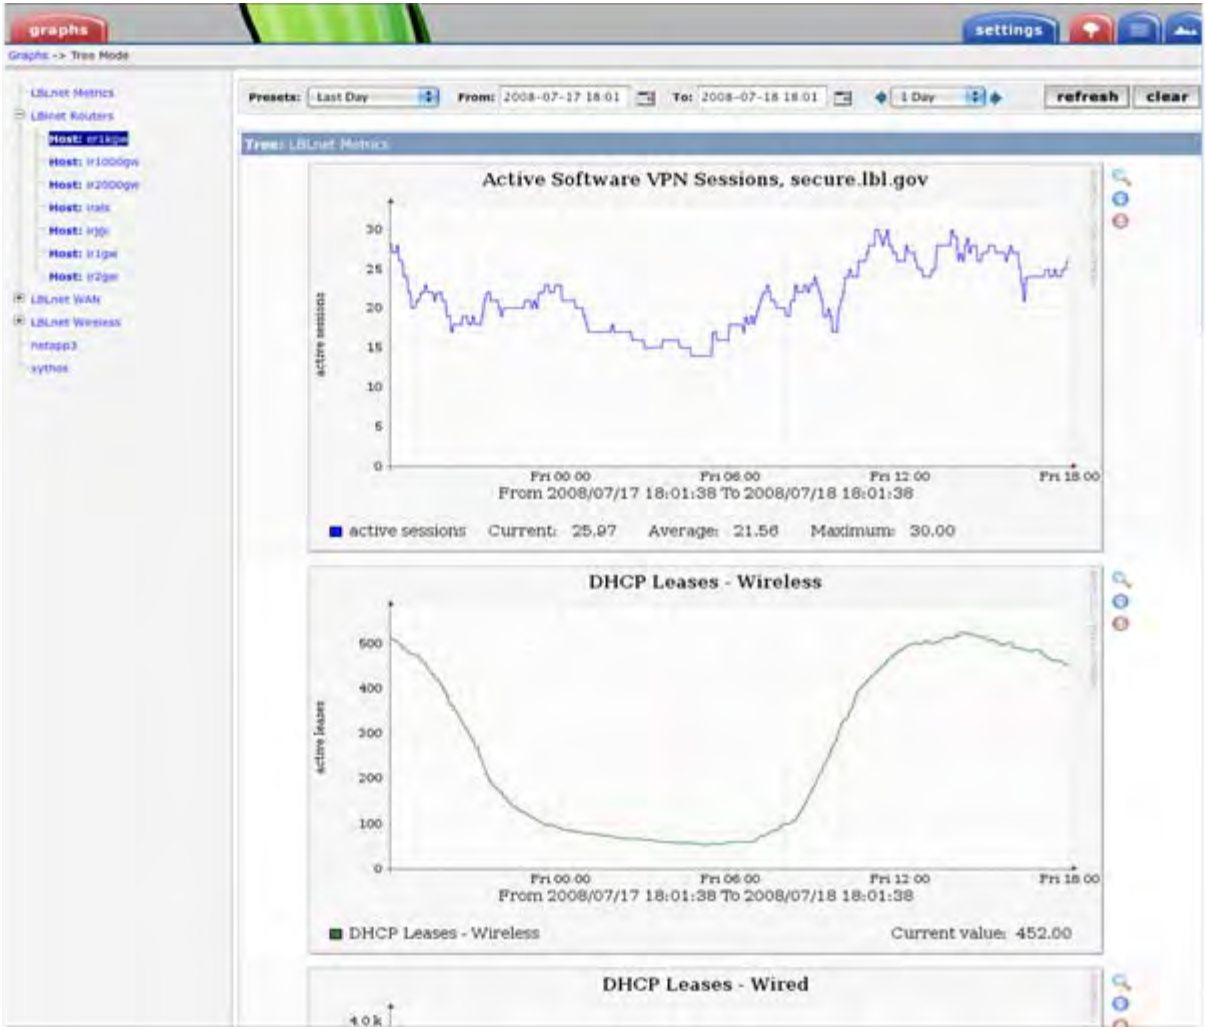

LBNL Wireless Sensor Installation

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- ✓ LBNL installed 800+ point sensor network.
- ✓ Measures:
  - Temperature
  - Humidity
  - Pressure (under floor)
  - Electrical power
- ✓ Presents real-time feedback and historic tracking
- ✓ Optimize based on empirical data, not intuition.

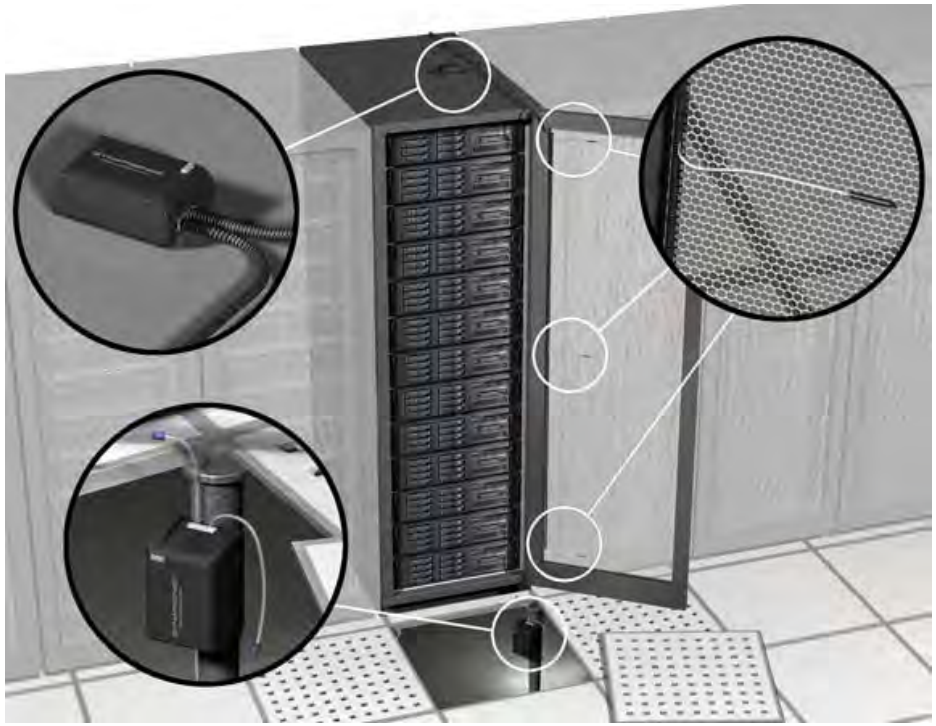

Image: SynapSense

Real-time Temperature Visualization by Level

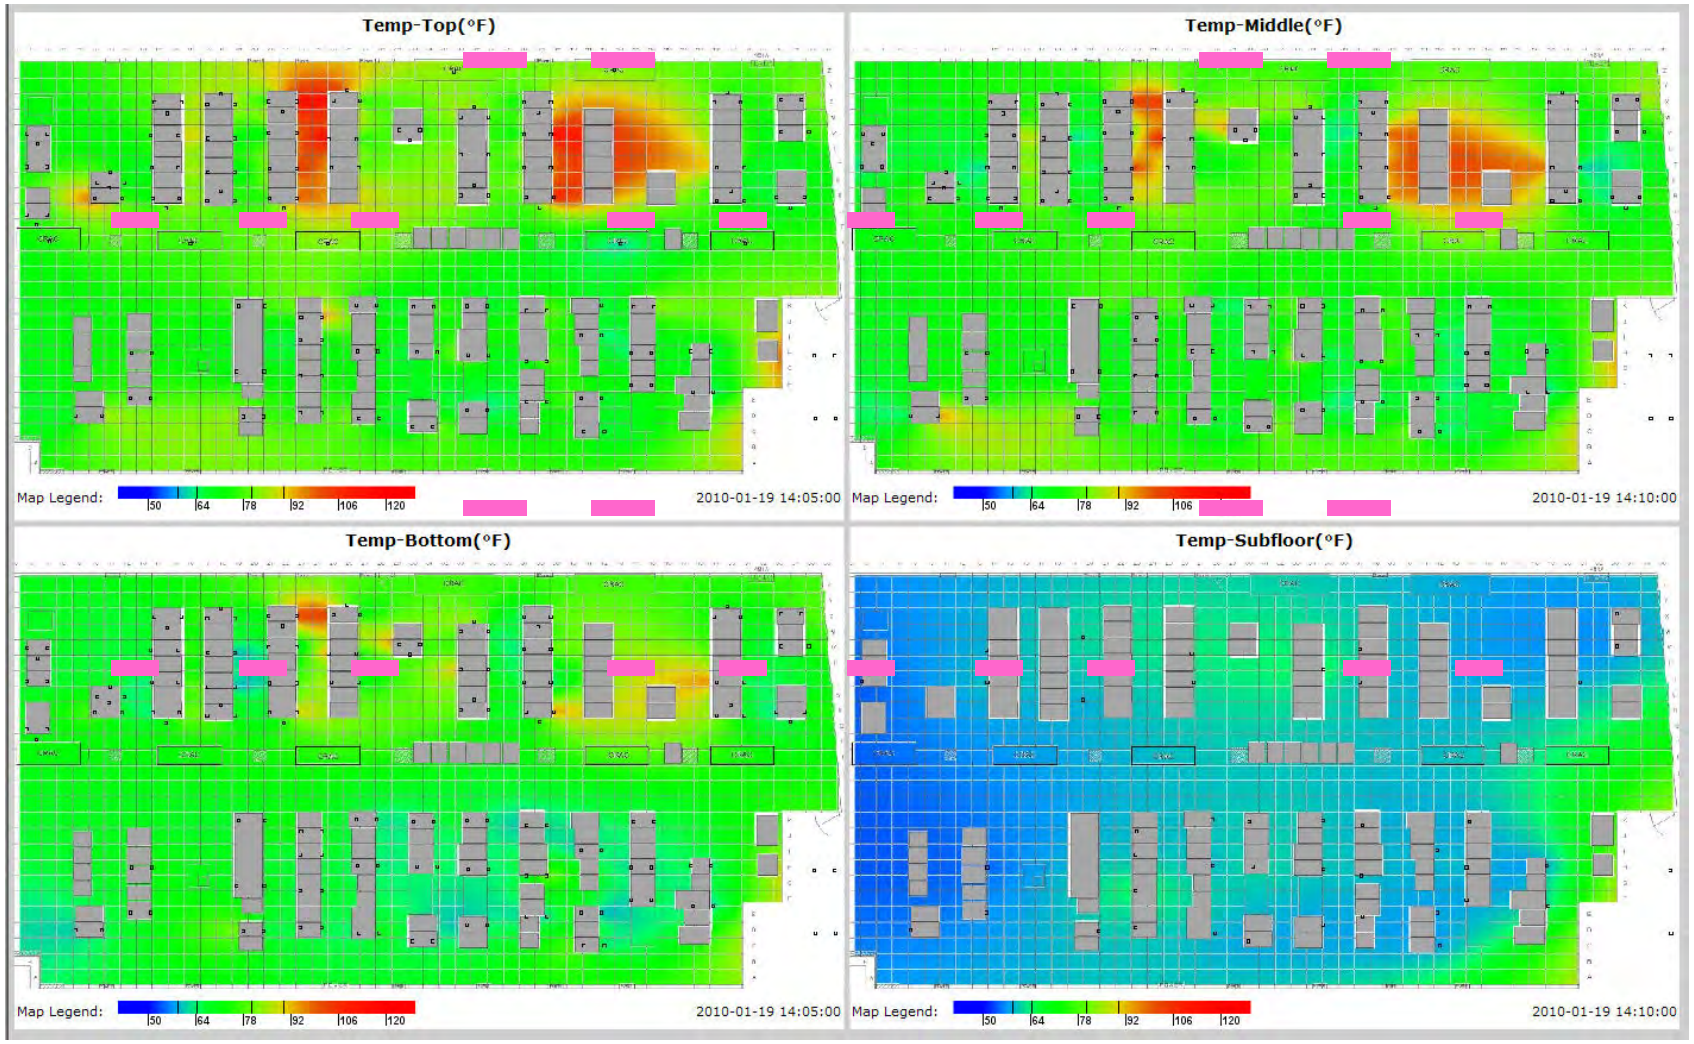

Displayed Under-floor Pressure Map…

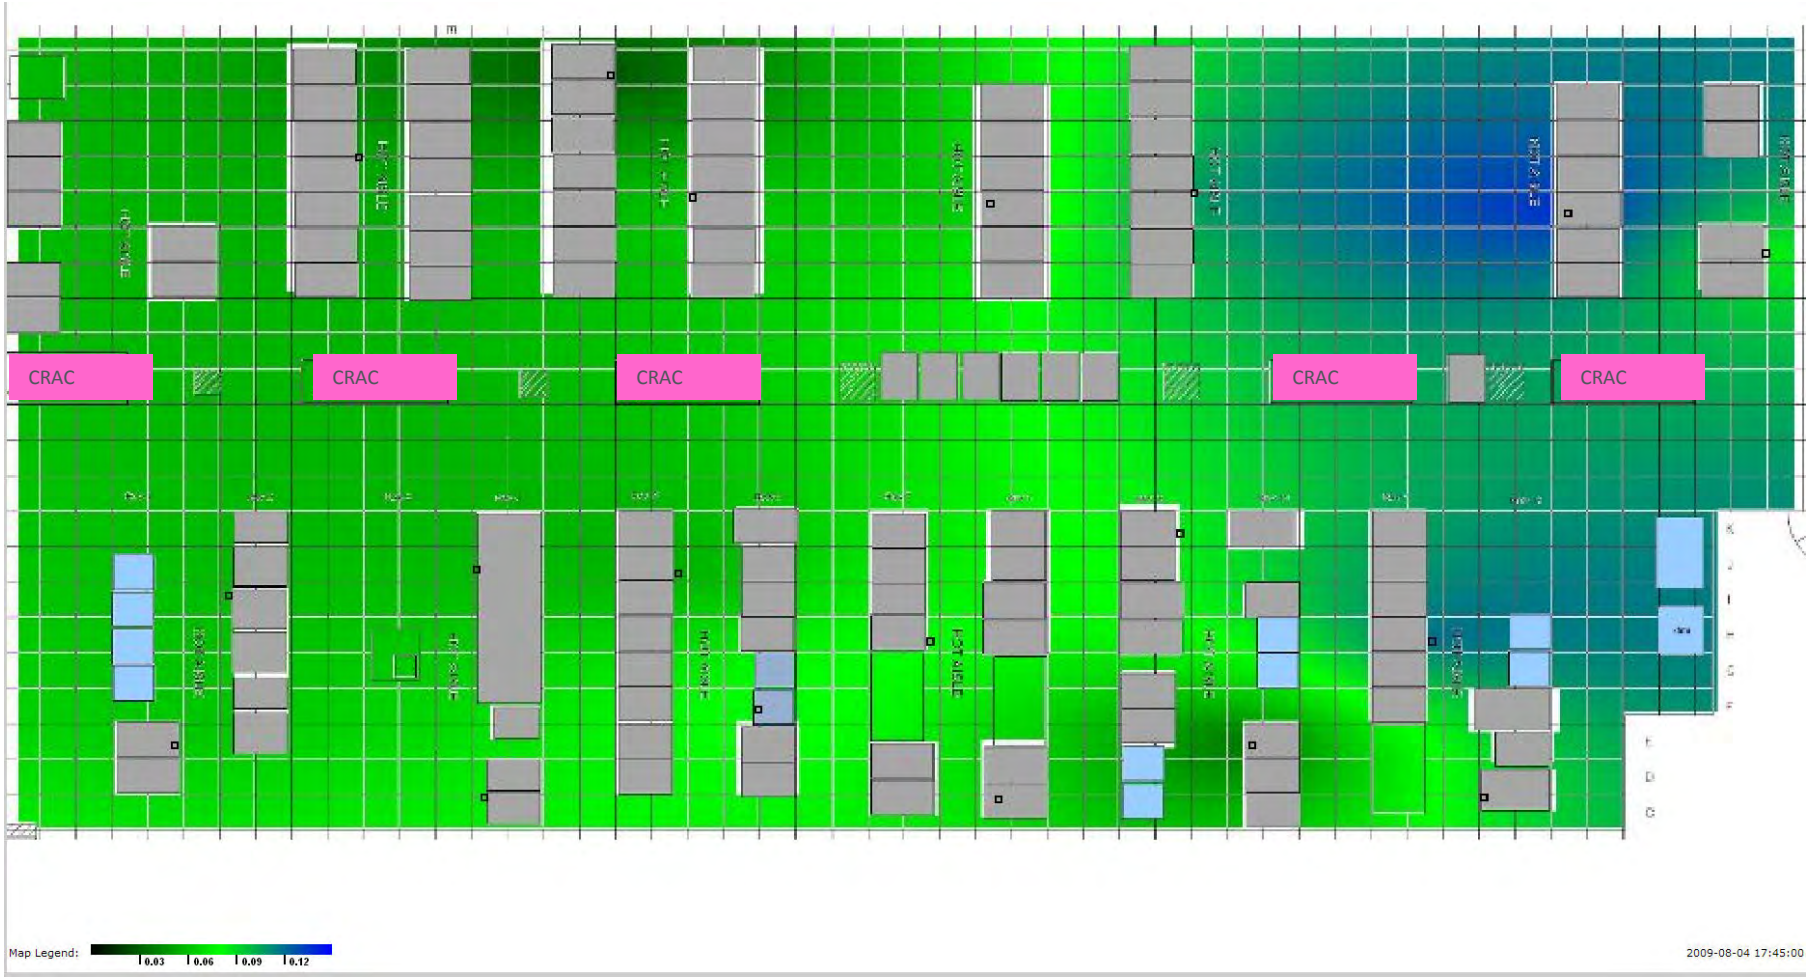

Provided Real-time Feedback During Floor-tile Tuning

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- ✓ Removed guesswork by monitoring and using visualization tool.

Under-Floor Pressure

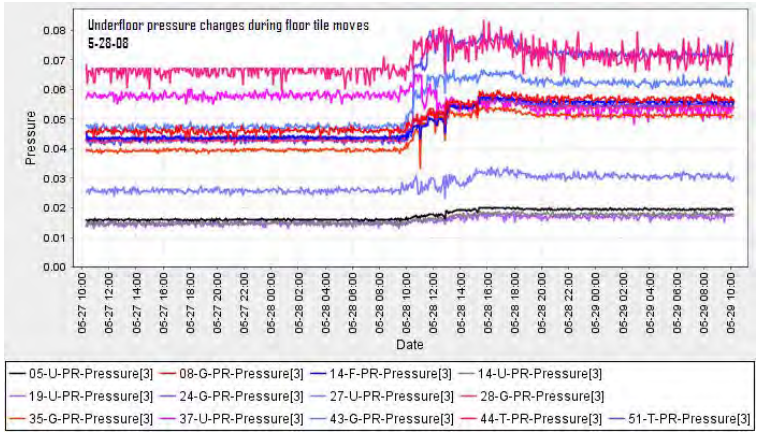

Rack-Top Temperatures

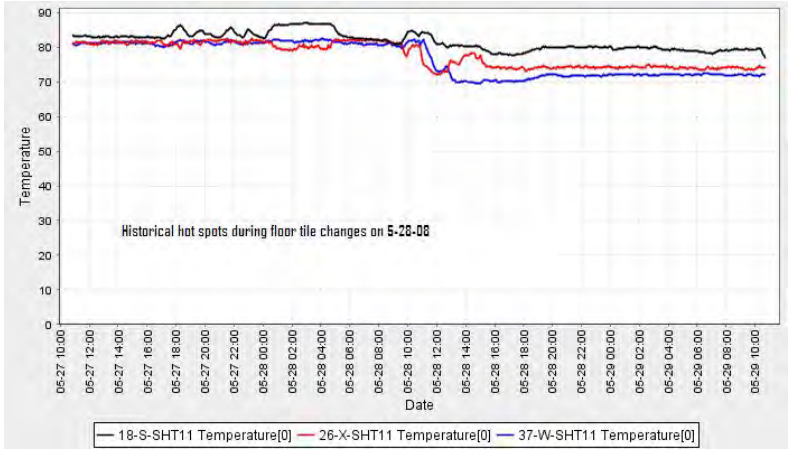

Determined Relative CRAC Cooling Energy Impact

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Enhanced knowledge of data center redundancy.
- Turned off unnecessary CRAC units to save energy.

Under-Floor Pressure

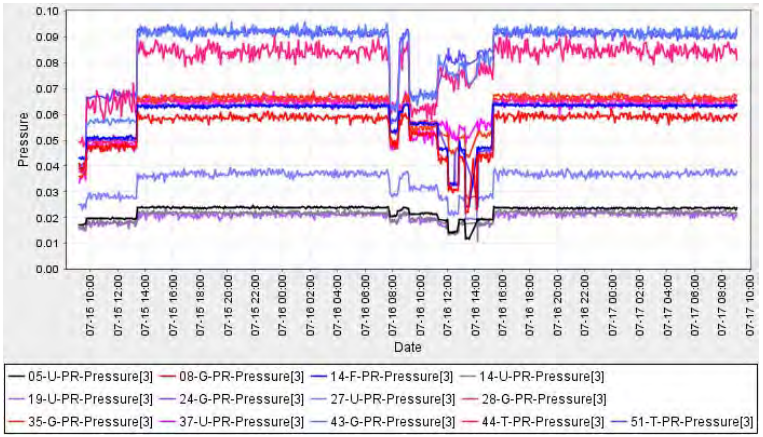

Rack-Top Temperatures

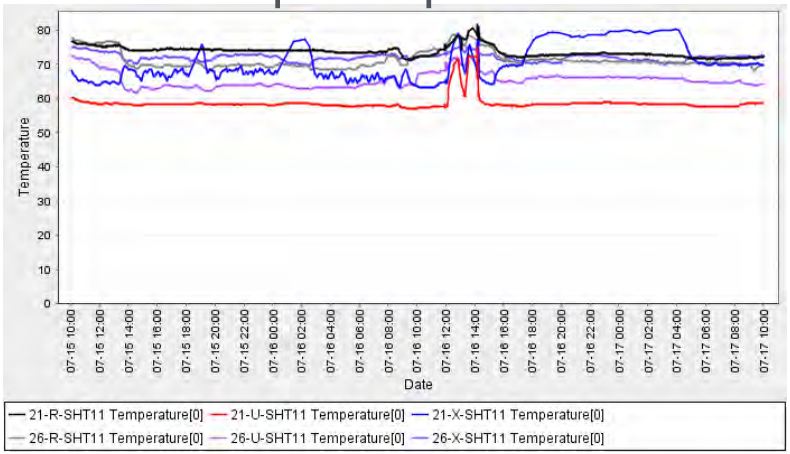

Feedback Continues to Help: Note impact of IT cart!

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Real-time feedback identified cold aisle air flow obstruction!

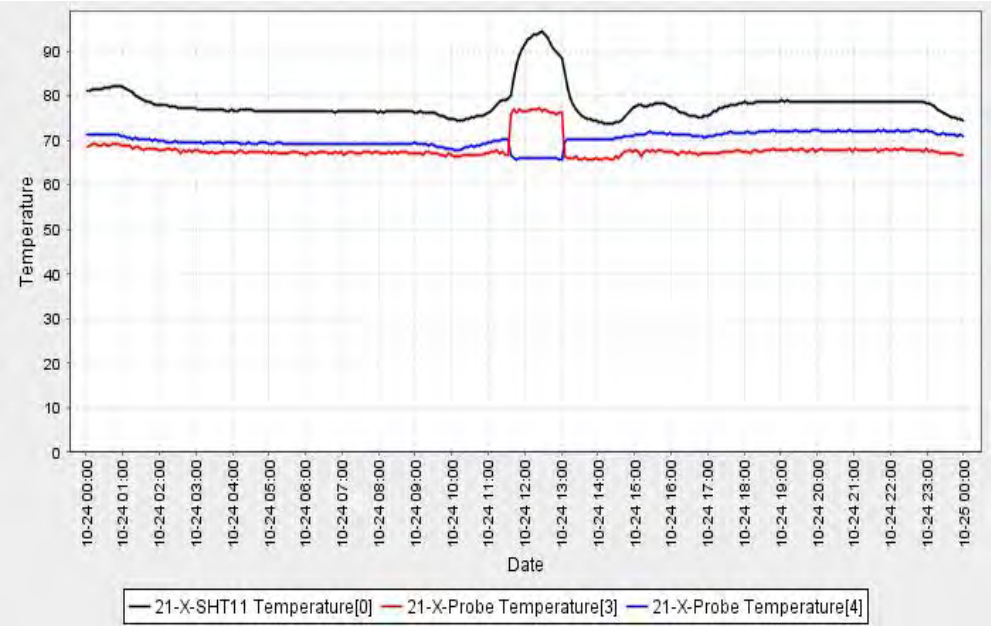

Real-time PUE Display

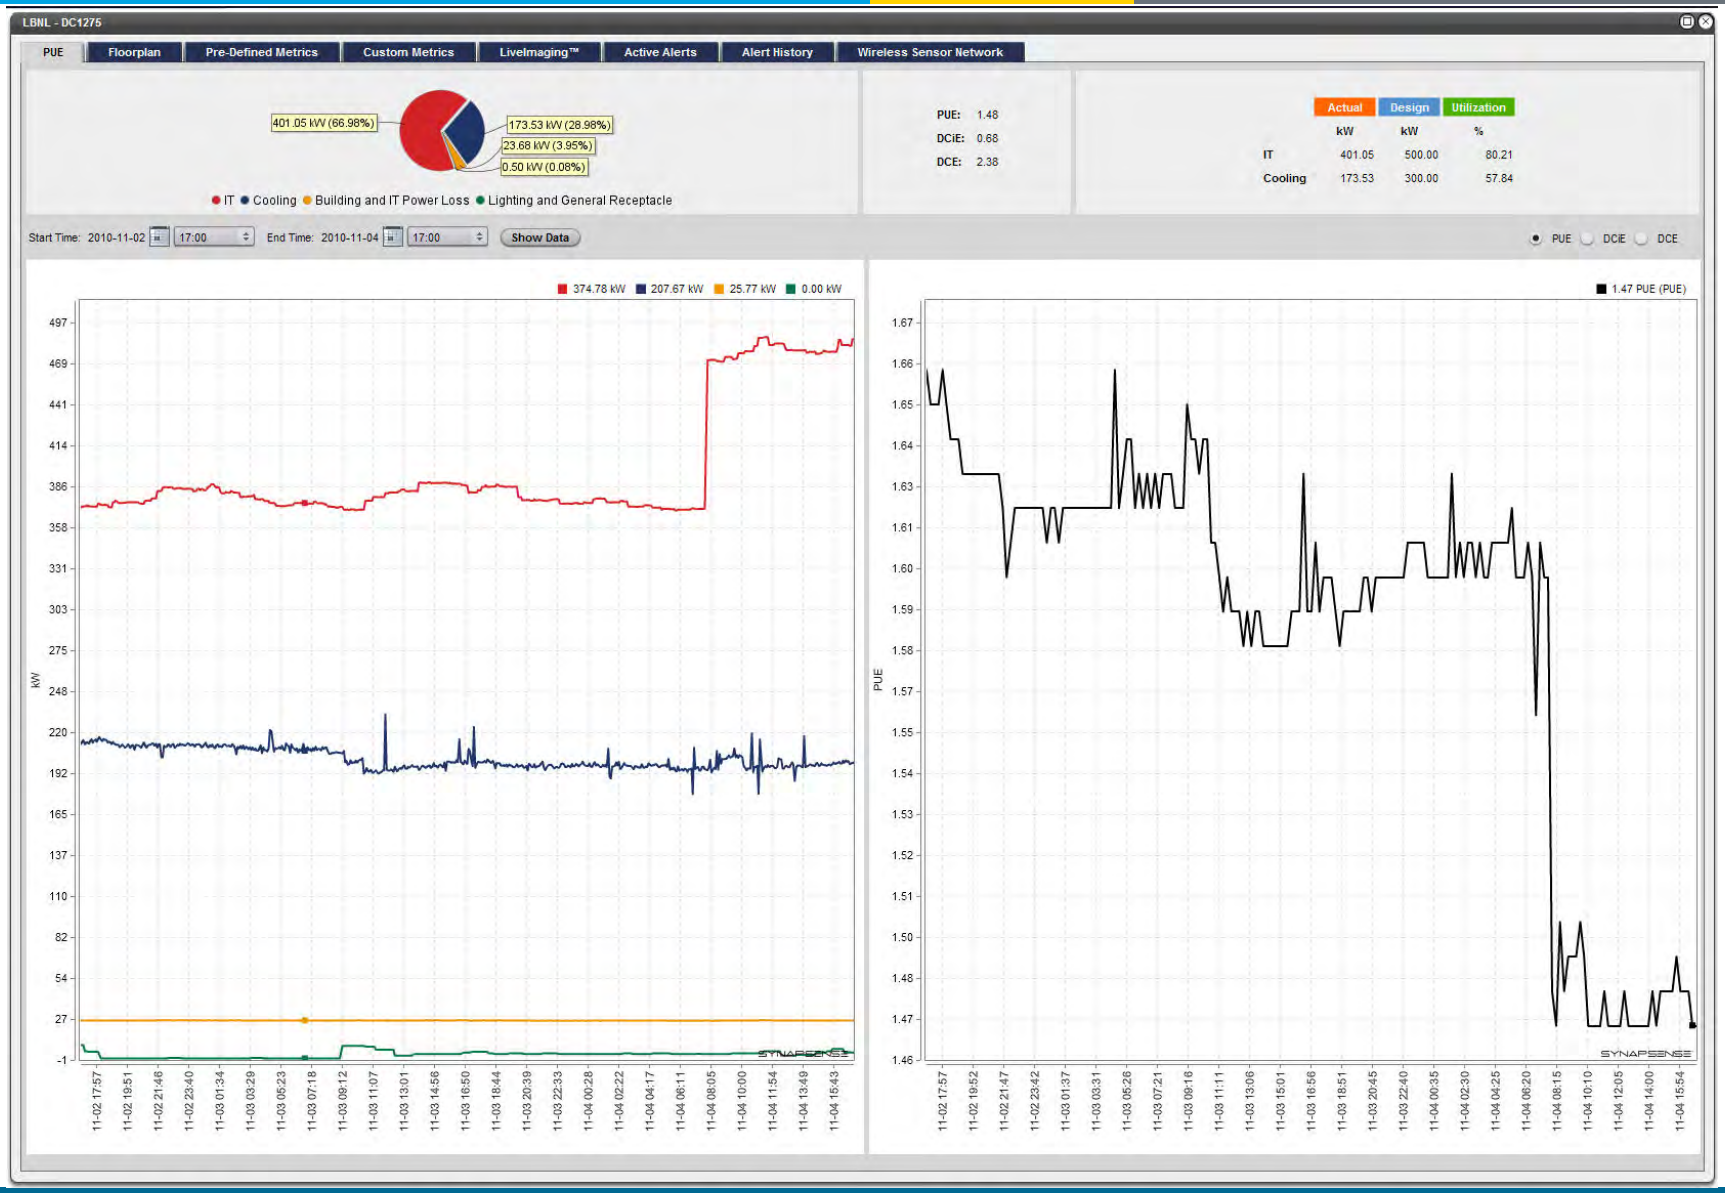

PUE Calculation Diagram

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Franchise Tax Board (FTB) Case Study

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Description:

- 10,000 Sq Ft
- 12 CRAH cooling units
- 135 kW load

Challenges:

- Over-provisioned
- History of fighting
- Manual shutoff not successful

Solution:

- Intelligent supervisory control software with inlet air sensing

FTB Wireless Sensor Network

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- **WSN included 50 wireless temperature sensors (Dust Networks radios)**
- **Intelligent control software**

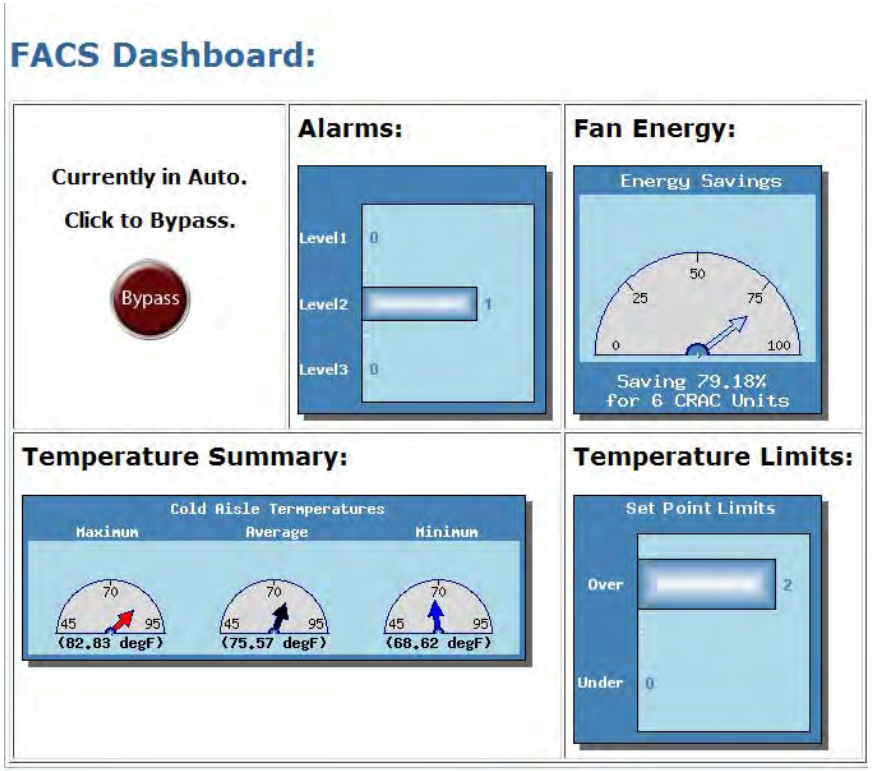

WSN Smart Software: learns about curtains

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

CRAH 3 influence at start

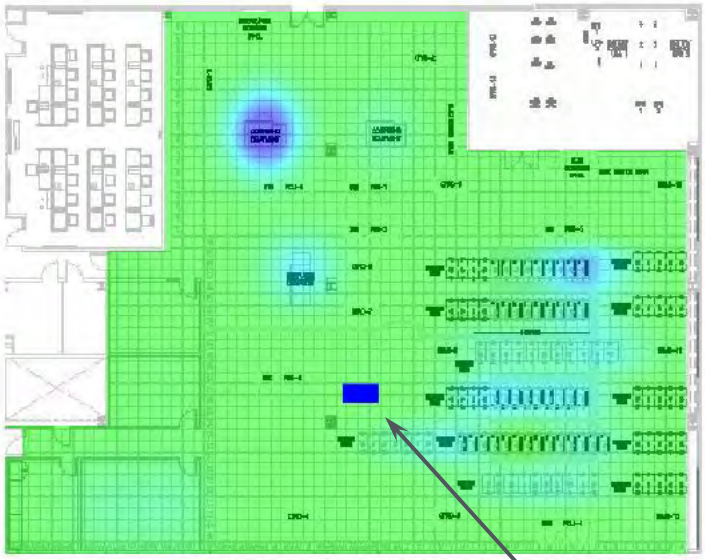

CRAH 3 influence after curtains

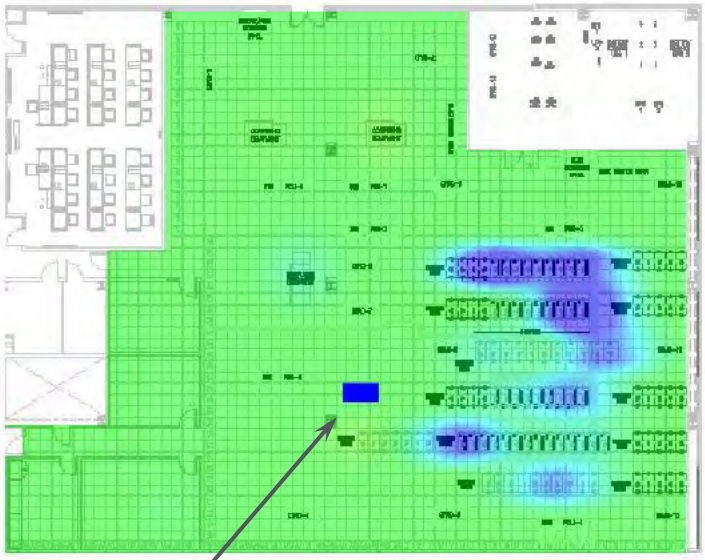

CRAH-03

WSN Provided Effect on Cold-aisle Temperatures:

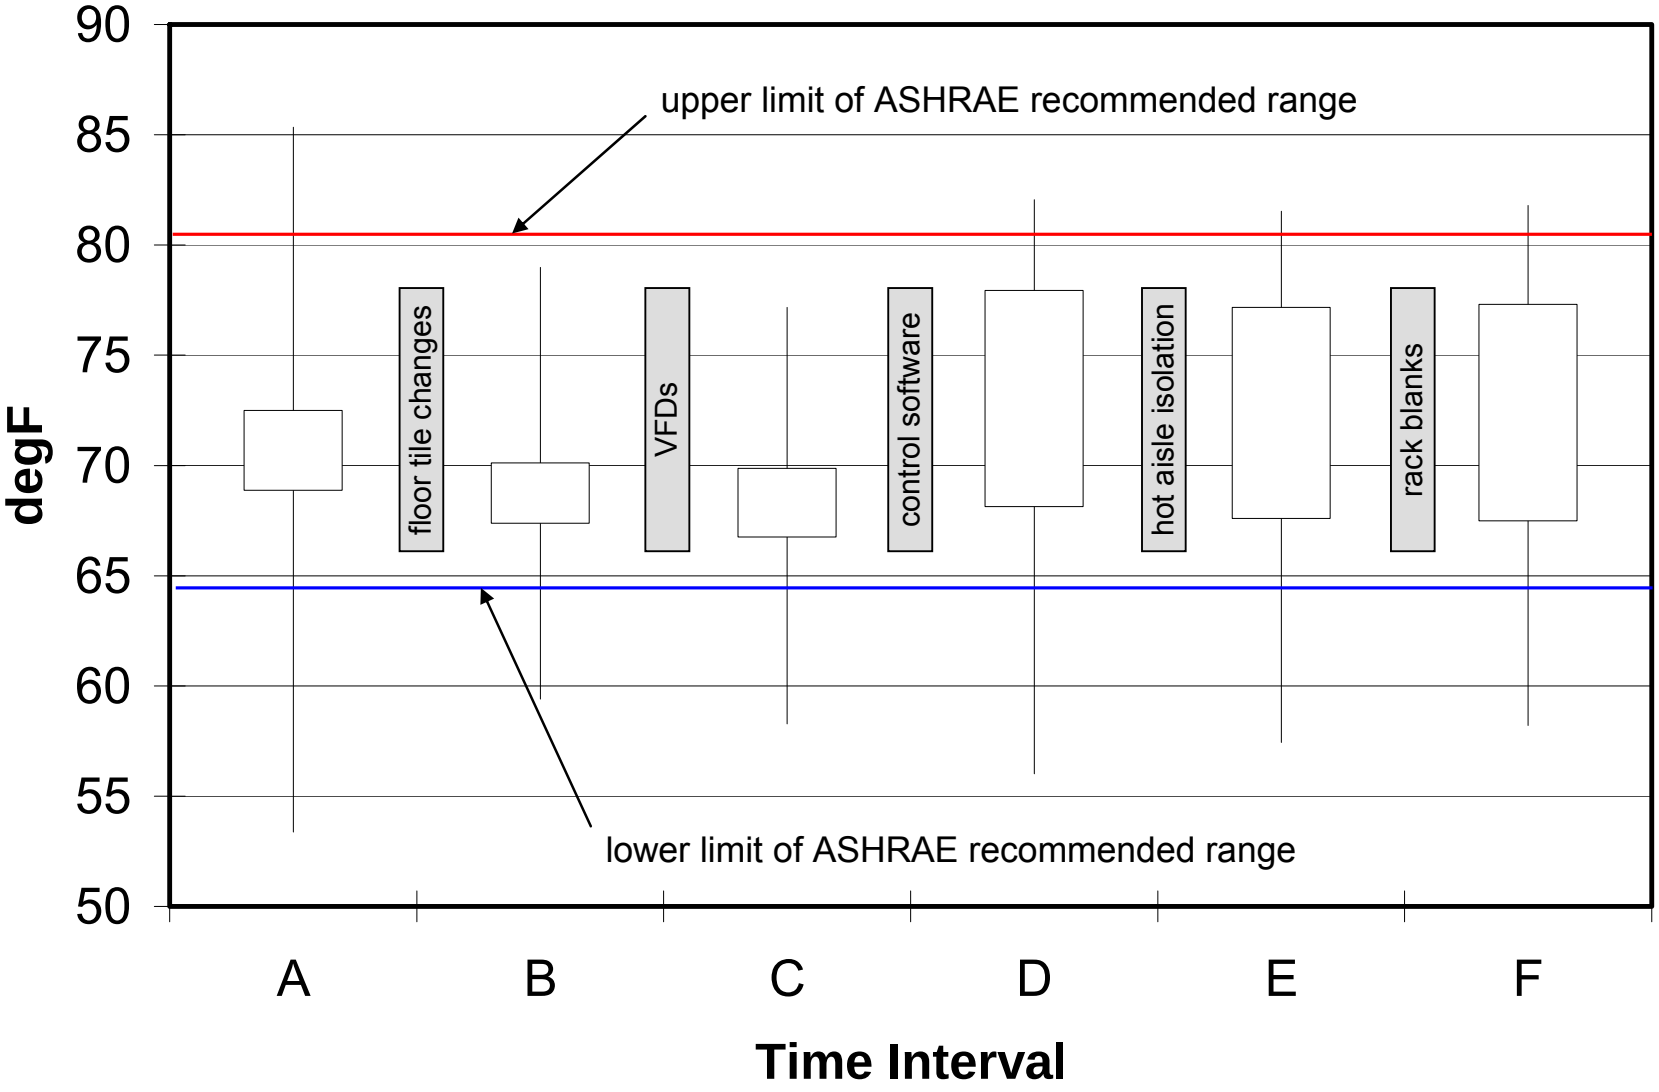

WSN Software = Dramatic Energy Reduction…

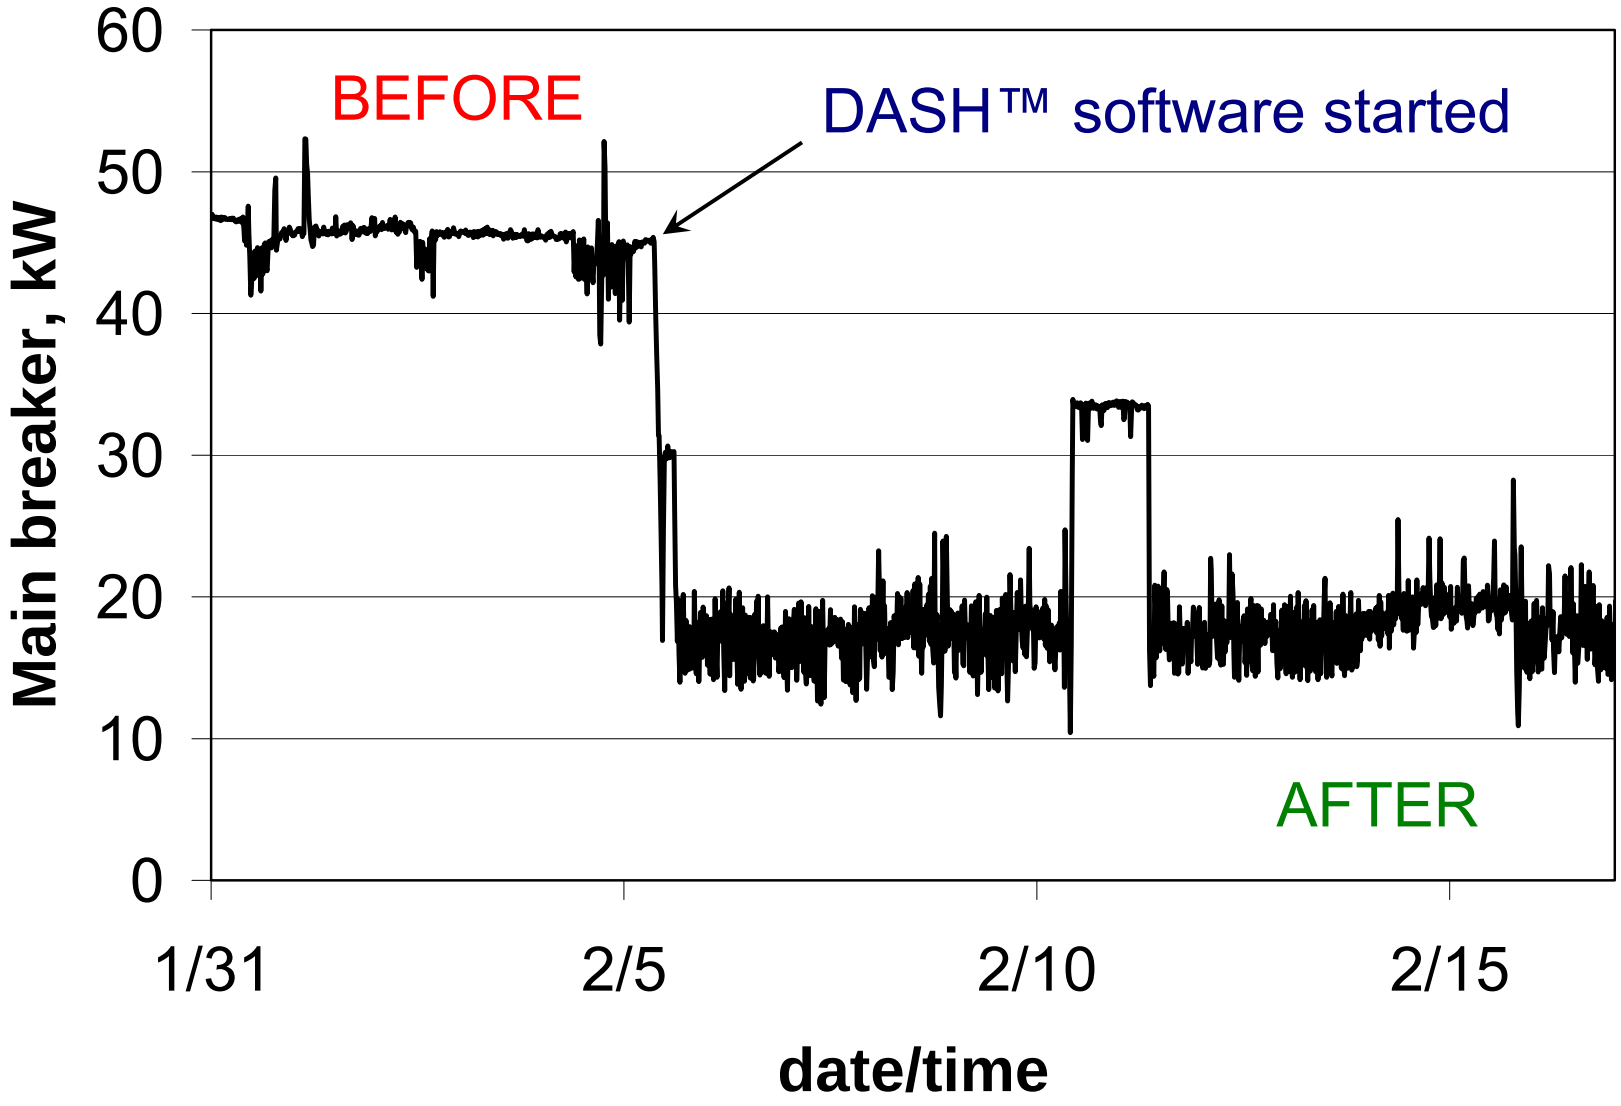

Cost-Benefit Analysis:

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- DASH cost-benefit (sensors and software)
  - Cost: $56,824
  - Savings: $30,564
  - Payback: 1.9 years

- Total project cost-benefit
  - Cost: $134,057
  - Savings: $42,772
  - Payback: 3.1 years

An Emerging Technology…

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Control data center air conditioning using the *built-in* IT server-equipment temperature sensors

Intel Demonstration

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- **Typically**, data center cooling devices use *return air temperature* as the primary control-variable
  - ASHRAE and IT manufacturers agree IT equipment inlet air temperature is the key operational parameter
  - Optimum control difficult
- Server inlet air temperature is available from ICT network
  - Intelligent Platform Management Interface (IPMI) or
  - Simple network management protocol (SNMP)

Intel Data Center HVAC:

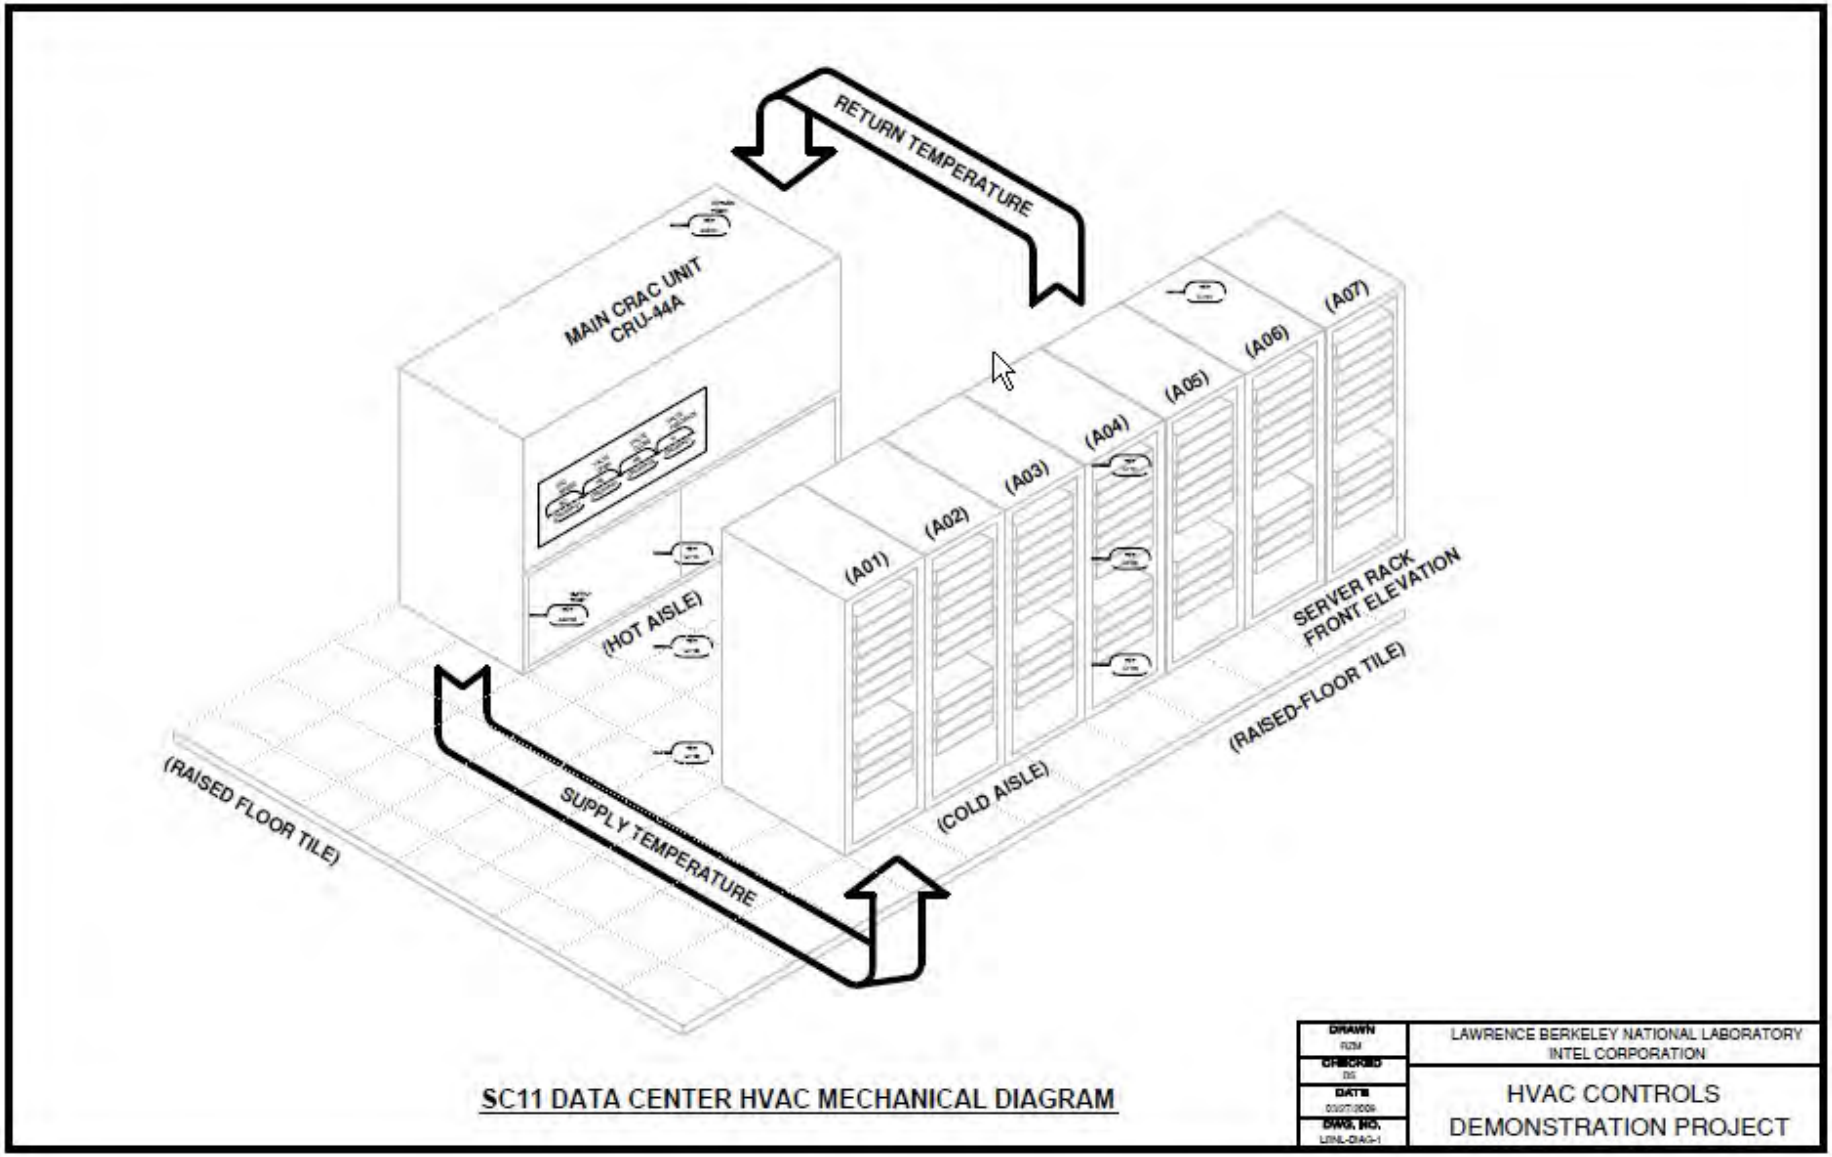

Intel Demonstration

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Demonstration showed:
  - Servers can provide temperature data to facilities control system
  - Given server inlet temperature, facility controls improved temperature control and efficiency
  - Effective communications and control accomplished without significant interruption or reconfiguration of systems

Dashboards

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Dashboards can display multiple systems' information for monitoring and maintaining data center performance

Why Dashboards?

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Provide IT and HVAC system performance at a glance
- Identify operational problems
- Baseline energy use and benchmark performance
- View effects of changes
- Share information and inform integrated decisions

Another Dashboard Example…

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

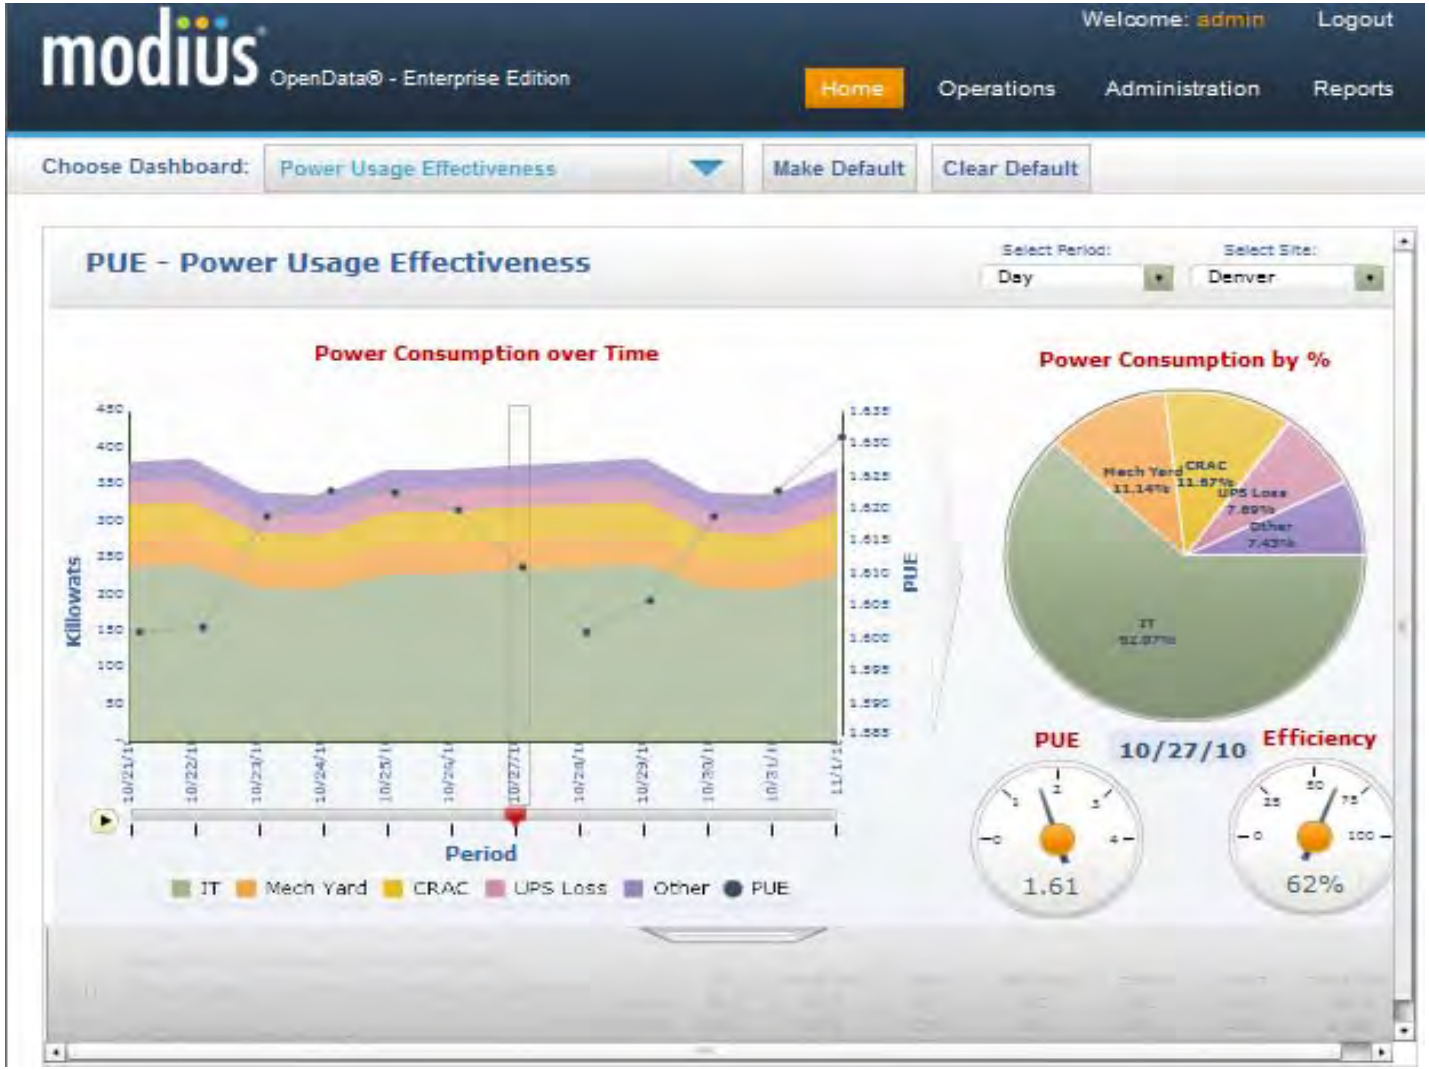

Use IT to Manage IT: Summary

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- **Evaluate monitoring systems to enhance operations and controls**
- **Install dashboards to manage and sustain energy efficiency.**

Questions?

Environmental Conditions

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Environmental Conditions

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

What are the main HVAC Energy Drivers?

- IT Load
- Climate
- **Room temperature and humidity**
  - **Most data centers are overcooled and have humidity control issues**
  - **Human comfort should not be a driver**

Equipment Environmental Specification

<u>Air Inlet</u> to IT Equipment **is** the important specification to meet

Outlet temperature is *not* important to IT Equipment

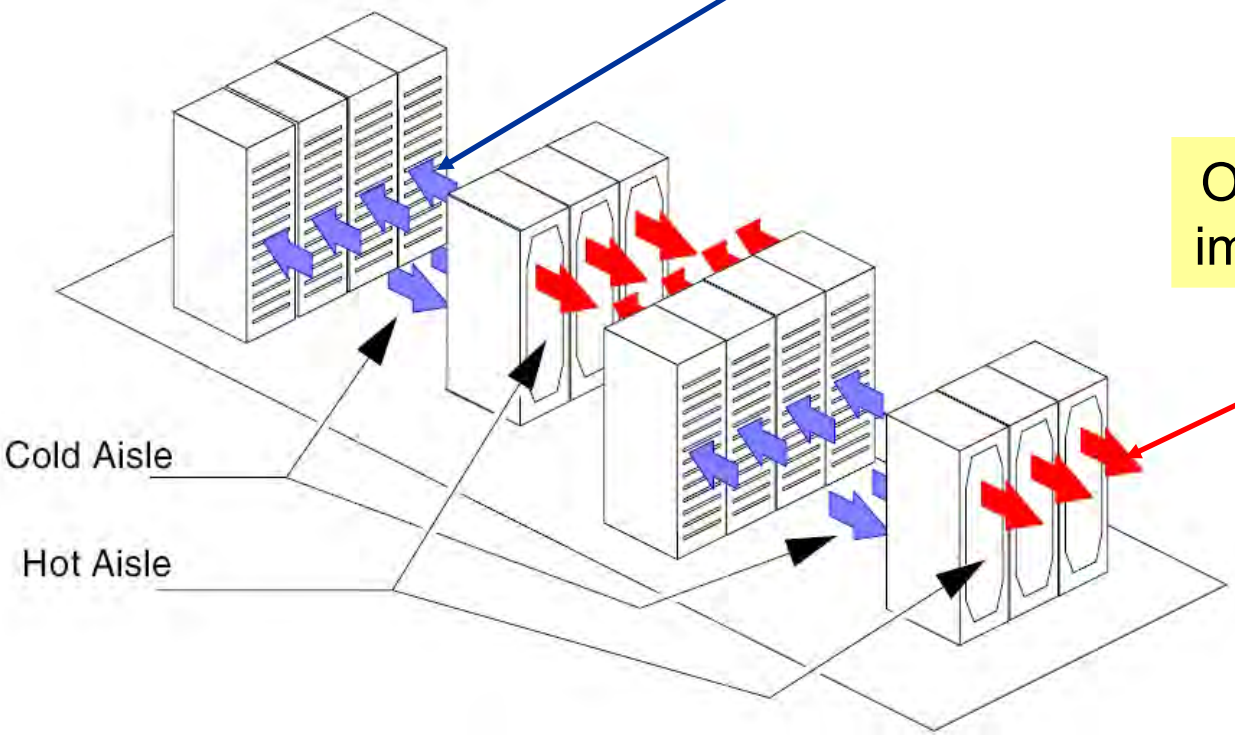

Environmental Conditions

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

ASHRAE's Thermal Guidelines:

- Provide common understanding between IT and facility staff.
- Endorsed by IT manufacturers
- Enables large energy savings - especially when using economizers.
- Recommends temperature range of 18˚C to 27˚C (80.6°F) with "allowable" much higher
- New (2011) ASHRAE Guidelines
  - Six classes of equipment identified with wider allowable ranges from 32° C to 45° C (113°F).
  - Provides more justification for operating above the recommended limits (in the allowable range)
  - Provides wider humidity ranges

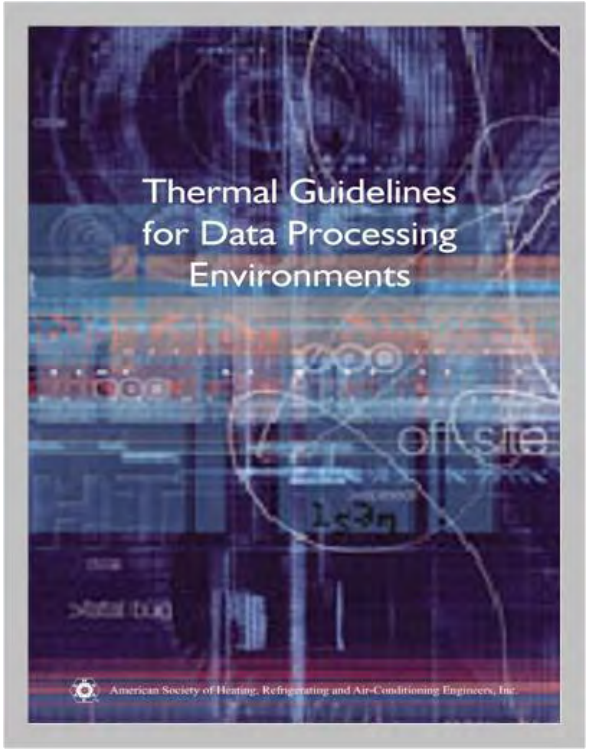

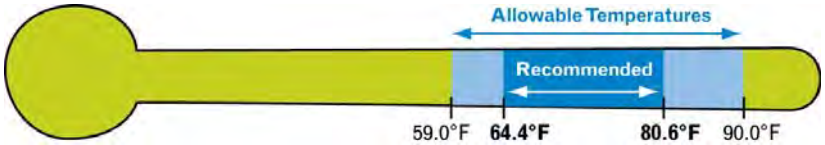

Purpose of the Ranges

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- The recommended range is a statement of reliability. For extended periods of time, the IT manufacturers recommend that data centers maintain their environment within these boundaries.

- The allowable range is a statement of functionality. These are the boundaries where IT manufacturers test their equipment to verify that the equipment will function.

2011 ASHRAE Thermal Guidelines

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Classes (a)	Equipment Environmental Specifications							
	Product Operations (b)(c)					Product Power Off (c) (d)		
	Dry-Bulb Temperature (˚C) (e) (g)	Humidity Range, non-Condensing (h) (i)	Maximum Dew Point (˚C)	Maximum Elevation (m)	Maximum Rate of Change(˚C/hr) (f)	Dry-Bulb Temperature (˚C)	Relative Humidity (%)	Maximum Dew Point (˚C)
Recommended (Applies to all A classes; individual data centers can choose to expand this range based upon the analysis described in this document)								
A1 to A4	18 to 27	5.5ºC DP to 60% RH and 15ºC DP						
Allowable								
A1	15 to 32	20% to 80% RH	17	3050	5/20	5 to 45	8 to 80	27
A2	10 to 35	20% to 80% RH	21	3050	5/20	5 to 45	8 to 80	27
A3	5 to 40	-12˚C DP & 8% RH to 85% RH	24	3050	5/20	5 to 45	8 to 85	27
A4	5 to 45	-12˚C DP & 8% RH to 90% RH	24	3050	5/20	5 to 45	8 to 90	27
B	5 to 35	8% RH to 80% RH	28	3050	NA	5 to 45	8 to 80	29
C	5 to 40	8% RH to 80% RH	28	3050	NA	5 to 45	8 to 80	29

2011 Thermal Guidelines for Data Processing Environments – Expanded Data Center Classes and Usage Guidance. White paper prepared by ASHRAE Technical Committee TC 9.9

2011 ASHRAE Allowable Ranges

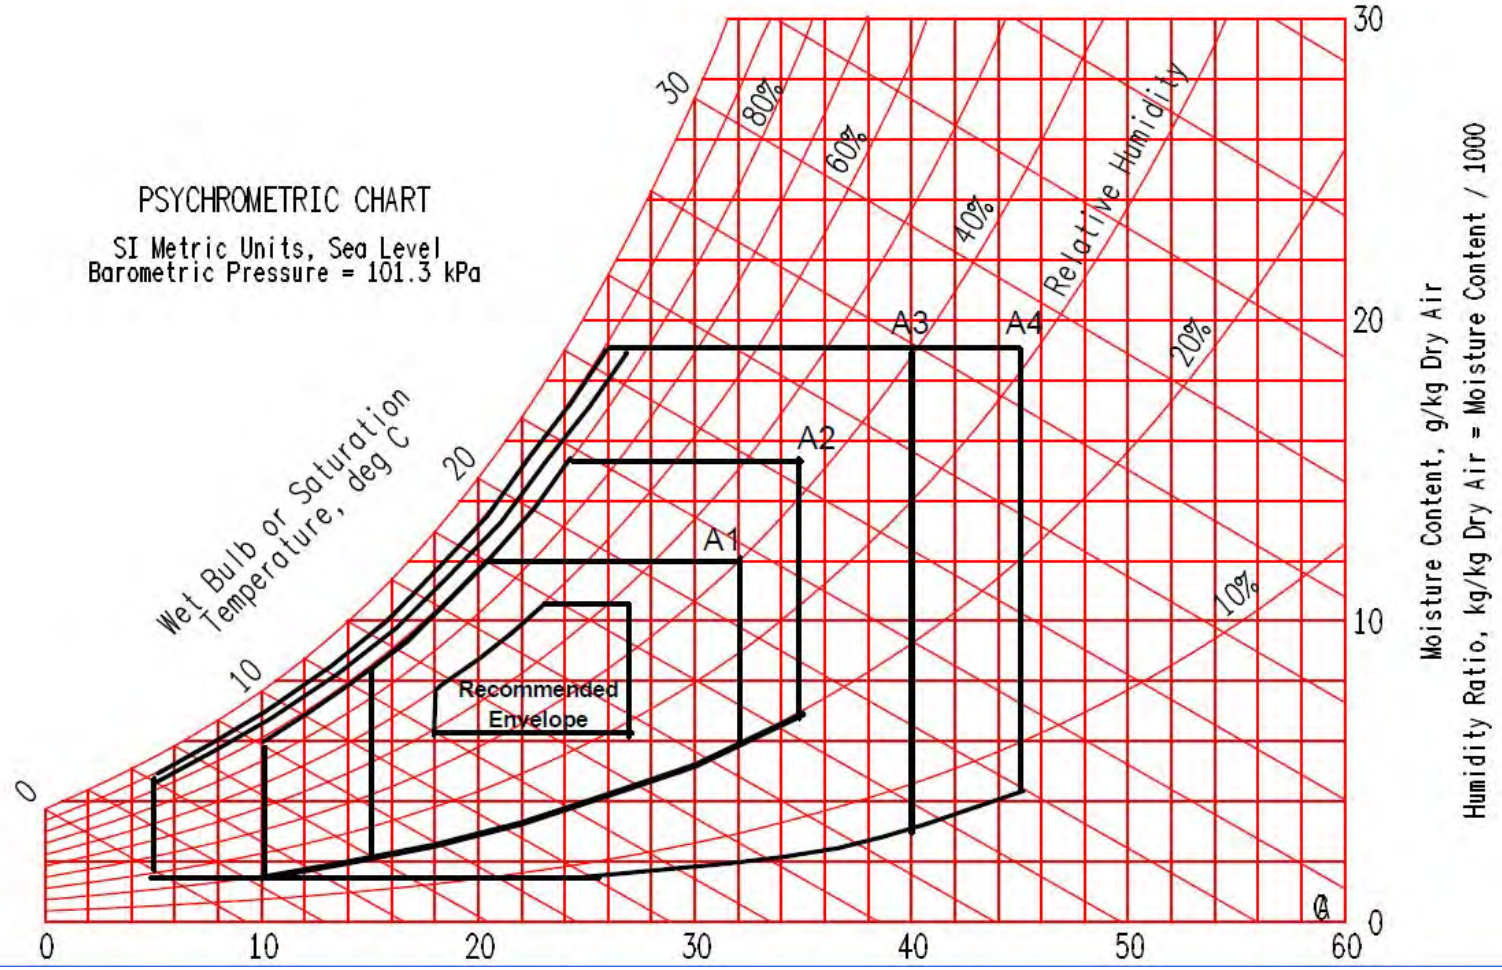

Dry Bulb Temperature

2011 ASHRAE Thermal Guidelines

ASHRAE's key conclusion when considering potential for increased failures at higher (allowable) temperatures:

"For a majority of US and European cities, the air-side and water-side economizer projections show failure rates that are very comparable to a traditional data center run at a steady state temperature of 20°C."

ASHRAE Liquid Cooling Guidelines

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

ASHRAE and a DOE High Performance Computer (HPC) user group have developing a white paper for liquid cooling

- Three temperature standards defined based on three mechanical system configurations:
  - Chilled water provided by a chiller (with or without a “tower side economizer”
  - Cooling water provided a cooling tower with possible chiller backup
  - Cooling water provided by a dry cooler with possible backup using evaporation

Summary Recommended Limits

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Liquid Cooling Class	Main Cooling Equipment	Supplemental Cooling Equipment	Building Supplied Cooling Liquid Maximum Temperature
L1	Cooling Tower and Chiller	Not Needed	17°C (63°F)
L2	Cooling Tower	Chiller	32°C (89°F)
L3	Dry Cooler	Spray Dry Cooler, or Chiller	43°C (110°F)

Example Server Specification

Environmental

Temperature:

- Operating: 10° to 35°C (50° to 95°F)
- Storage: -40° to 65°C (-40° to 149°F)

Relative humidity

- Operating: 20% to 80% (non-condensing)
- Storage: 5% to 95% (non-condensing)

Altitude

- Operating: -15 to 3048 m (-50 to 10,000 ft)
- Storage: -15 to 10,668 m (-50 to 35,000 ft)

Environmental Conditions: Summary

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Most computer room air conditioners (CRACs) are controlled based on the <u>return</u> air temperature – *this needs to change*
- A cold data center = efficiency opportunity
- Perceptions, based on old technology lead to cold data centers with tight humidity ranges – *this needs to change*.
- Many IT manufacturers design for harsher conditions than ASHRAE guidelines
- Design Data Centers for IT equipment performance - *not people comfort*.
- **Address air management issues first**

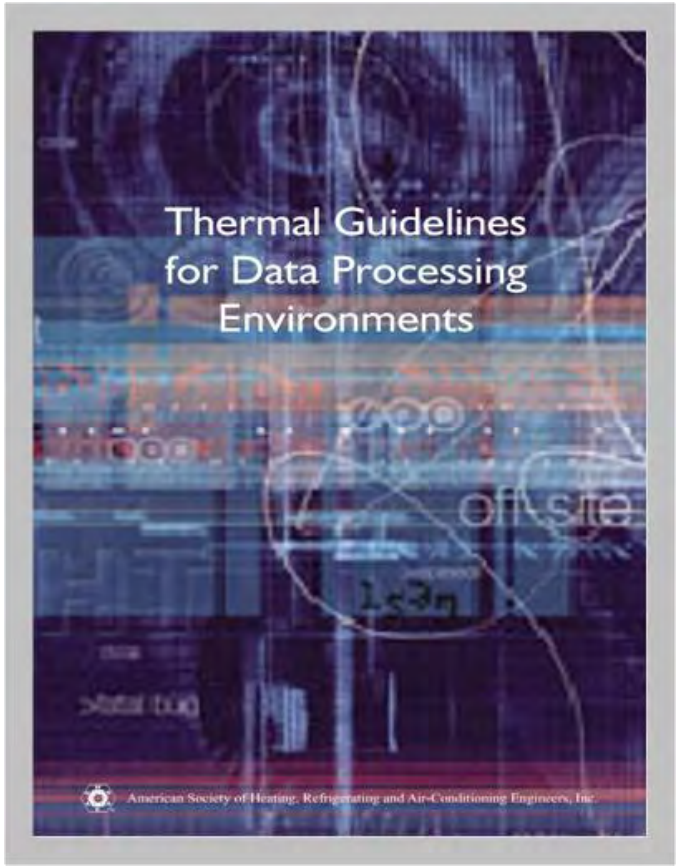

Questions?

Airflow Management

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Air Management: The Early Days at LBNL

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

It was cold but hot spots were everywhere

Fans were used to redirect air

High flow tiles reduced air pressure

Air Management

- Typically, more air circulated than required
- Air mixing and short circuiting leads to:
  - Low supply temperature
  - Low Delta T
- Use hot and cold aisles
- Improve isolation of hot and cold aisles
  - Reduce fan energy
  - Improve air-conditioning efficiency
  - Increase cooling capacity

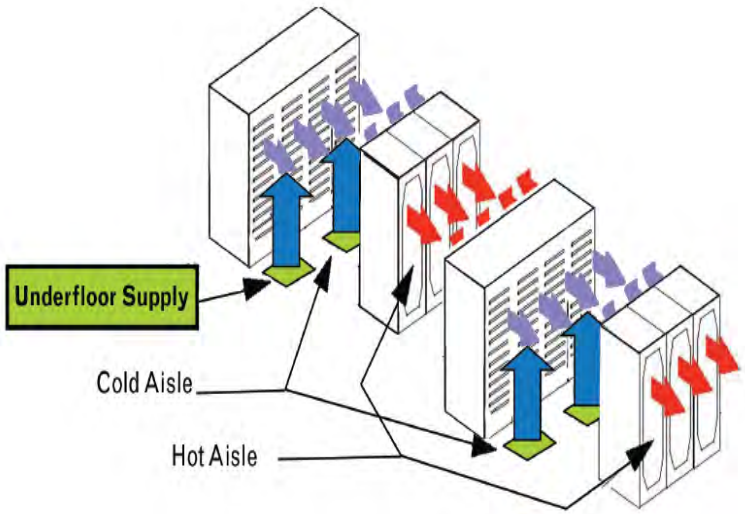

Hot aisle / cold aisle configuration decreases mixing of intake & exhaust air, promoting efficiency.

Benefits of Hot- and Cold-aisles

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- **Improves equipment intake air conditions by separating cold from hot airflow.**

Preparation:

✓Arranging racks with alternating hot and cold aisles.

✓Supply cold air to front of facing servers.

✓Hot exhaust air exits into rear aisles.

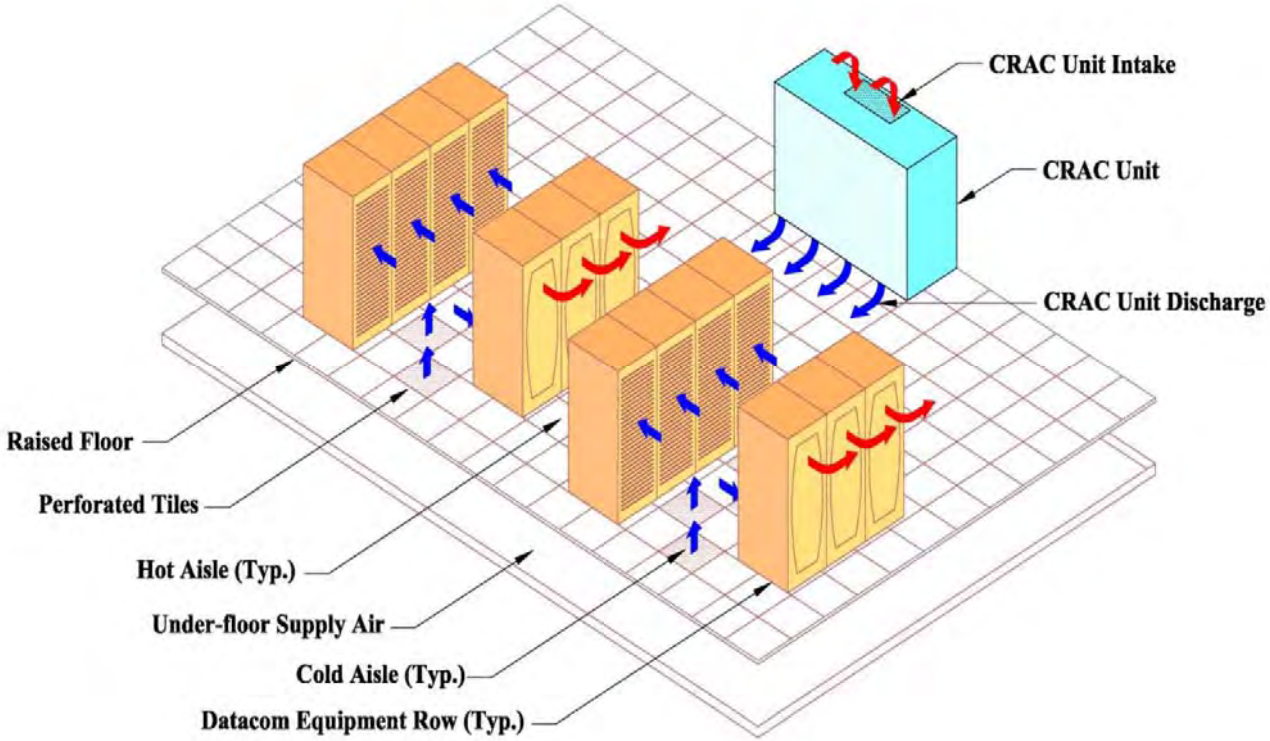

Graphics courtesy of DLB Associates

Reduce Bypass and Recirculation

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Bypass Air / Short-Circuiting…

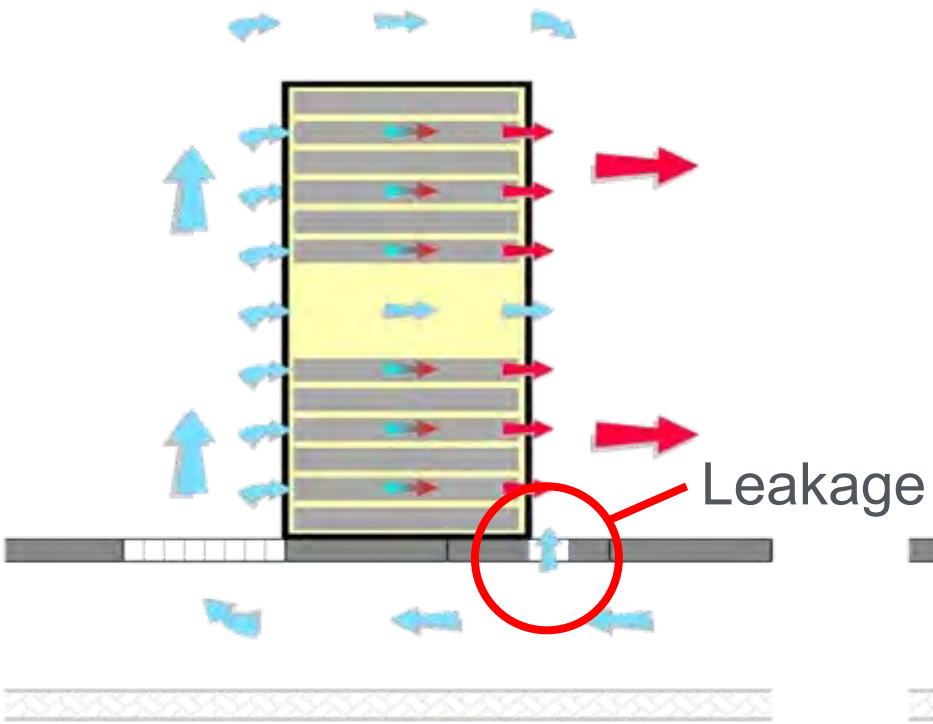

Wastes cooling capacity.

Recirculation…

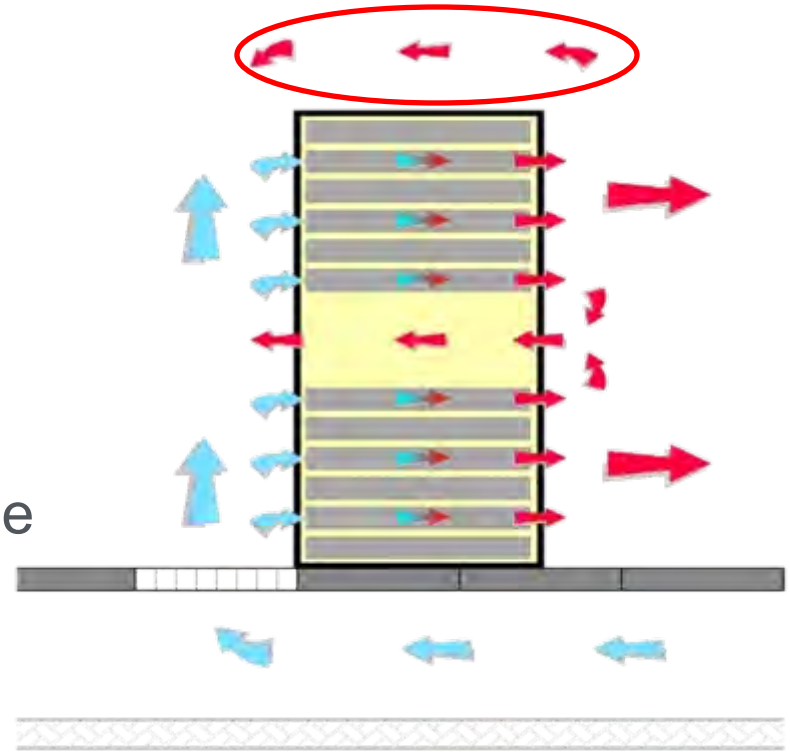

Increases inlet temperature to servers.

Maintain Raised-Floor Seals

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Maintain sealing of all potential leaks in the raised floor plenum.

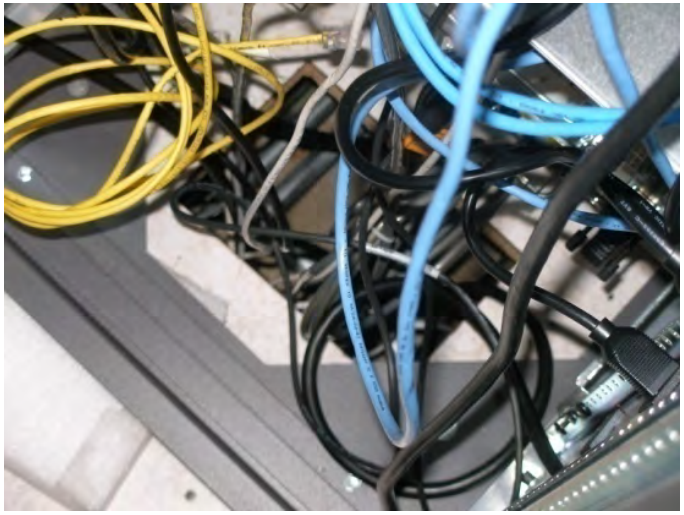

Unsealed cable penetration

Sealed cable penetration

Manage Blanking Panels

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Any opening will degrade the separation of hot and cold air

- maintain server blanking and side panels.

One 12” blanking panel added
Temperature dropped ~20°

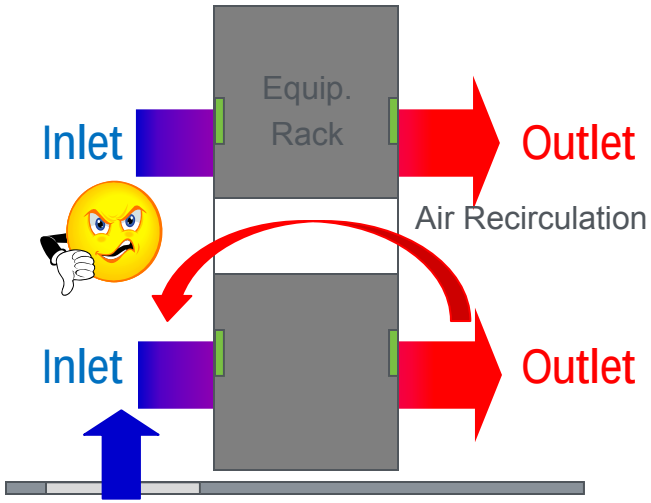

top of rack

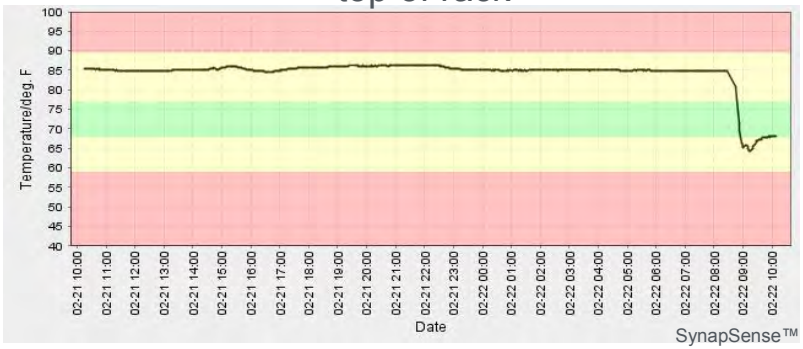

middle of rack

Reduce Airflow Restrictions & Congestion

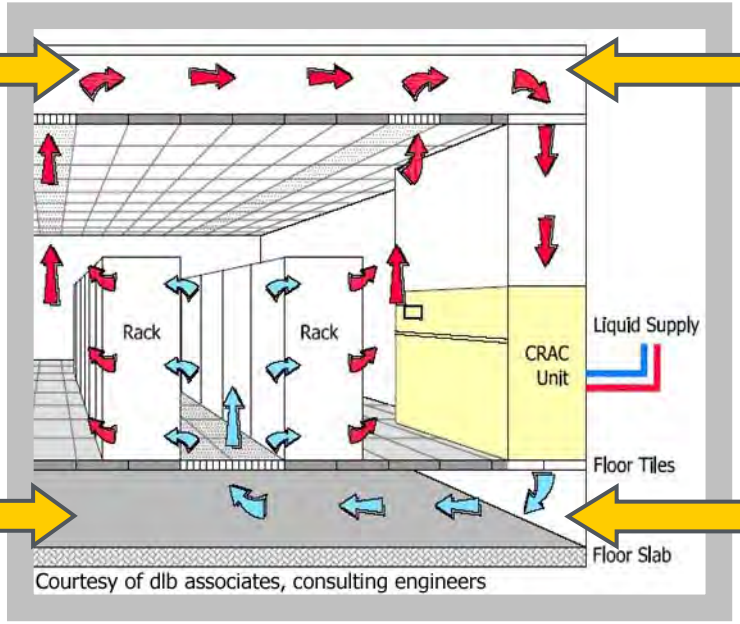

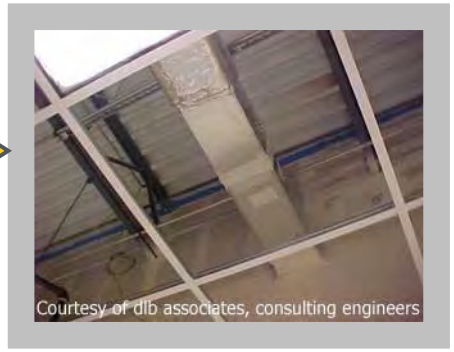

Consider The Impact That Congestion Has On The Airflow Patterns

Congested Floor & Ceiling Cavities

Empty Floor & Ceiling Cavities

Resolve Airflow Balancing

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- BALANCING is required to optimize airflow.
- Rebalancing needed with new IT or HVAC equipment
- Locate perforated floor tiles *only* in cold aisles

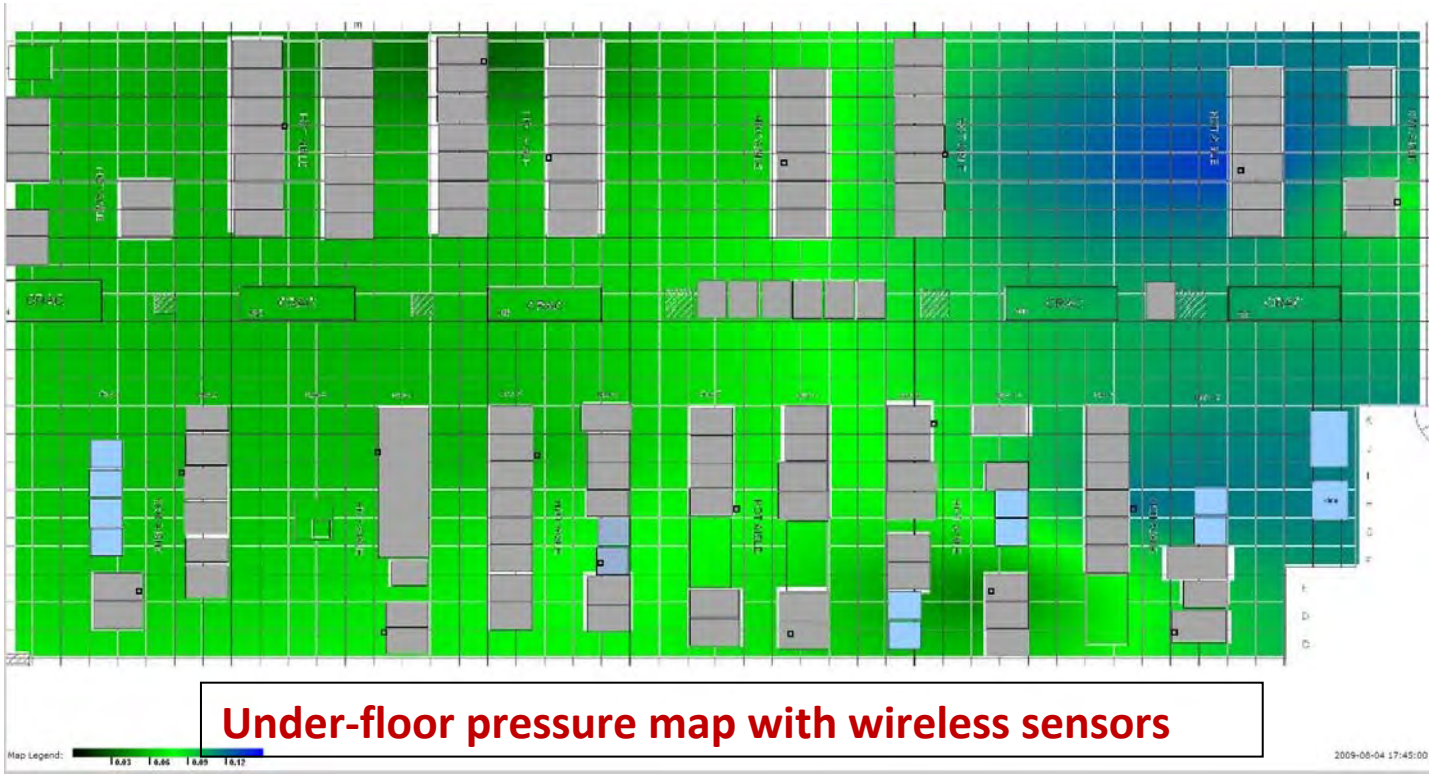

Under-floor pressure map with wireless sensors

Results: Tune Floor Tiles

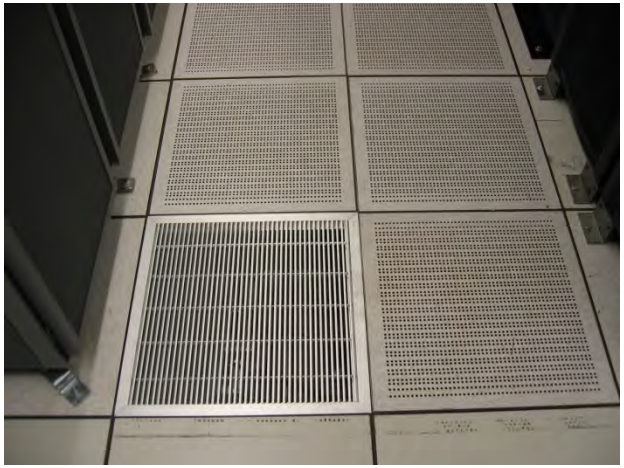

- Too many permeable floor tiles
- if airflow is optimized
  - under-floor pressure up □
  - rack-top temperatures down □
  - data center capacity increases
- Measurement and visualization assisted tuning process

under-floor pressures

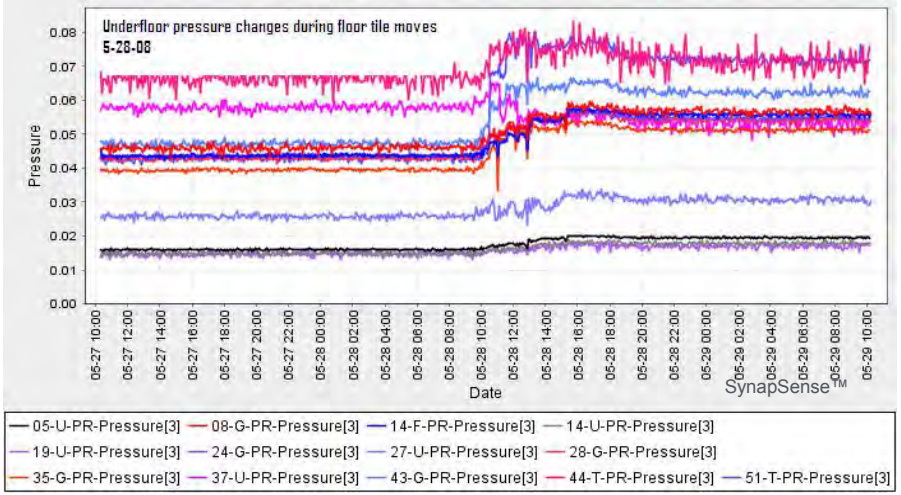

rack-top temperatures

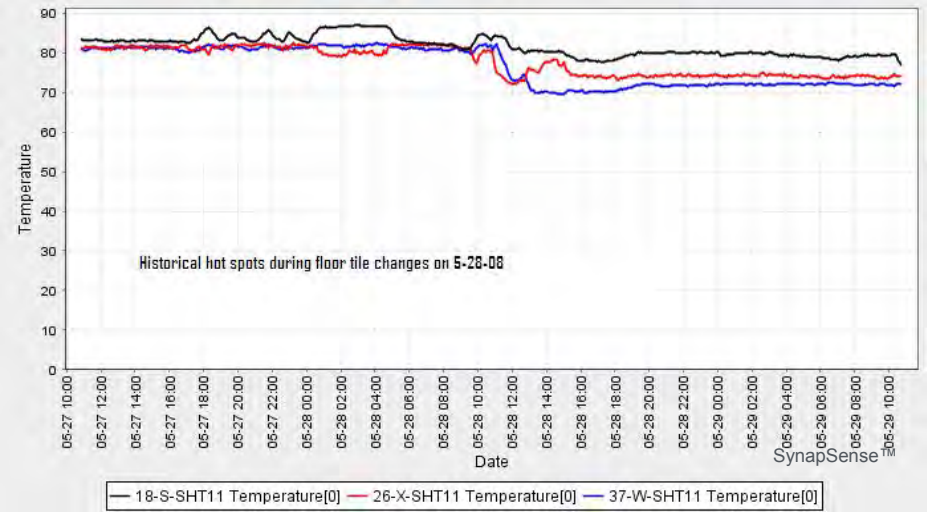

Optimally Locate CRAC/CRAHs

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Locate CRAC/CRAH units at ends of Hot Aisles

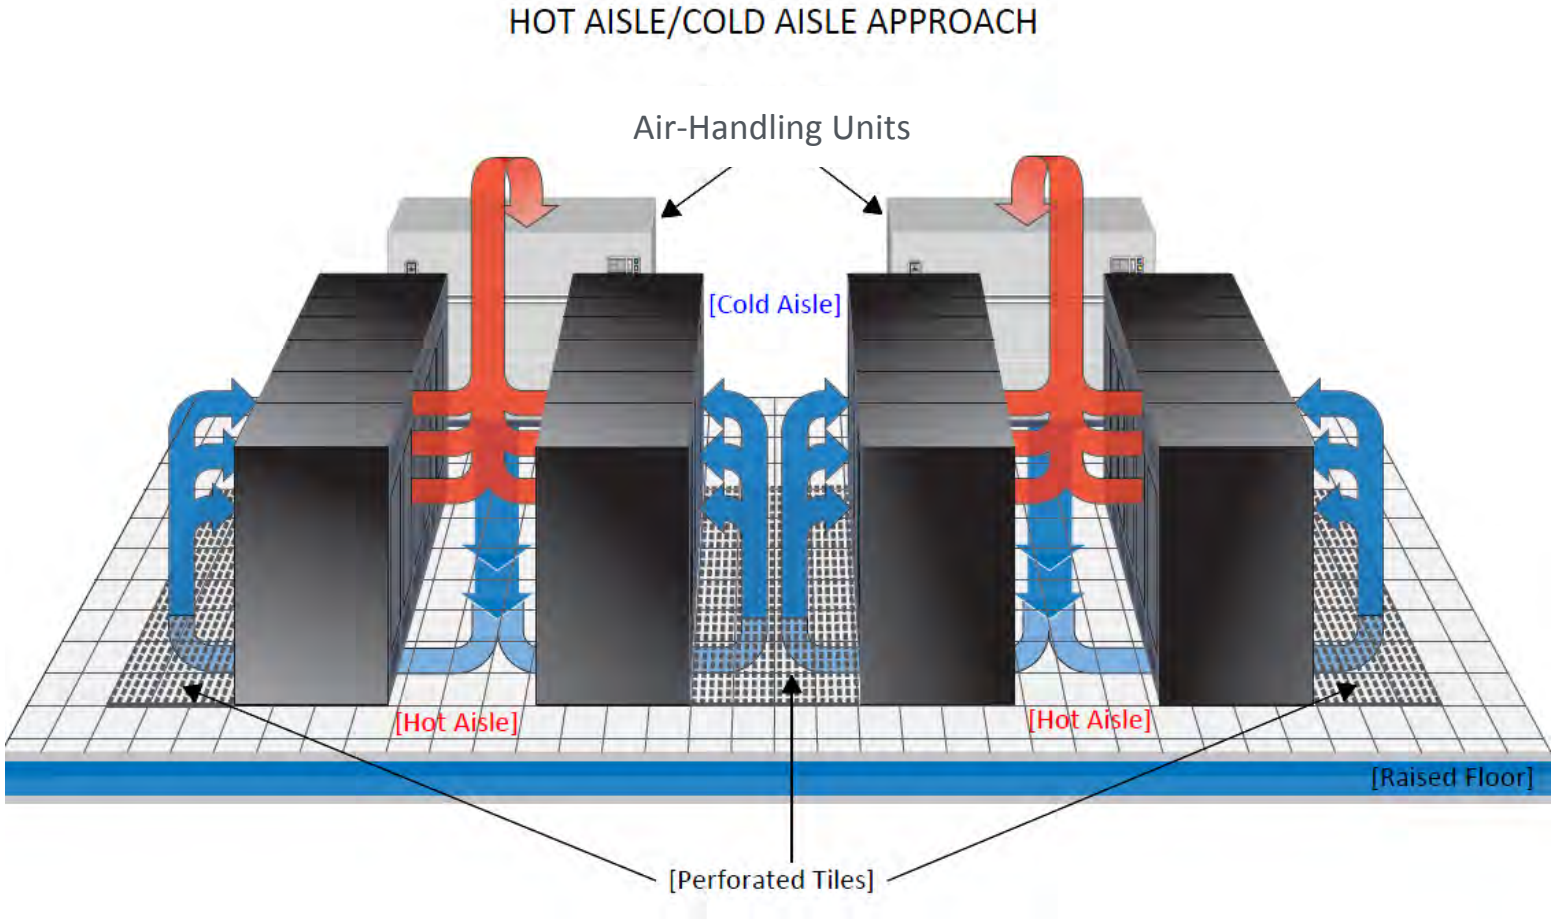

Typical Temperature Profile with Under-floor Supply

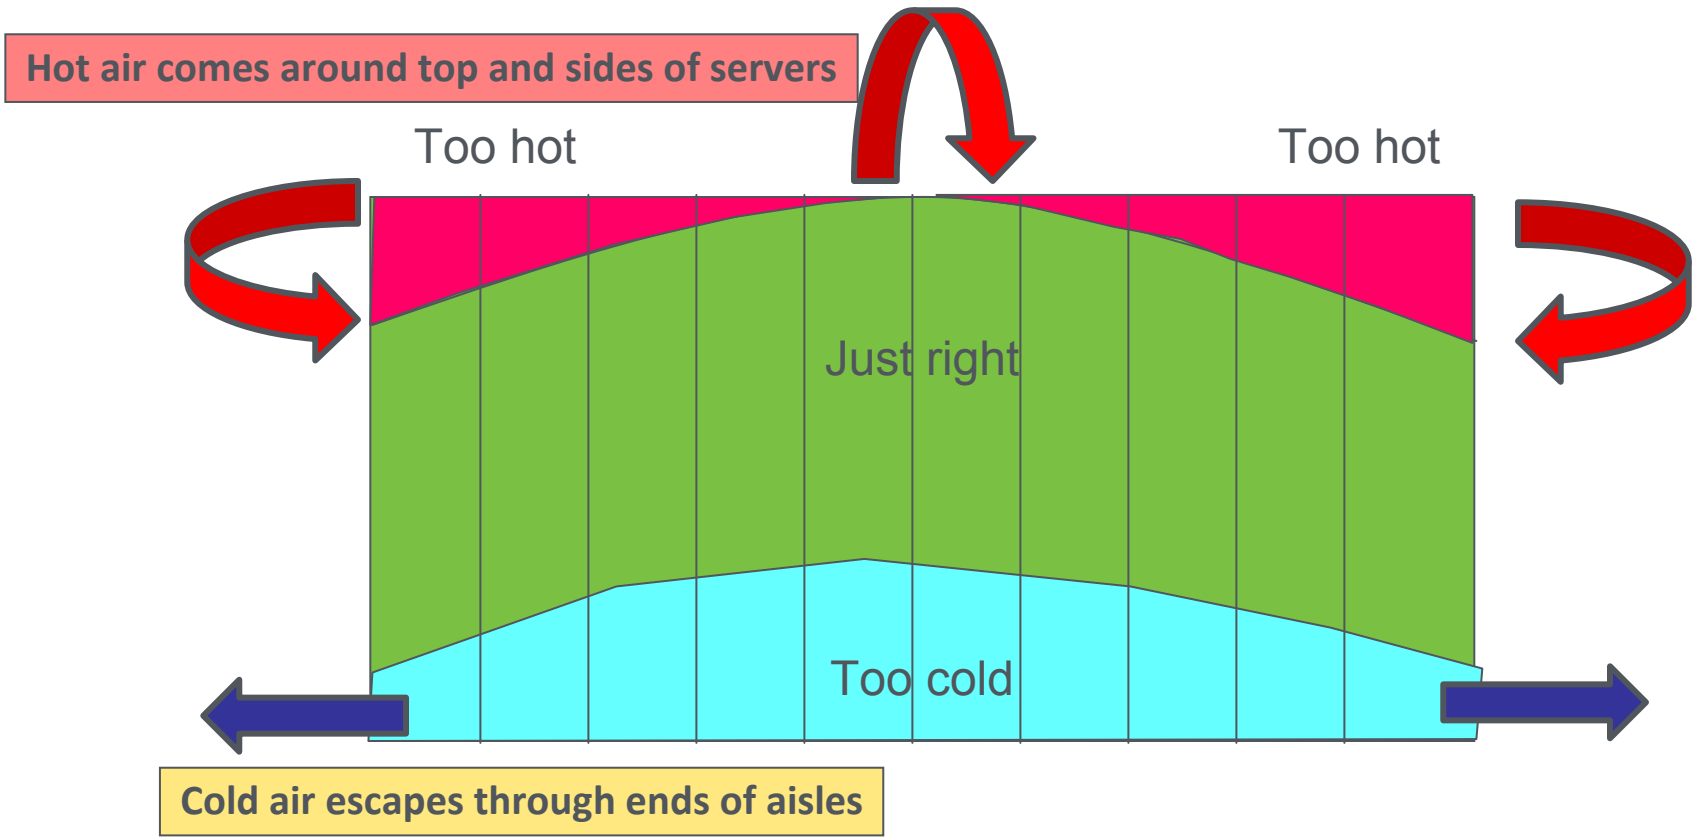

Elevation at a cold aisle looking at racks

There are numerous references in ASHRAE. See for example V. Sorell et al; "Comparison of Overhead and Underfloor Air Delivery Systems in a Data Center Environment Using CFD Modeling"; ASHRAE Symposium Paper DE-05-11-5; 2005

Next step: Air Distribution Return-Air Plenum

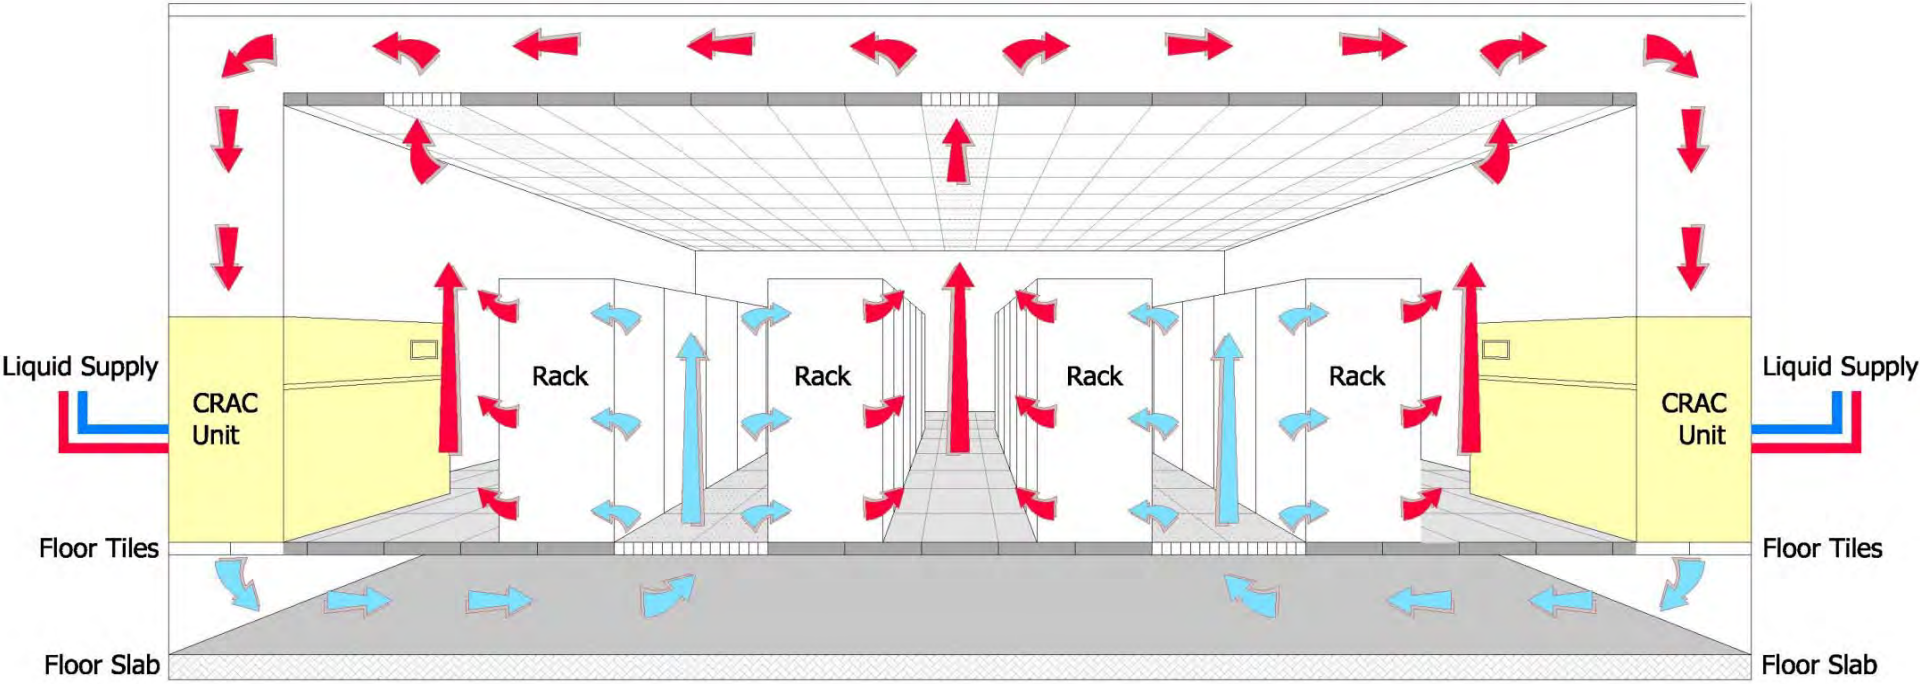

Return Air Plenum

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Overhead plenum converted to hot-air return
- Return registers placed over hot aisle
- CRAC intakes extended to overhead

Before

After

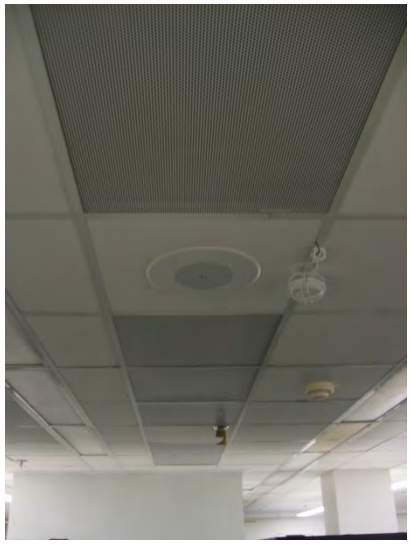

Return-Air Plenum Connections

Return air duct on top of CRAC unit connects to the return air plenum.

Isolate Hot Return

Duct on top of each rack connects to the return air plenum.

Other Isolation Options

- ✓ Physical barriers enhance separate hot and cold airflow.
- ✓ Barriers placement must comply with fire codes.
- ✓ Curtains, doors, or lids have been used successfully.

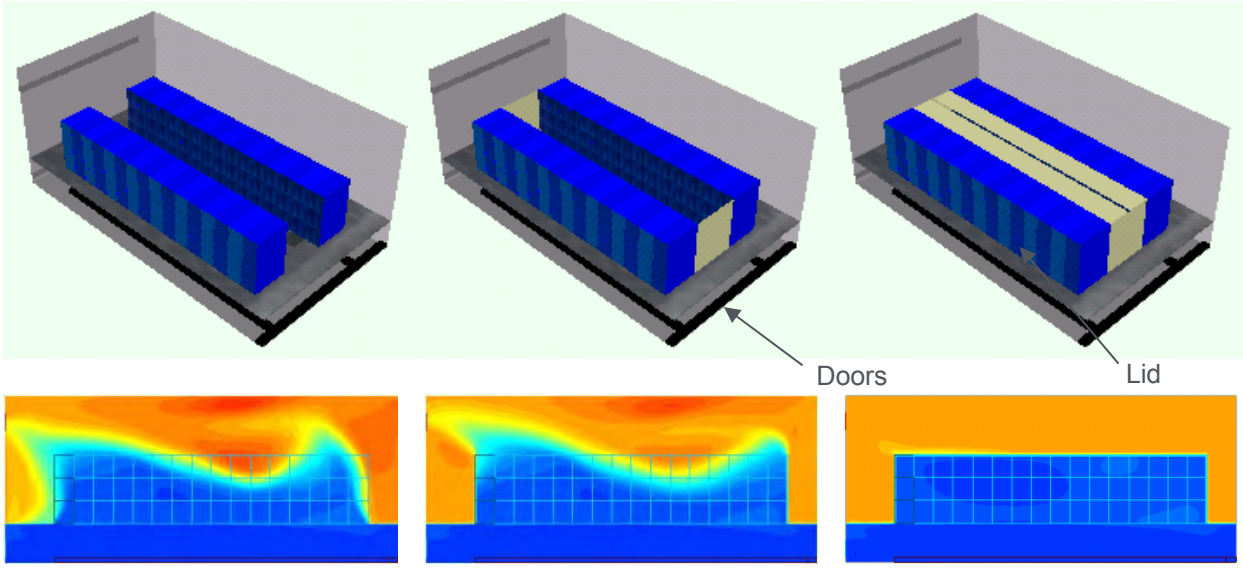

Open | **Semi-enclosed cold aisle** | **Enclosed cold aisle**

Adding Air Curtains for Hot/Cold Isolation

Isolate Cold and Hot Aisles

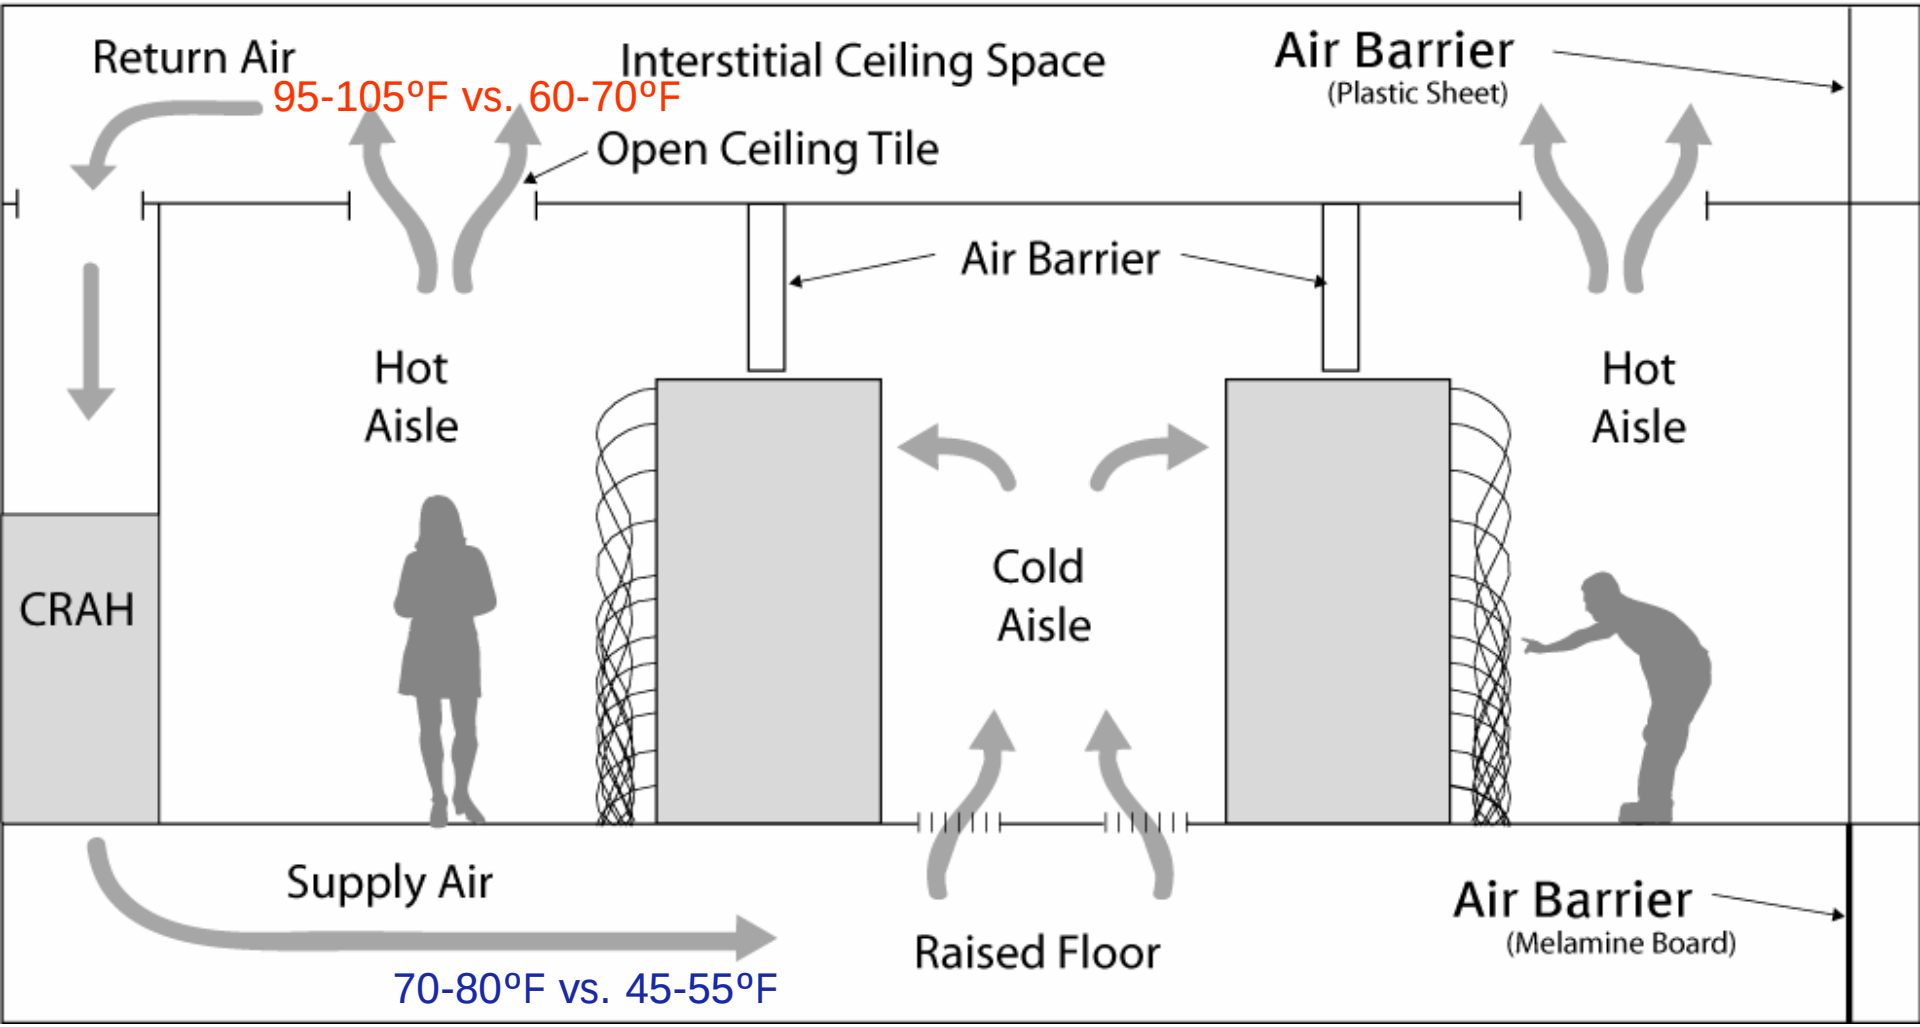

Cold Aisle Airflow Containment Example

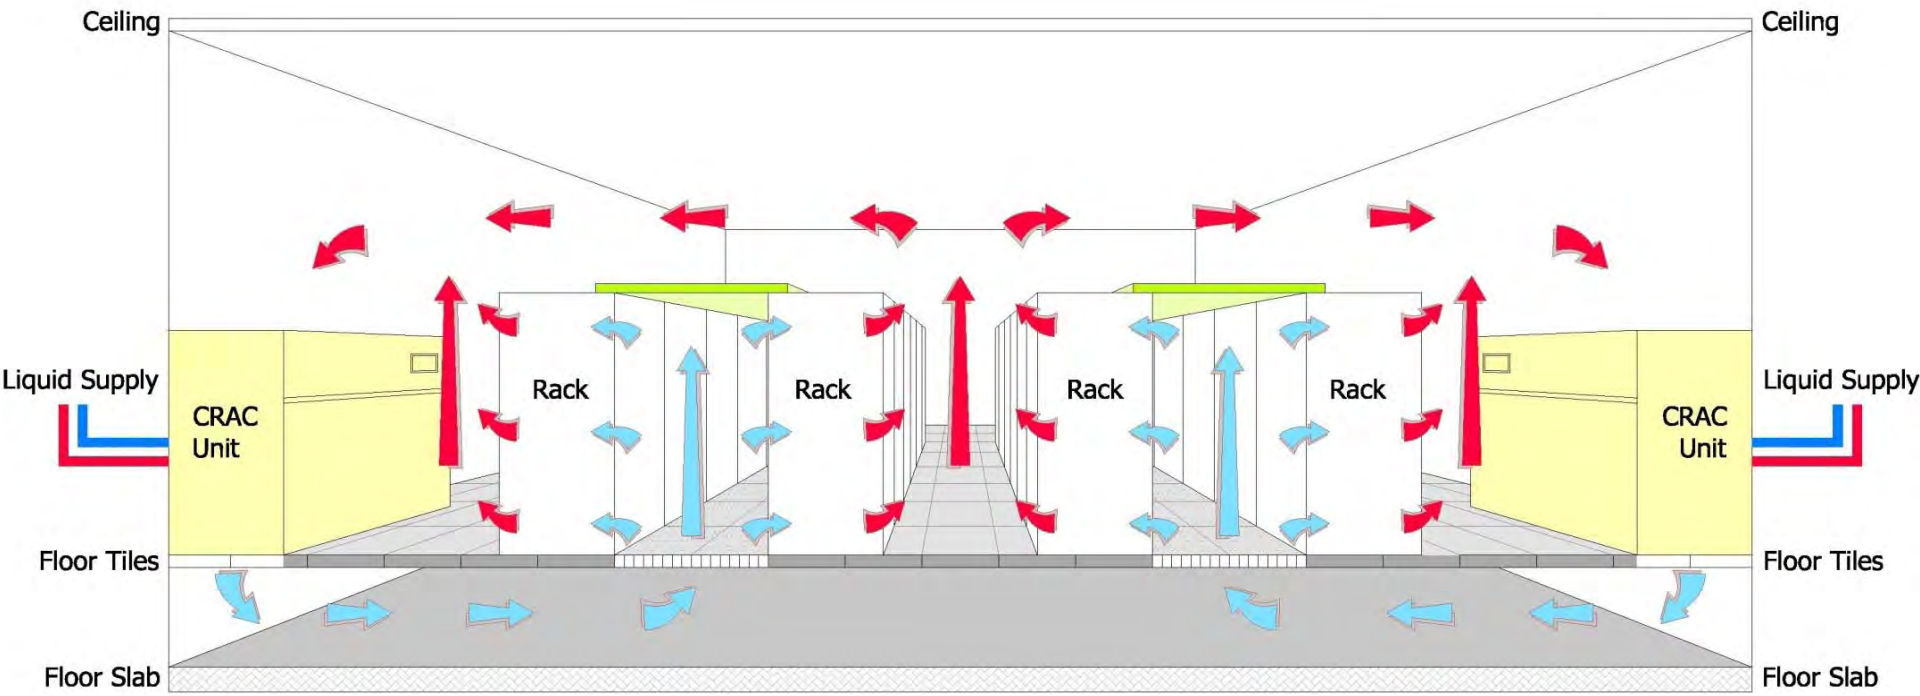

LBNL Cold Aisle Containment study achieved fan energy savings of ~ 75%

Fan Energy Savings

- Isolation can significantly reduce air mixing and hence flow
- Fan speed can be reduced and fan power is proportional to the cube of the flow.
- Fan energy savings of 70-80% is possible with variable air volume (VAV) fans in CRAH/CRAC units (or central AHUs)

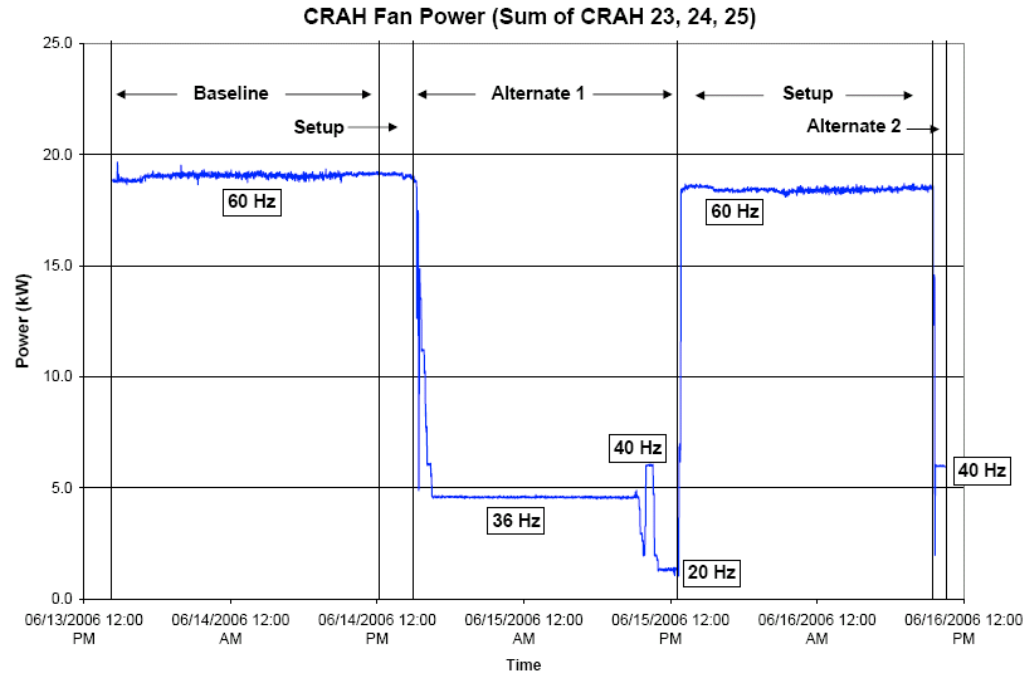

Without Enclosure With Enclosure Without Enclosure

LBNL Air Management Demonstration

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Better airflow management permits warmer supply temperatures!

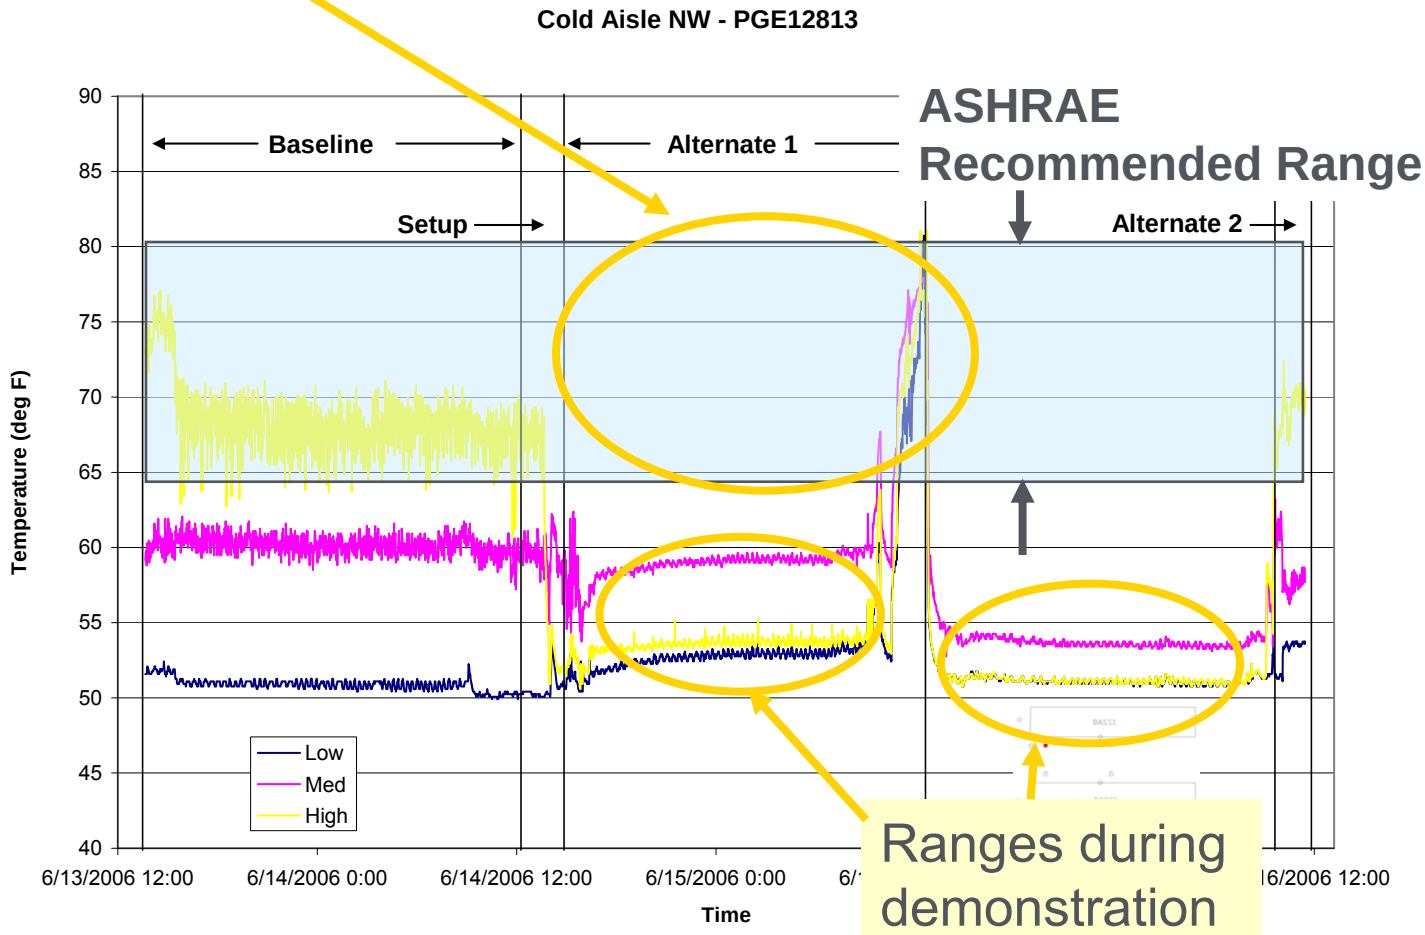

Isolating Hot and Cold Aisles

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Energy intensive IT equipment needs good isolation of "cold" inlet and "hot" discharge.
- Supply airflow can be reduced if no mixing occurs.
- Overall temperature can be raised if air is delivered without mixing.
- Cooling systems and economizers use less energy with warmer return air temperatures.
- Cooling capacity increases with warmer air temperatures.

Efficient Alternatives to Under-floor Air Distribution

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Localized air cooling systems with hot and cold isolation can supplement or replace under-floor systems (raised floor not required!)

Examples include:

- **Row-based cooling units**
- **Rack-mounted heat exchangers**
- **Both options "Pre-engineer" hot and cold isolation**

Example – Local Row-Based Cooling Units

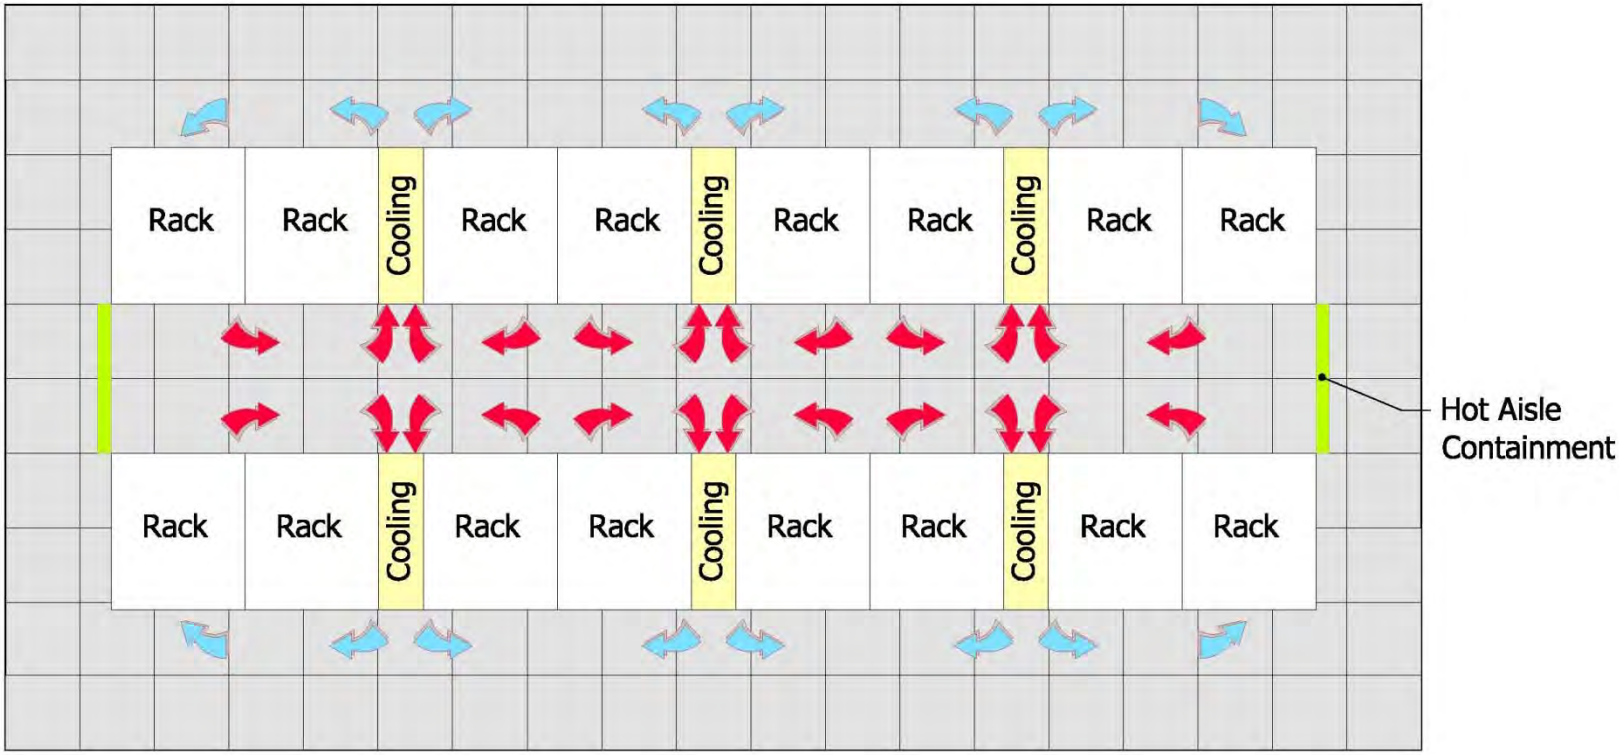

Air Distribution – Rack-Mounted Heat Exchangers

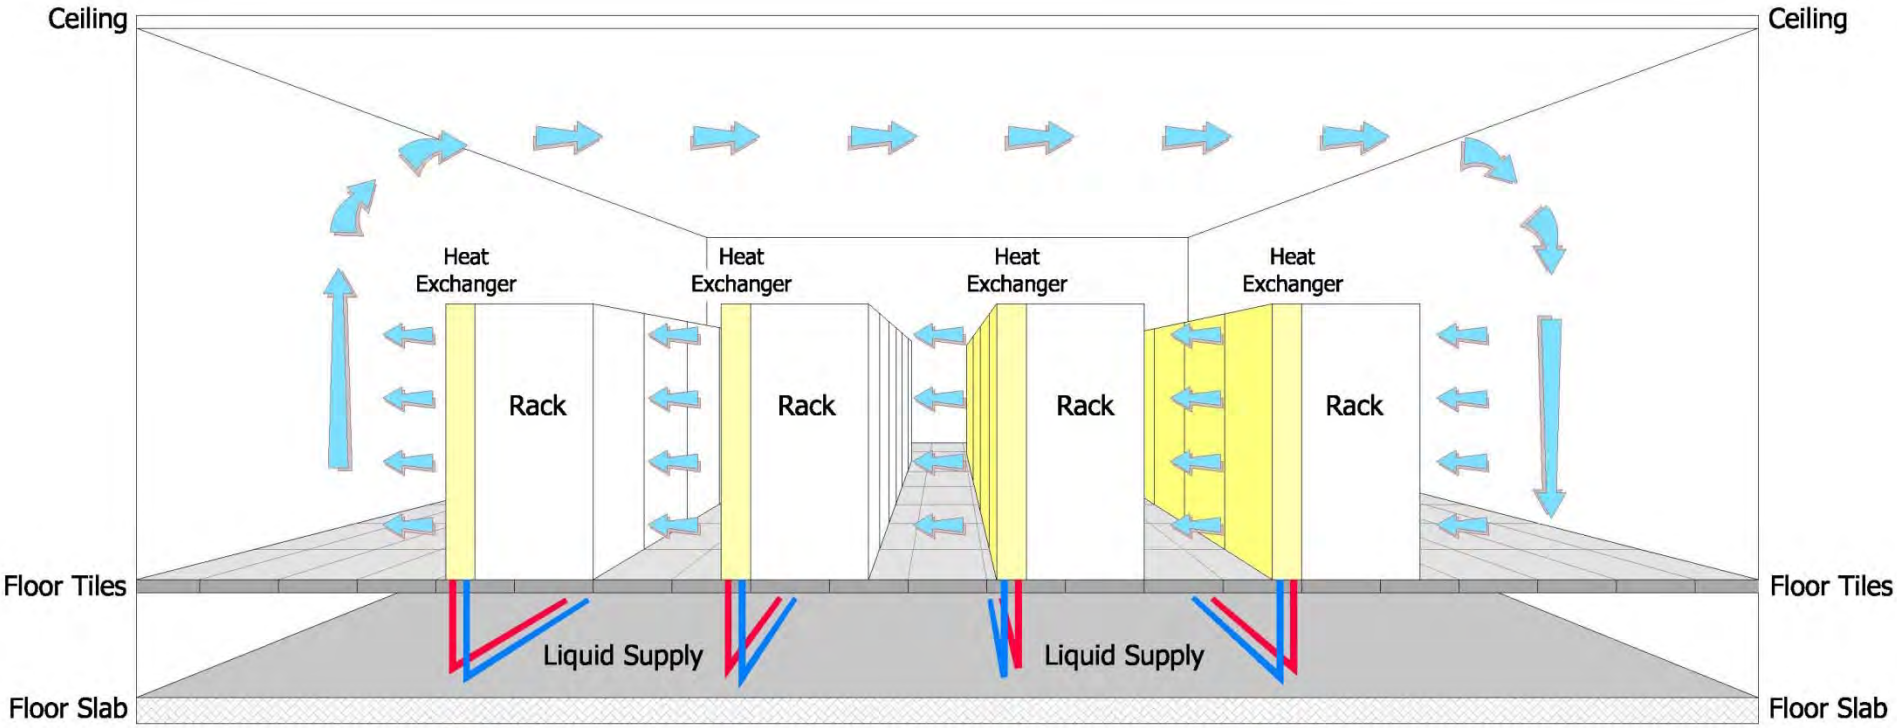

Review: Airflow Management Basics

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Air management techniques:

- Seal air leaks in floor (e.g. cable penetrations)
- Prevent recirculation with blanking panels in racks
- Manage floor tiles (e.g. no perforated tiles in hot aisle)
- Improve isolation of hot and cold air (e.g. return air plenum, curtains, or complete isolation)

Impact of good isolation:

- Supply airflow reduced
  - Fan savings up to 75%+
- Overall temperature can be raised
  - Cooling systems efficiency improves
  - Greater opportunity for economizer (“free” cooling)
- Cooling capacity increases

Questions?

Cooling systems

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Linking good air management and an optimized cooling system:

- ✓ Improved efficiencies
- ✓ Increased cooling capacity
- ✓ More hours for air-side and water-side free cooling
- ✓ Lower humidification/dehumidification energy
- ✓ Reduced fan energy

HVAC Systems Overview

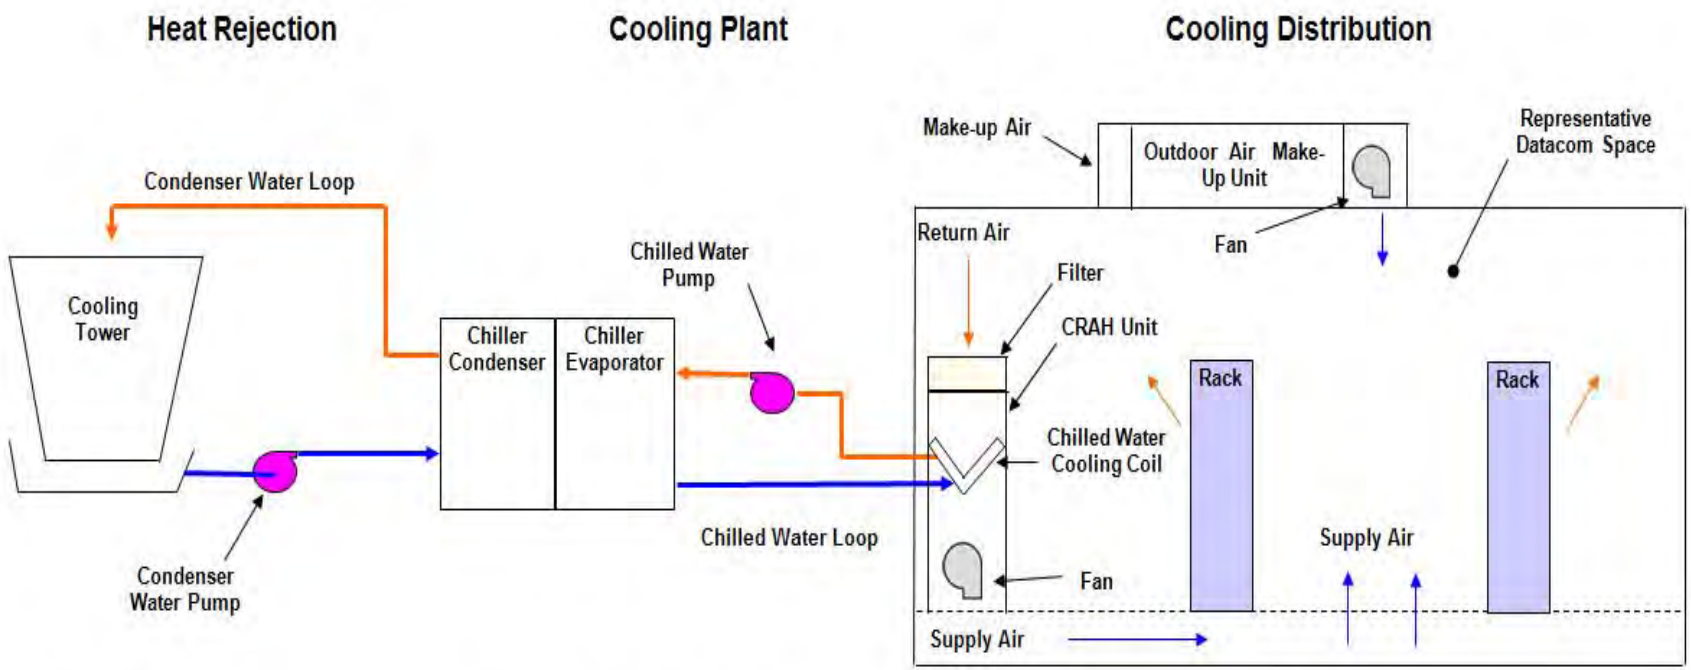

Heat Rejection Alternatives:

High Eff

- Water Cooled Direct (shown)
- Water Cooled Indirect (with HX)
- Evaporatively Cooled
- Air Cooled
- Dry Cooler (Air Cooled with Glycol)

Low Eff

Cooling Plant Alternatives:

- Water-Side Economizer (HX)
- Chiller (shown)
- Direct Expansion (DX)

Terminal Unit Alternatives

- Liquid Cooling
- Central AHU
- CRAH Unit (shown)
- CRAC Unit (DX)

Distribution Alternatives

- On Board
- In Rack
- In Row
- Overhead Air
- Underfloor Air (Shown)

High Eff

Low Eff

Computer Room Air Conditioners (CRACs) and Air Handlers (CRAHs)

- **CRAC units**
  - Fan, direct expansion (DX) coil, and refrigerant compressor.
- **CRAH units**
  - Fan and chilled water coil
  - Typically in larger facilities with a chiller plant
- **Both often equipped with humidifiers and reheat for dehumidification**
- **Often independently controlled**
  - Tight ranges and poor calibration lead to fighting

DX (or AC) units reject heat outside…

Dry-Cooler DX

Air-Cooled DX

Glycol

Refrigerant

Evaporatively-Cooled DX

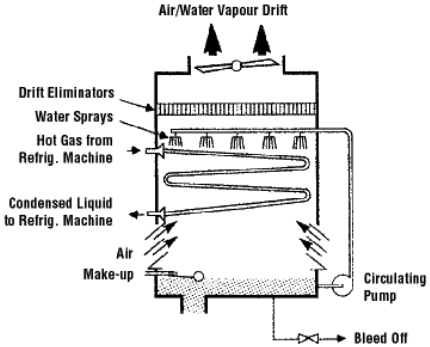

Refrigerant

Water-Cooled DX

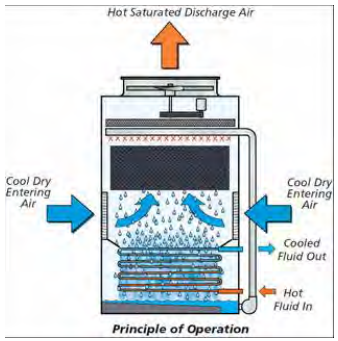

Water

Computer Room Air Handling (CRAH) units using Chilled-Water

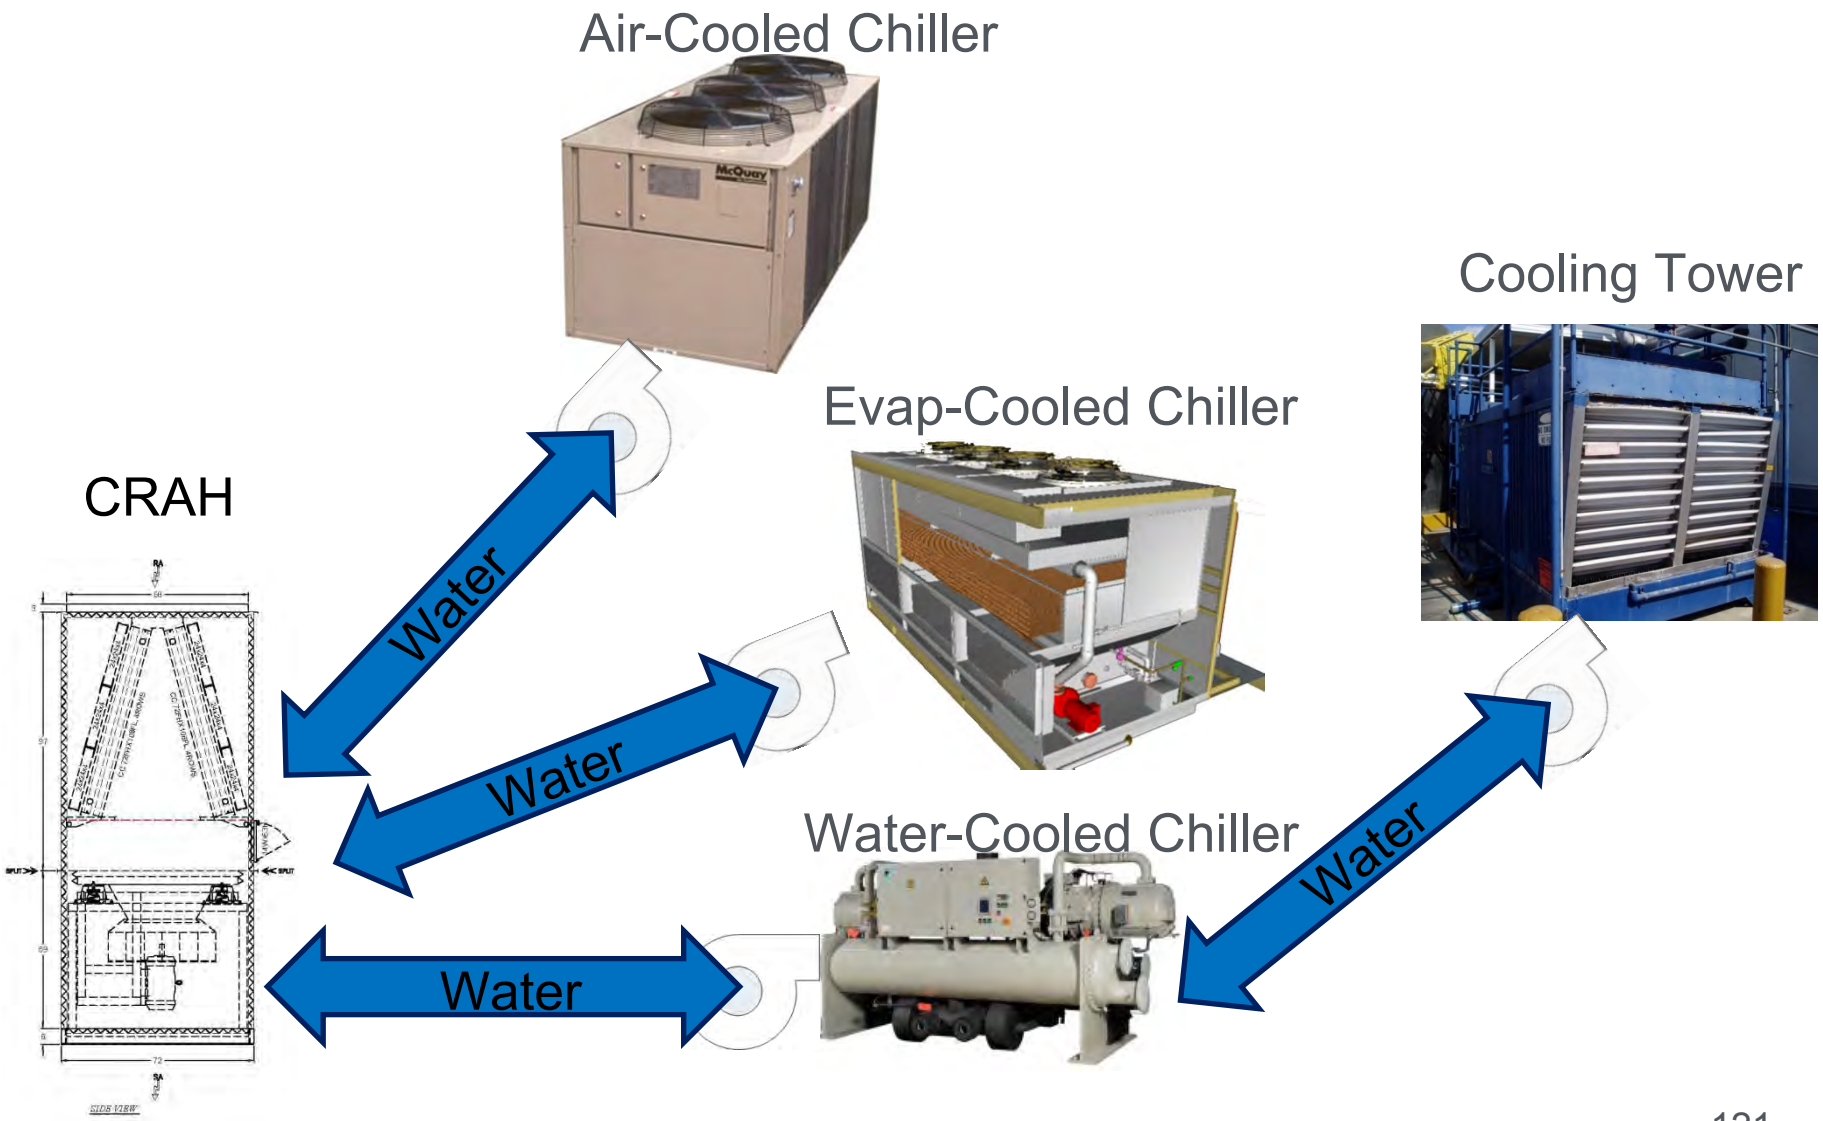

Optimize the Chiller Plant

- Have a plant (vs. distributed cooling)
- Use “warm” water cooling (multi-loop)
- Size cooling towers for “free” cooling
- Integrate controls and monitor efficiency of all primary components
- Thermal storage
- Utilize variable speed drives on:
  - Fans
  - Pumps
  - Towers
  - Chillers

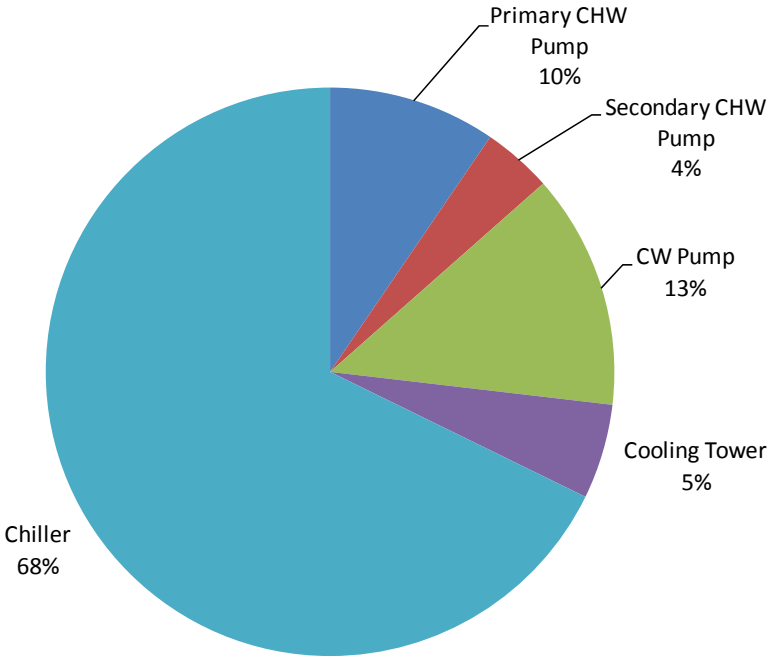

Select Efficient Chillers

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Chiller	Compressor kW / ton			
	25%	50%	75%	100%
400 Ton Air Cooled	0.69	0.77	0.96	1.25
1200 Ton Water Cooled w/o VFD	0.51	0.41	0.45	0.55
1200 Ton Water Cooled with a VFD	0.34	0.30	0.43	0.57

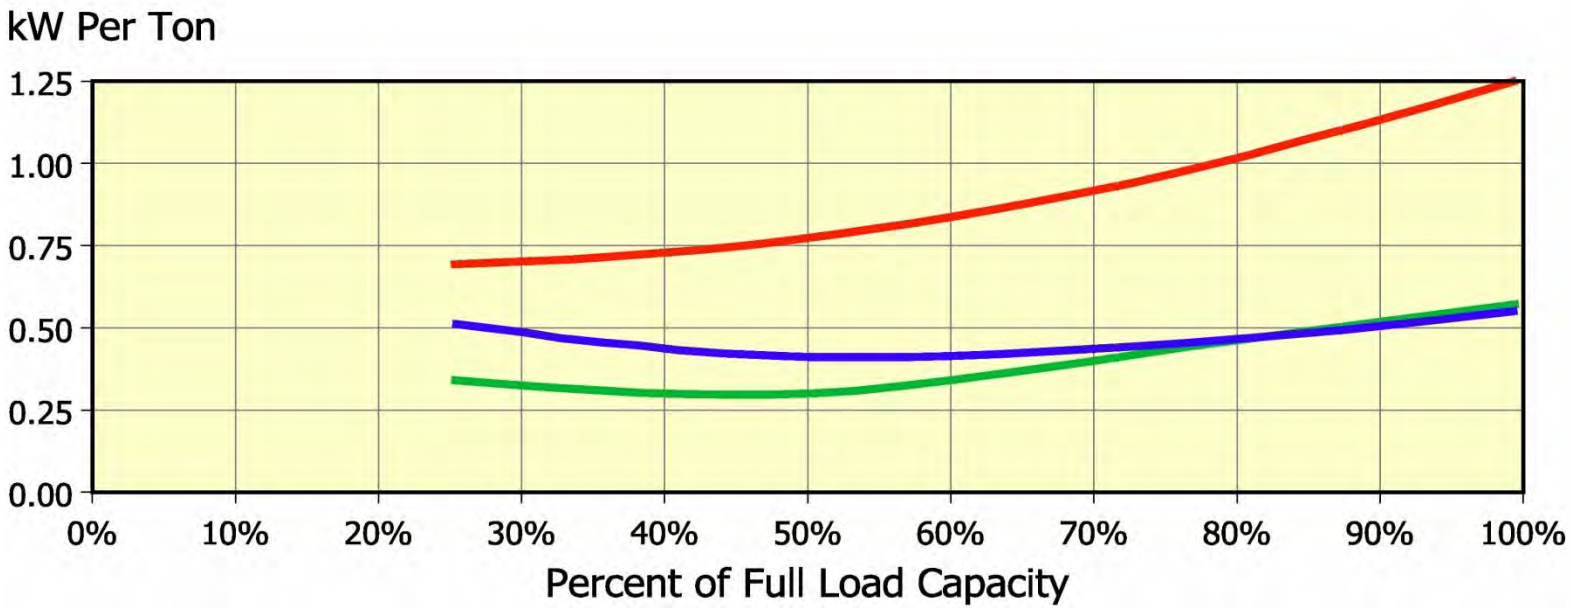

Increase Temperature of Chiller Plant

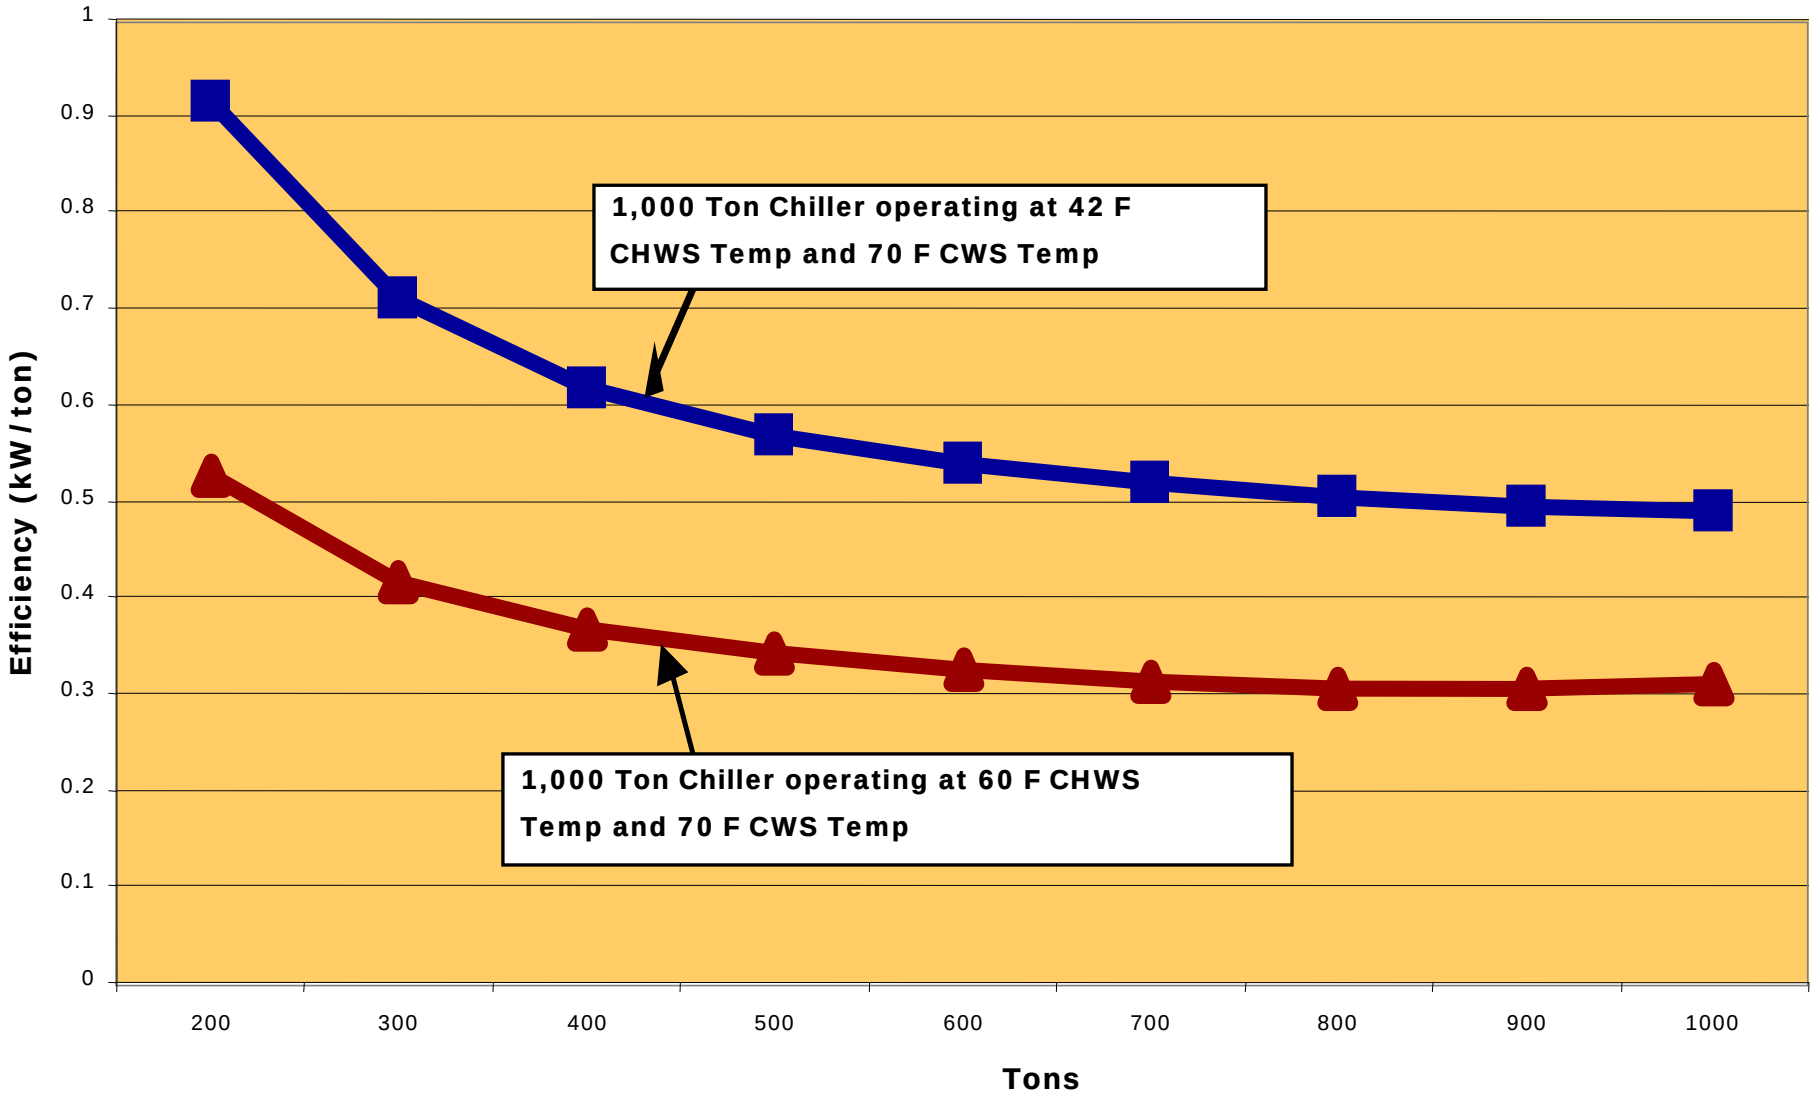

Data provided by York International Corporation.

Moving (Back) to Liquid Cooling

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

As heat densities rise, liquid solutions become more attractive:

Volumetric heat capacity comparison

Water

=

Air

Why Liquid Cooling?

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Heat removal efficiency increases as liquid gets closer to the heat source
- Liquids can provide cooling with higher temperature coolant
  - Improved cooling efficiency
  - Increased economizer hours
  - Greater potential use of waste heat
- Reduced transport energy:

Heat Transfer		Resultant Energy Requirements			
Rate	ΔT	Heat Transfer Medium	Fluid Flow Rate	Conduit Size	Theoretical Horsepower
10 Tons	12°F	Forced Air 	9217 cfm	34" Ø	3.63 Hp
		Water	20 gpm	2" Ø	.25 Hp

In-Row Liquid Cooling

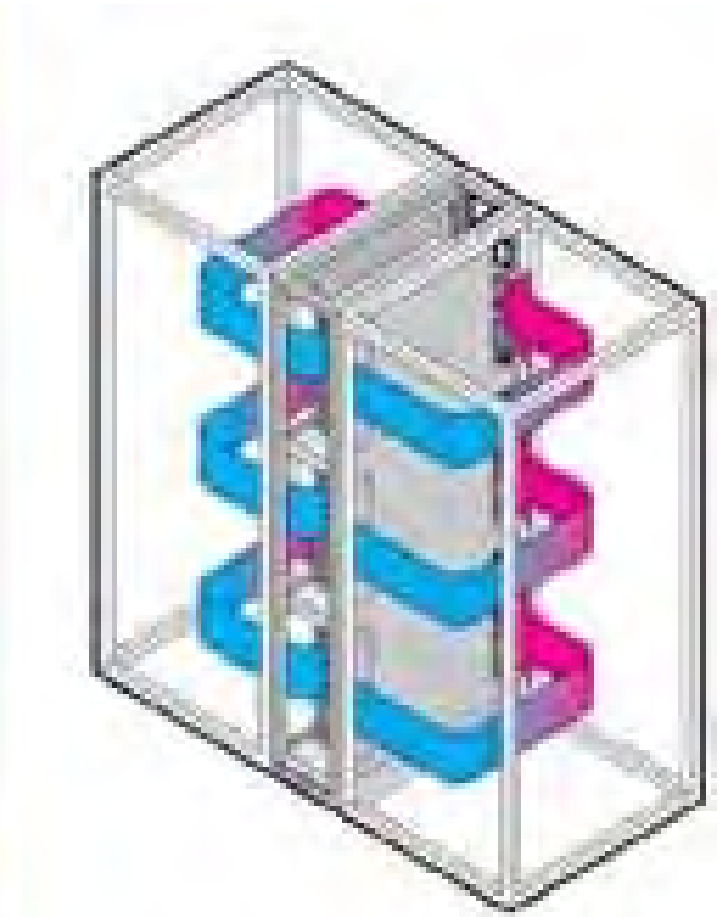

Graphics courtesy of Rittal

In Rack Liquid Cooling

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Racks with integral coils and full containment

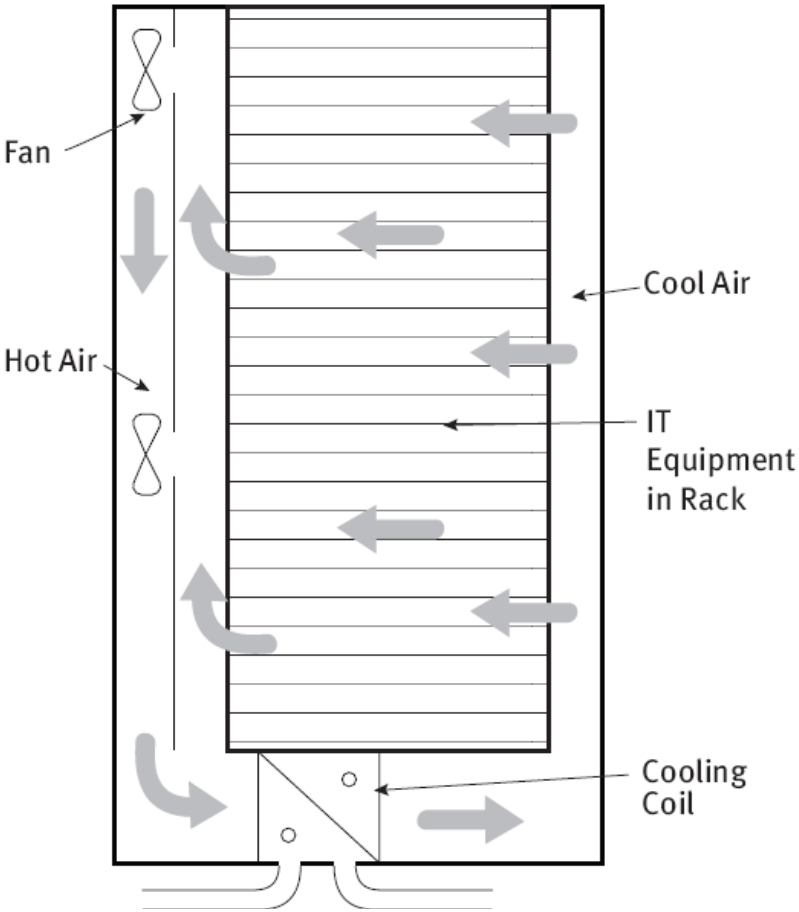

Rear-Door Liquid Cooling

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Rear Door (open)

Inside rack RDHx, open 90°

Rear Doors (closed)

Liquid Cooling Connections

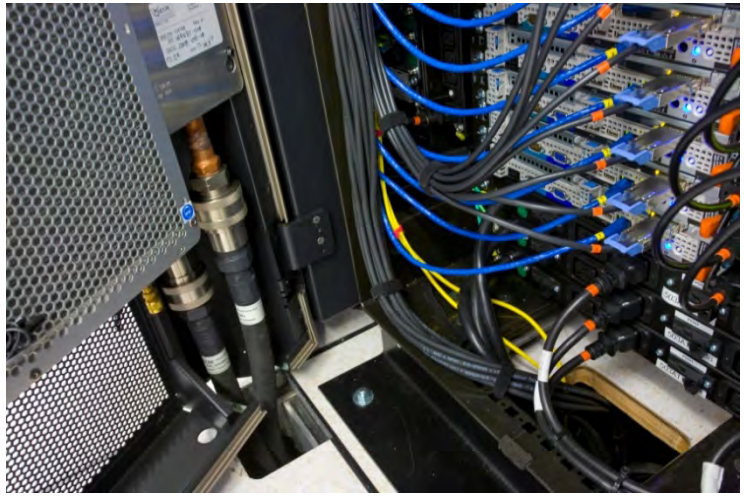

On Board Cooling

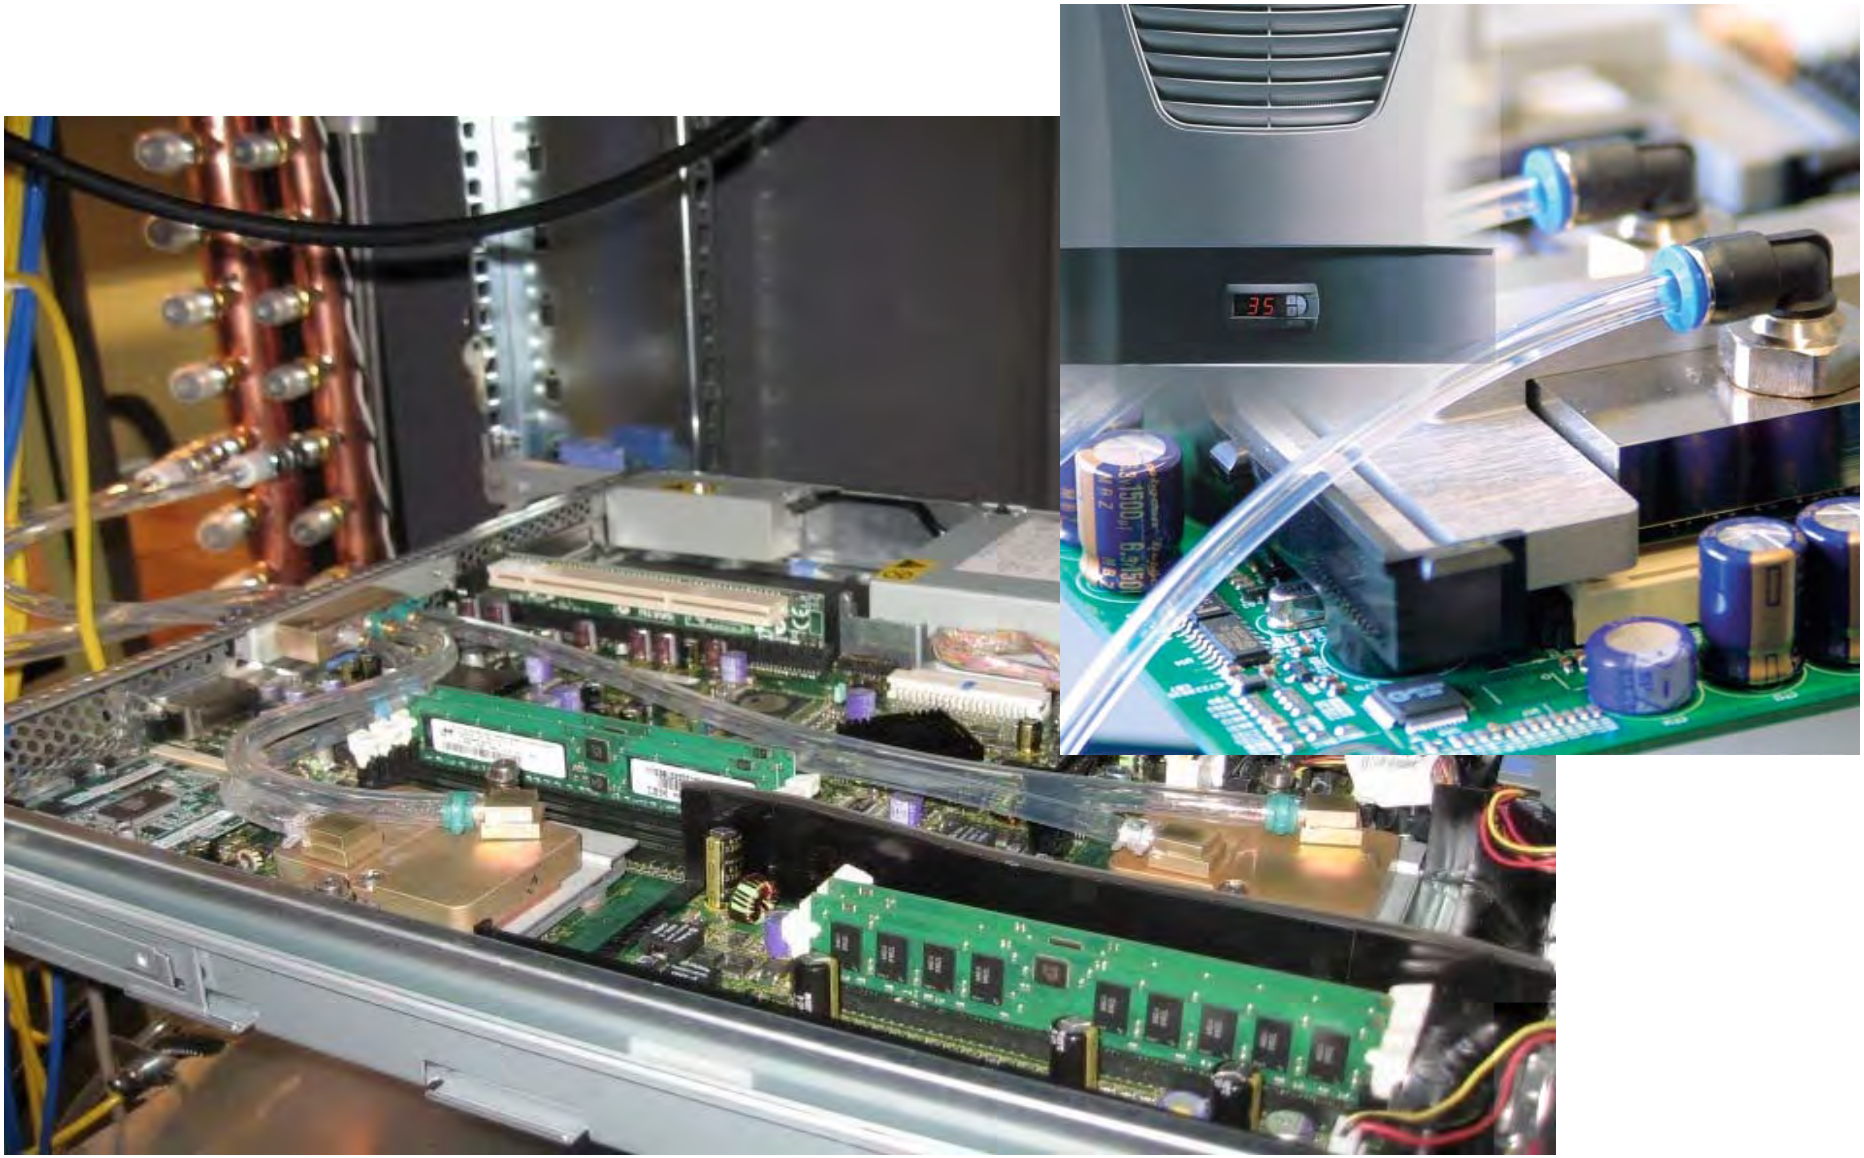

"Chill-off 2" Evaluation of Liquid Cooling Solutions

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

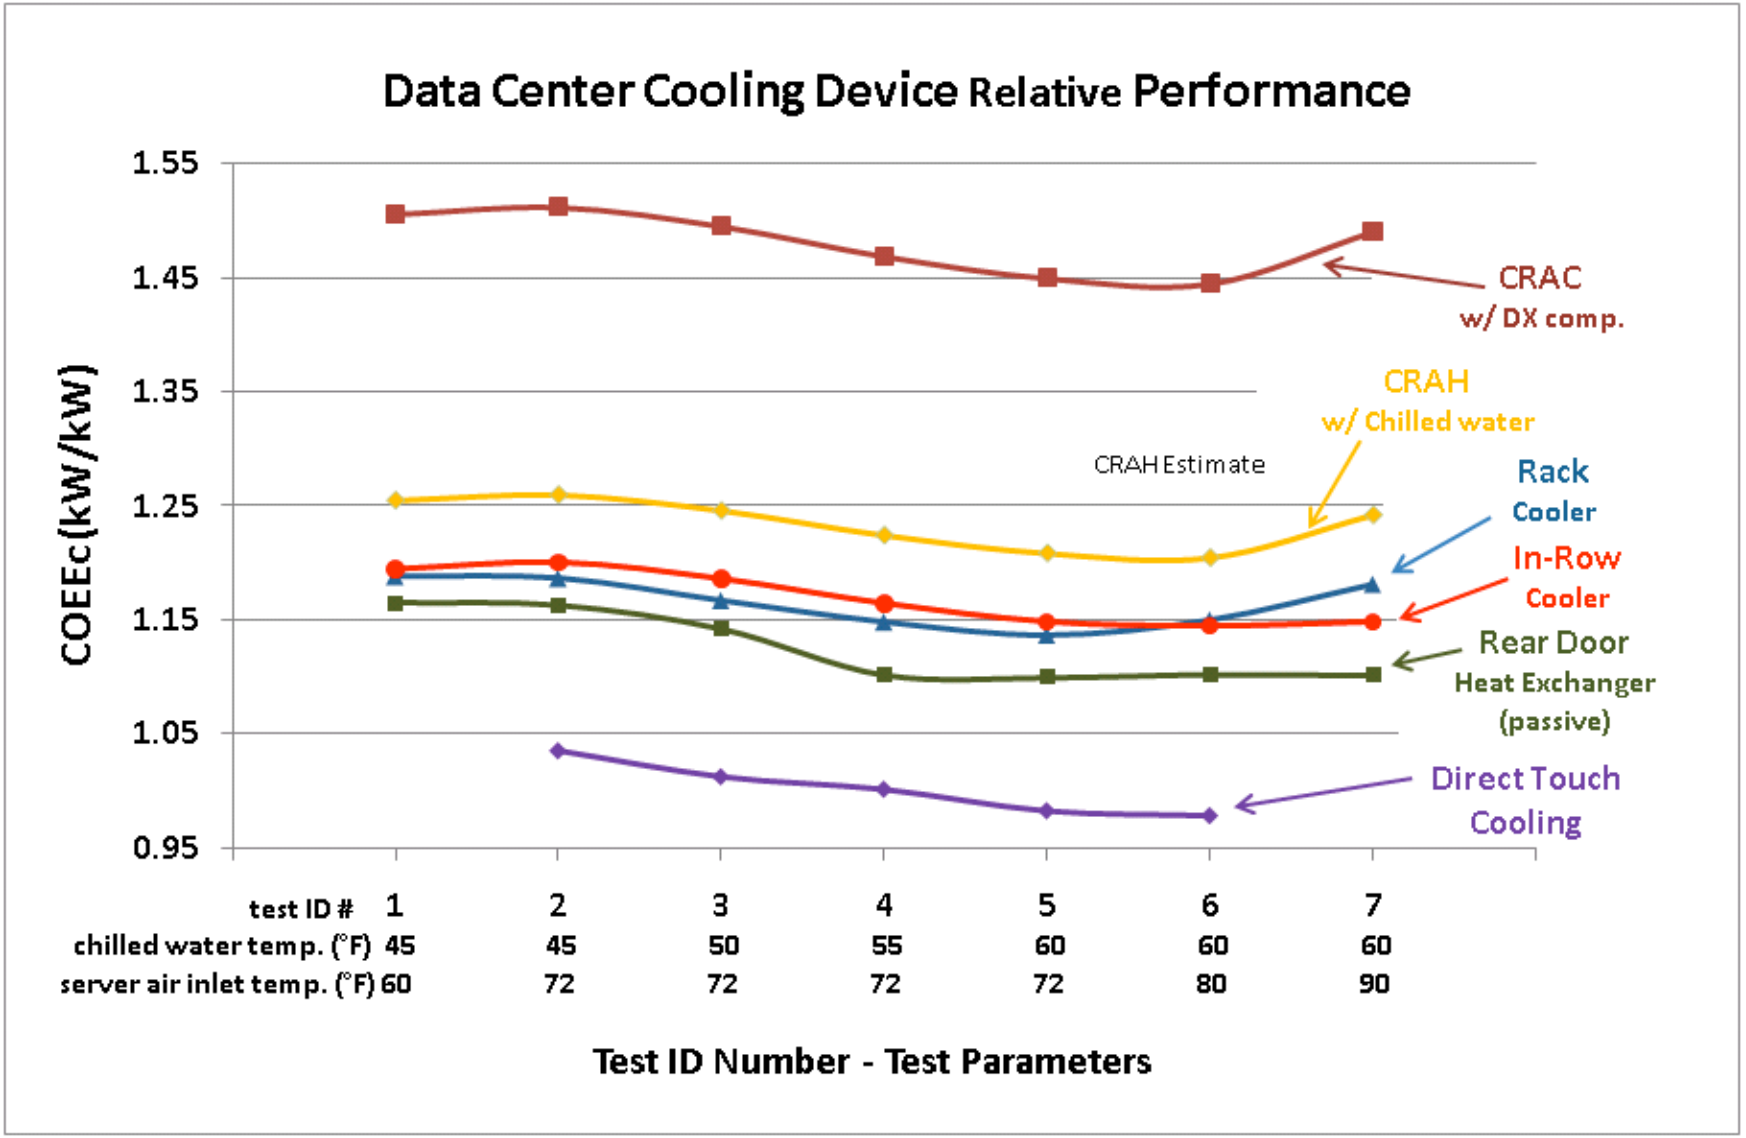

Use Free Cooling:

Cooling without Compressors:

- Outside-Air Economizers
- Water-side Economizers

➢ Let's get rid of chillers in data centers

Outside-Air Economizers

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Advantages

- Lower energy use
- Added reliability (backup for cooling system)

Potential Issues

- Space.
- Dust
  - Not a concern with Merv 13 filters
- Gaseous contaminants
  - Not widespread
  - Impacts normally cooled data centers as well
- Shutdown or bypass if smoke is outside data center.

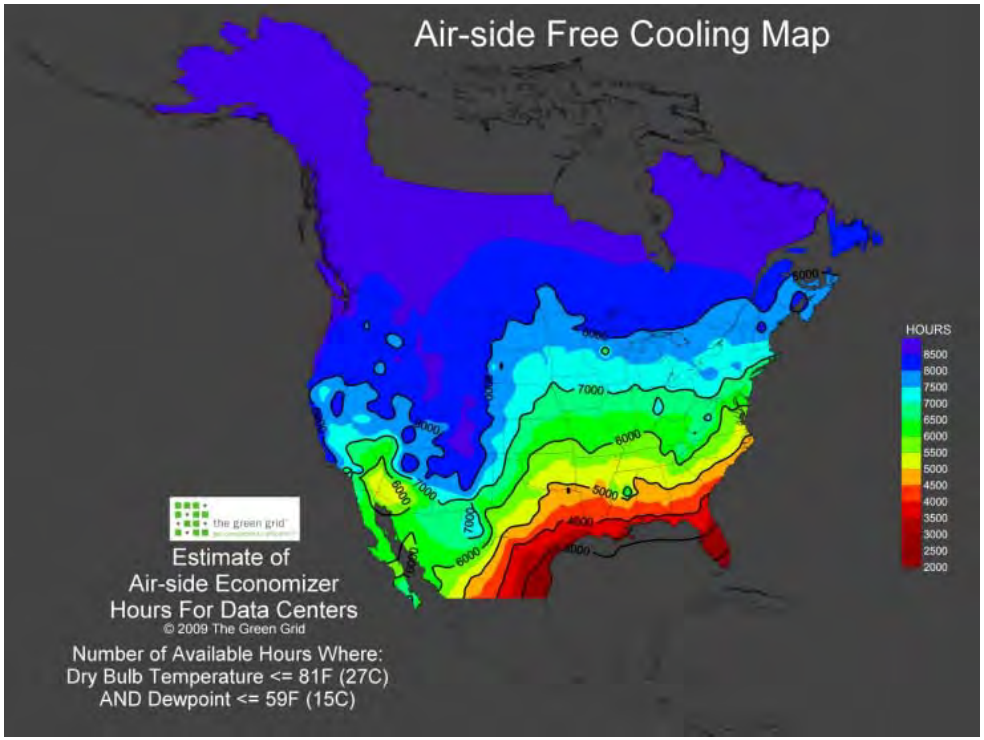

http://cooling.thegreengrid.org/namerica/WEB_APP/calc_index.html

UC's Computational Research and Theory (CRT) Facility

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Free Cooling – Outside Air Based

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

1. Blue = recommended supply
2. Green can become blue mixing return and outdoor air
3. Most of the conditions below and right of blue can be satisfied w/ evaporative cooling
4. Hot and humid hours will enter the "allowable" range or require compressor air conditioning

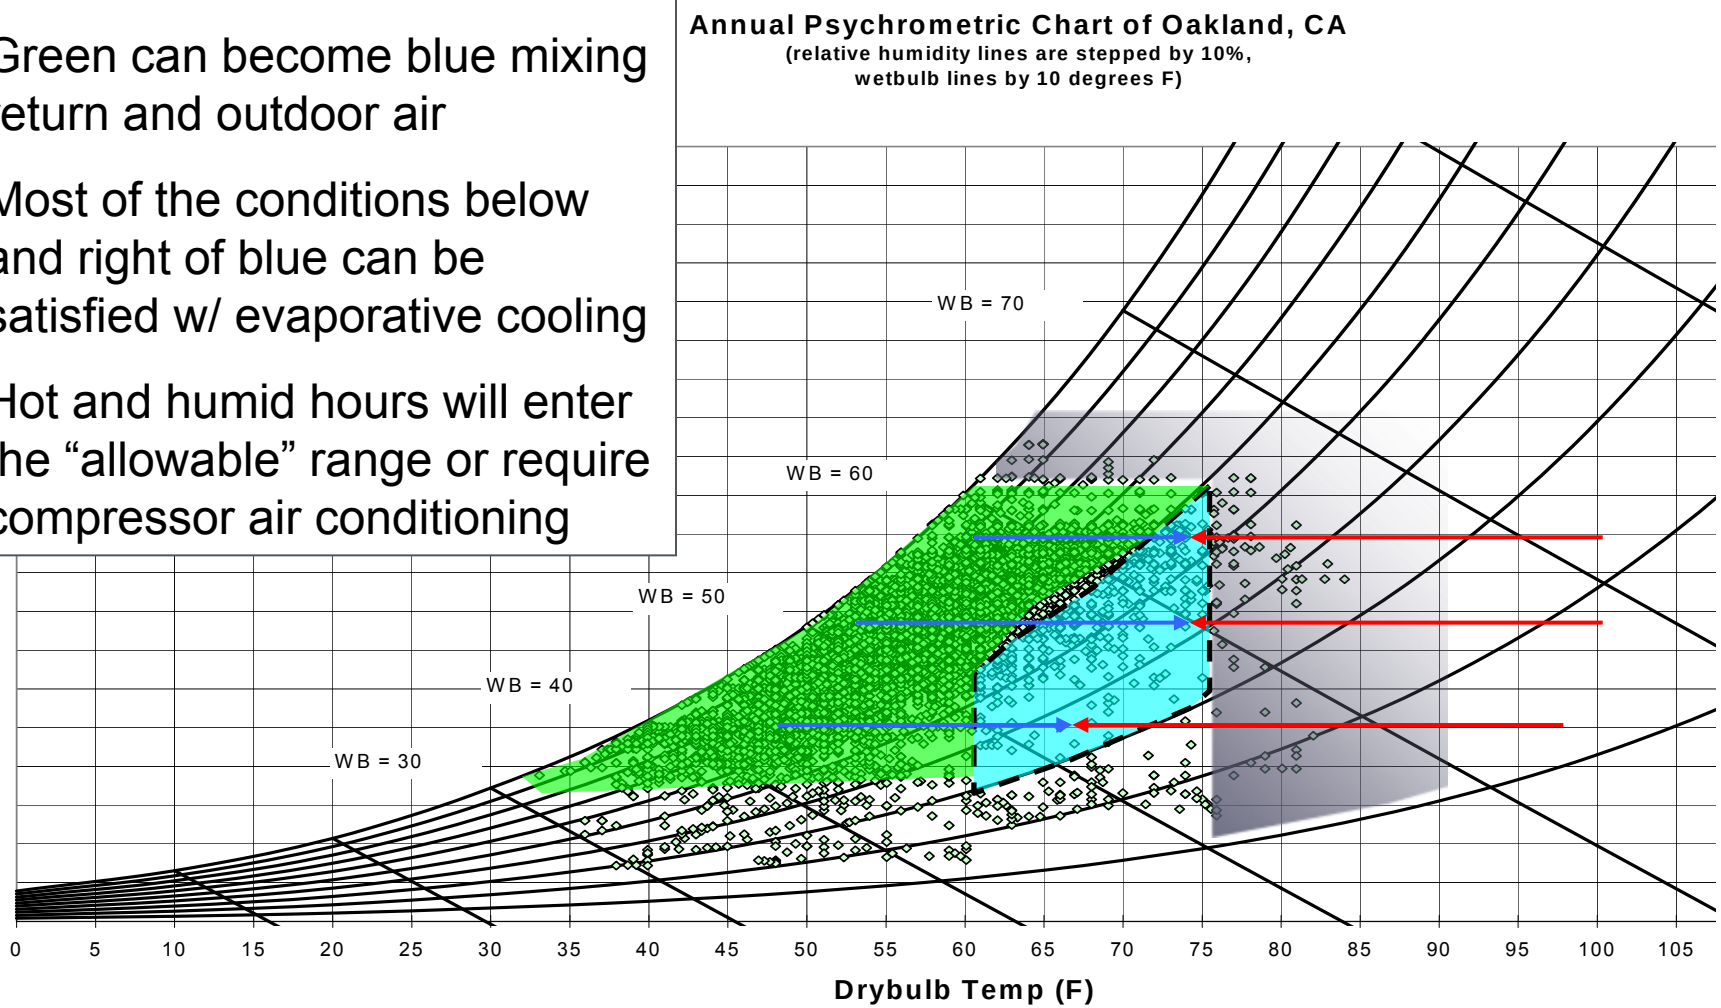

System Design Approach:

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Air-Side Economizer (93% of hours)
- Direct Evaporative Cooling for Humidification/ pre-cooling
- Low Pressure-Drop Design (1.5” total static peak)

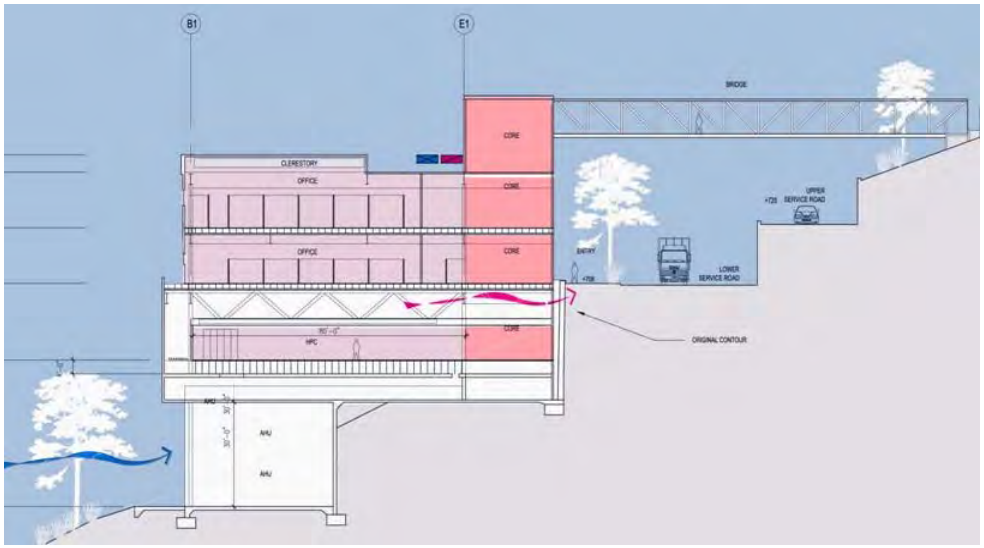

Hours of Operation

Mode 1	100% Economiser	2207	hrs
Mode 2	OA + RA	5957	hrs
Mode 3	Humidification	45	hrs
Mode 4	Humid + CH cooling	38	hrs
Mode 5	CH only	513	hrs
total		8760	hrs

Water Cooling:

- Tower side economizer
- Four pipe system
- Waste heat reuse
- Headers, valves and caps for modularity and flexibility

Predicted CRT Performance:

- Annual PUE = 1.1

Water-Side Economizers

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Advantages

- Cost effective in cool and dry climates
- Often easier retrofit
- Added reliability (backup in the event of chiller failure).
- No contamination questions

Integrated Water-Side Economizer

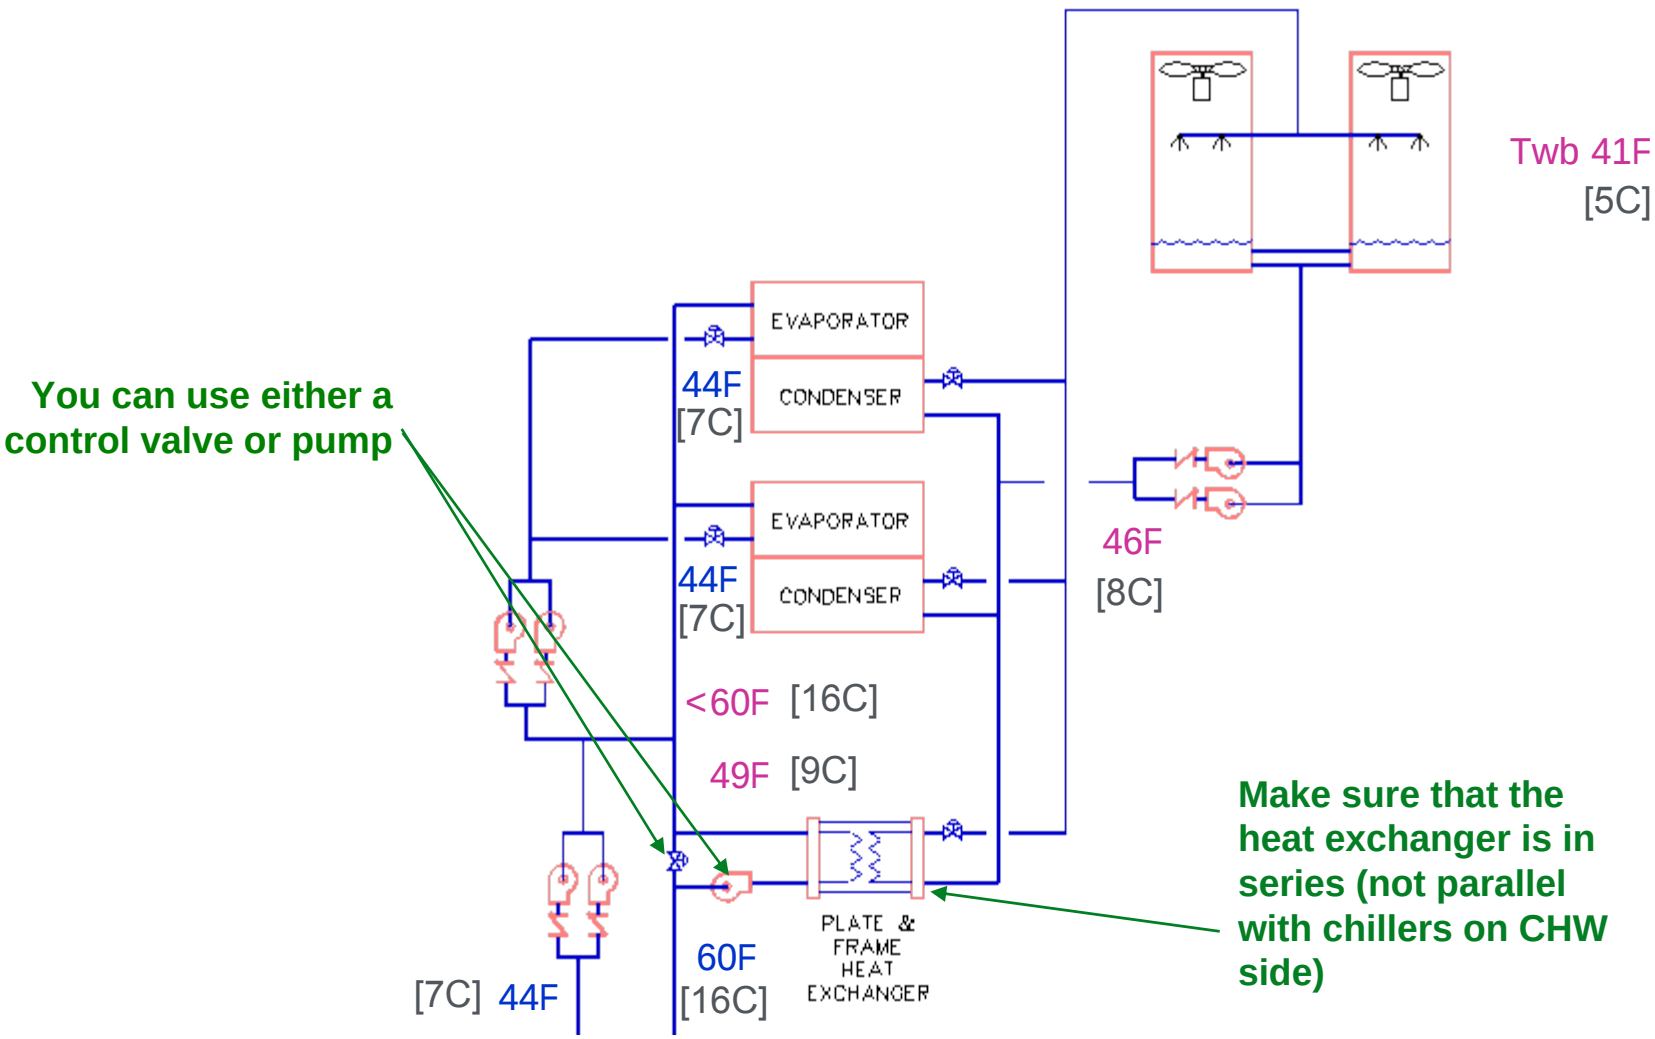

Potential for Tower Cooling

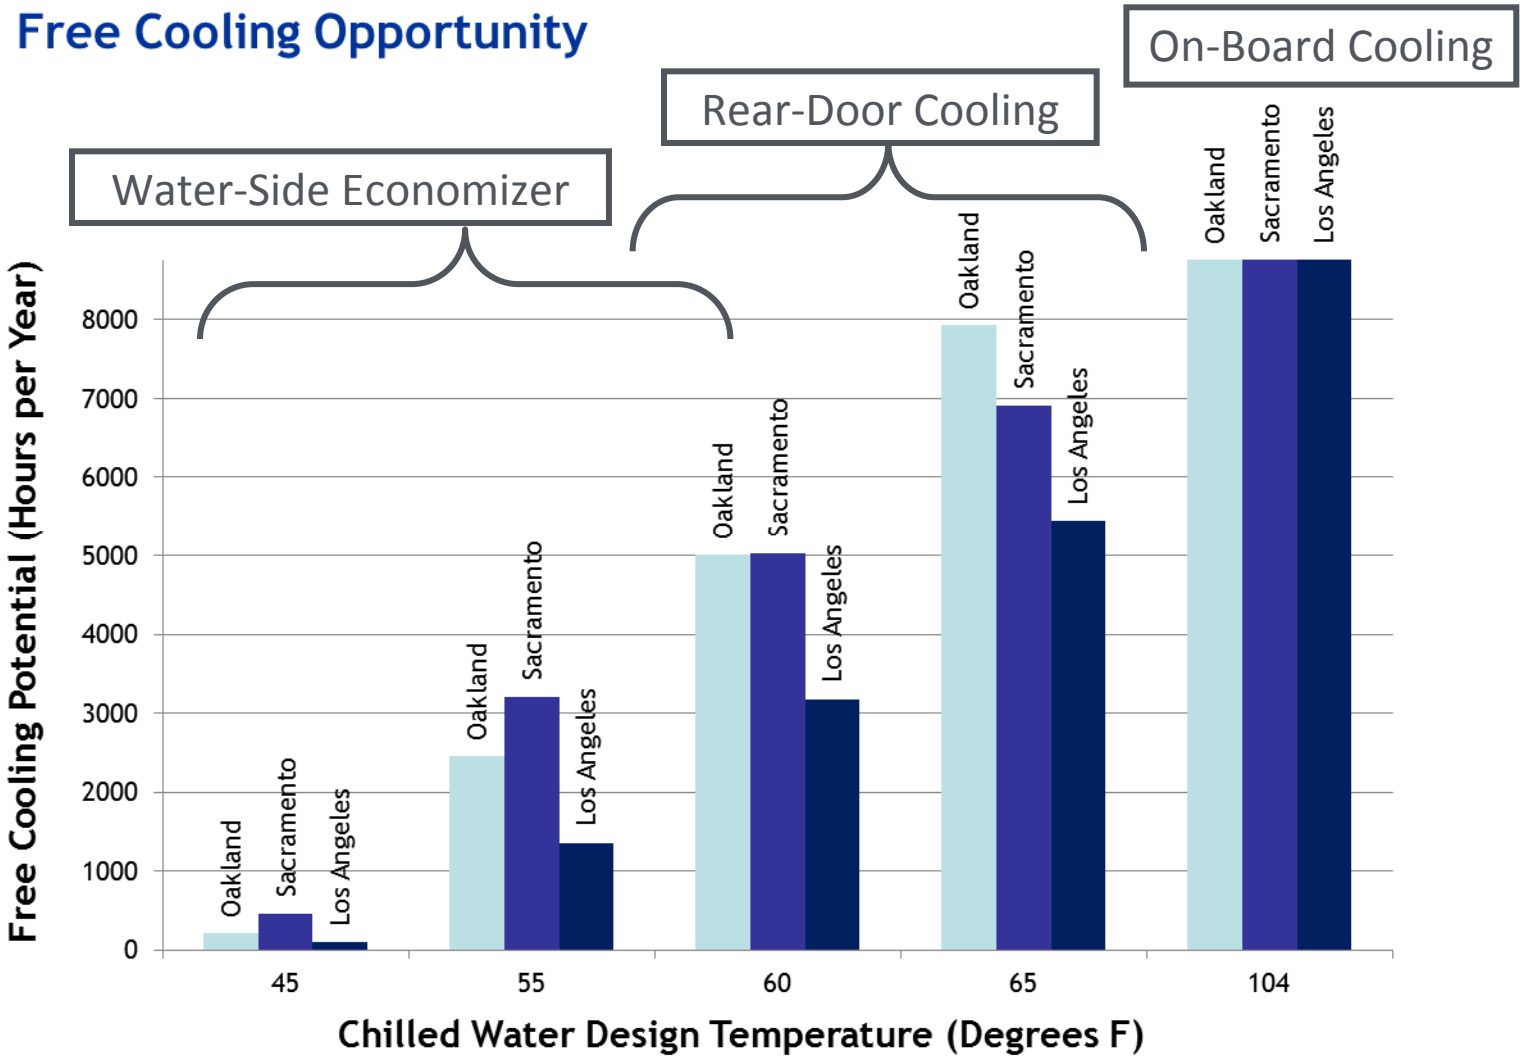

LBNL Example: Rear Door Cooling

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Used instead of adding CRAC units
- Rear door water cooling with tower-only (or central chiller plant in series).
  - Both options significantly more efficient than existing direct expansion (DX) CRAC units.

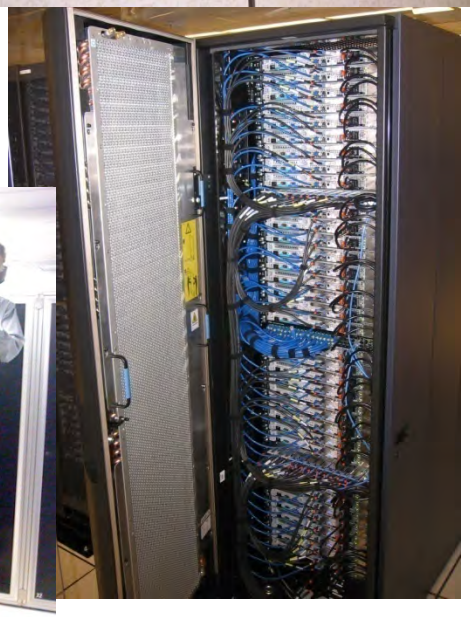

Improve Humidity Control:

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Eliminate inadvertent dehumidification
  - Computer load is sensible only
- Use ASHRAE allowable humidity ranges
  - Many manufacturers allow even wider humidity range
- Defeat equipment fighting
  - Coordinate controls
- Disconnect and only control humidity of makeup air or one CRAC/CRAH unit
- Entirely disconnect (many have!)

Cost of Unnecessary Humidification

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

	Visalia Probe			CRAC Unit Panel			
	Temp	RH	Tdp	Temp	RH	Tdp	Mode
AC 005	84.0	27.5	47.0	76	32.0	44.1	Cooling
AC 006	81.8	28.5	46.1	55	51.0	37.2	Cooling & Dehumidification
AC 007	72.8	38.5	46.1	70	47.0	48.9	Cooling
AC 008	80.0	31.5	47.2	74	43.0	50.2	Cooling & Humidification
AC 010	77.5	32.8	46.1	68	45.0	45.9	Cooling
AC 011	78.9	31.4	46.1	70	43.0	46.6	Cooling & Humidification
Min	72.8	27.5	46.1	55.0	32.0	37.2	
Max	84.0	38.5	47.2	76.0	51.0	50.2	
Avg	79.2	31.7	46.4	68.8	43.5	45.5	

Humidity down ~2%

CRAC power down 28%

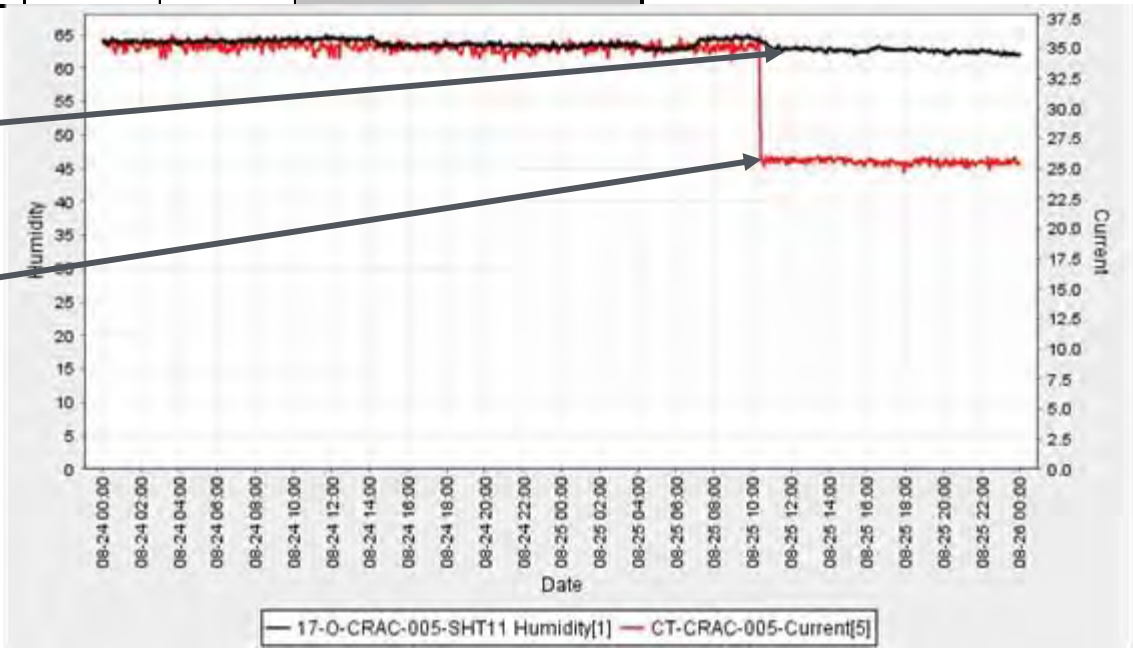

Cooling Takeaways…

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Use efficient equipment and a central plant (e.g. chiller/CRAHs) vs. CRAC units
- Use centralized controls on CRAC/CRAH units
  - Prevent simultaneous humidifying and dehumidifying
  - Optimize sequencing and staging
- Move to liquid cooling (room, row, rack, chip)
- Consider VSDs on fans, pumps, chillers, and towers
- Use air- or water-side economizers where possible.
- Expand humidity range and improve humidity control (or disconnect).

Questions?

Electrical Systems

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Electrical system end use – Orange bars

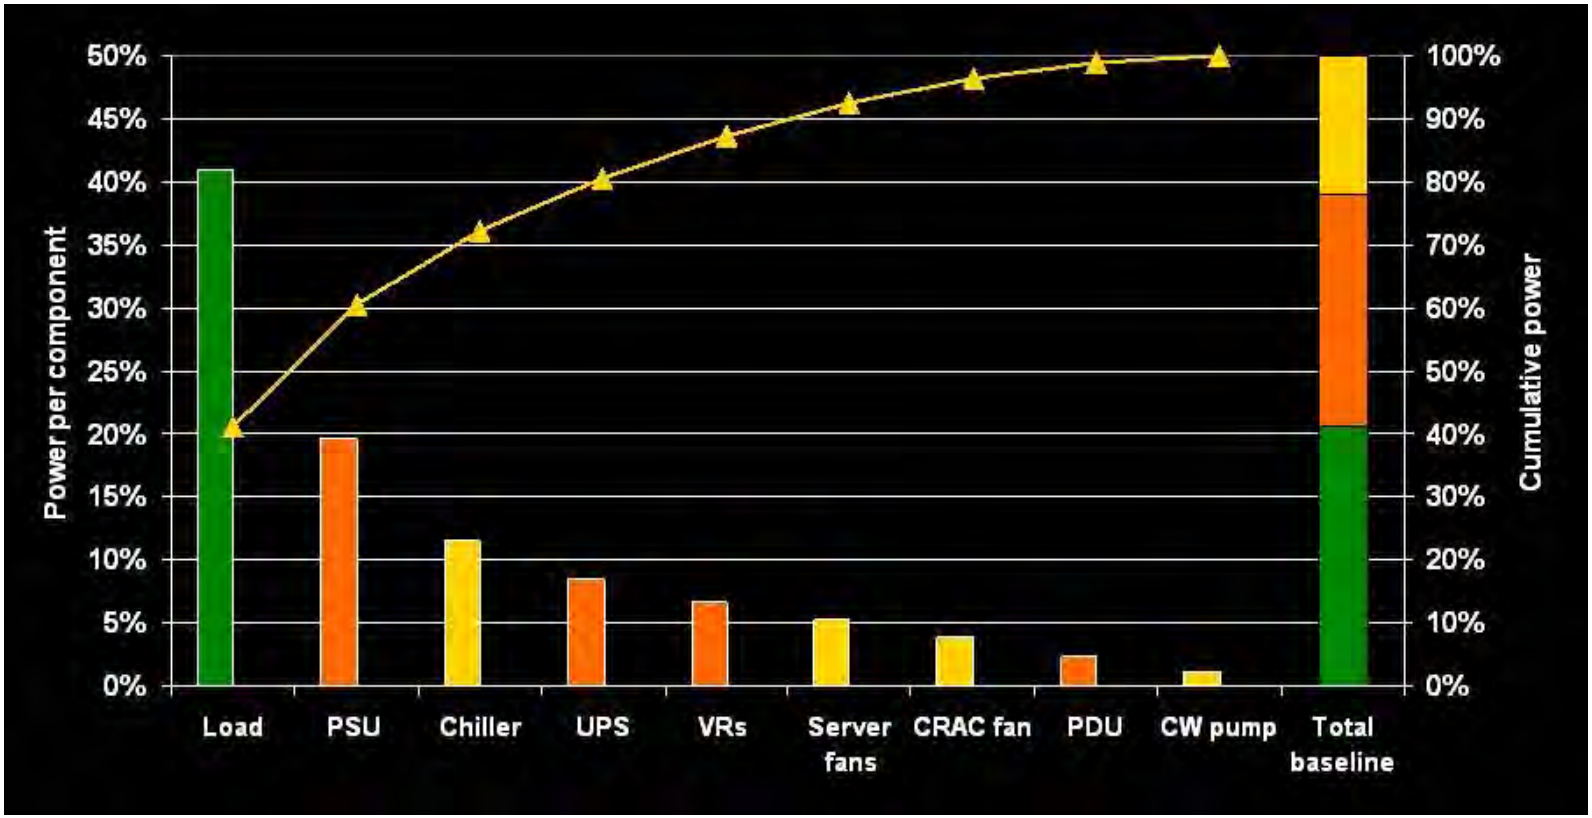

Courtesy of Michael Patterson, Intel Corporation

Electrical Distribution

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Every power conversion (AC-DC, DC-AC, AC-AC) loses some energy and creates heat
- Efficiency decreases when systems are lightly loaded
- Distributing higher voltage is more efficient and can save capital cost (conductor size is smaller)
- Power supply, uninterruptible power supply (UPS), transformer, and PDU efficiency varies – carefully select
- Lowering distribution losses also lowers cooling loads

Electrical Systems – Points of Energy Inefficiency

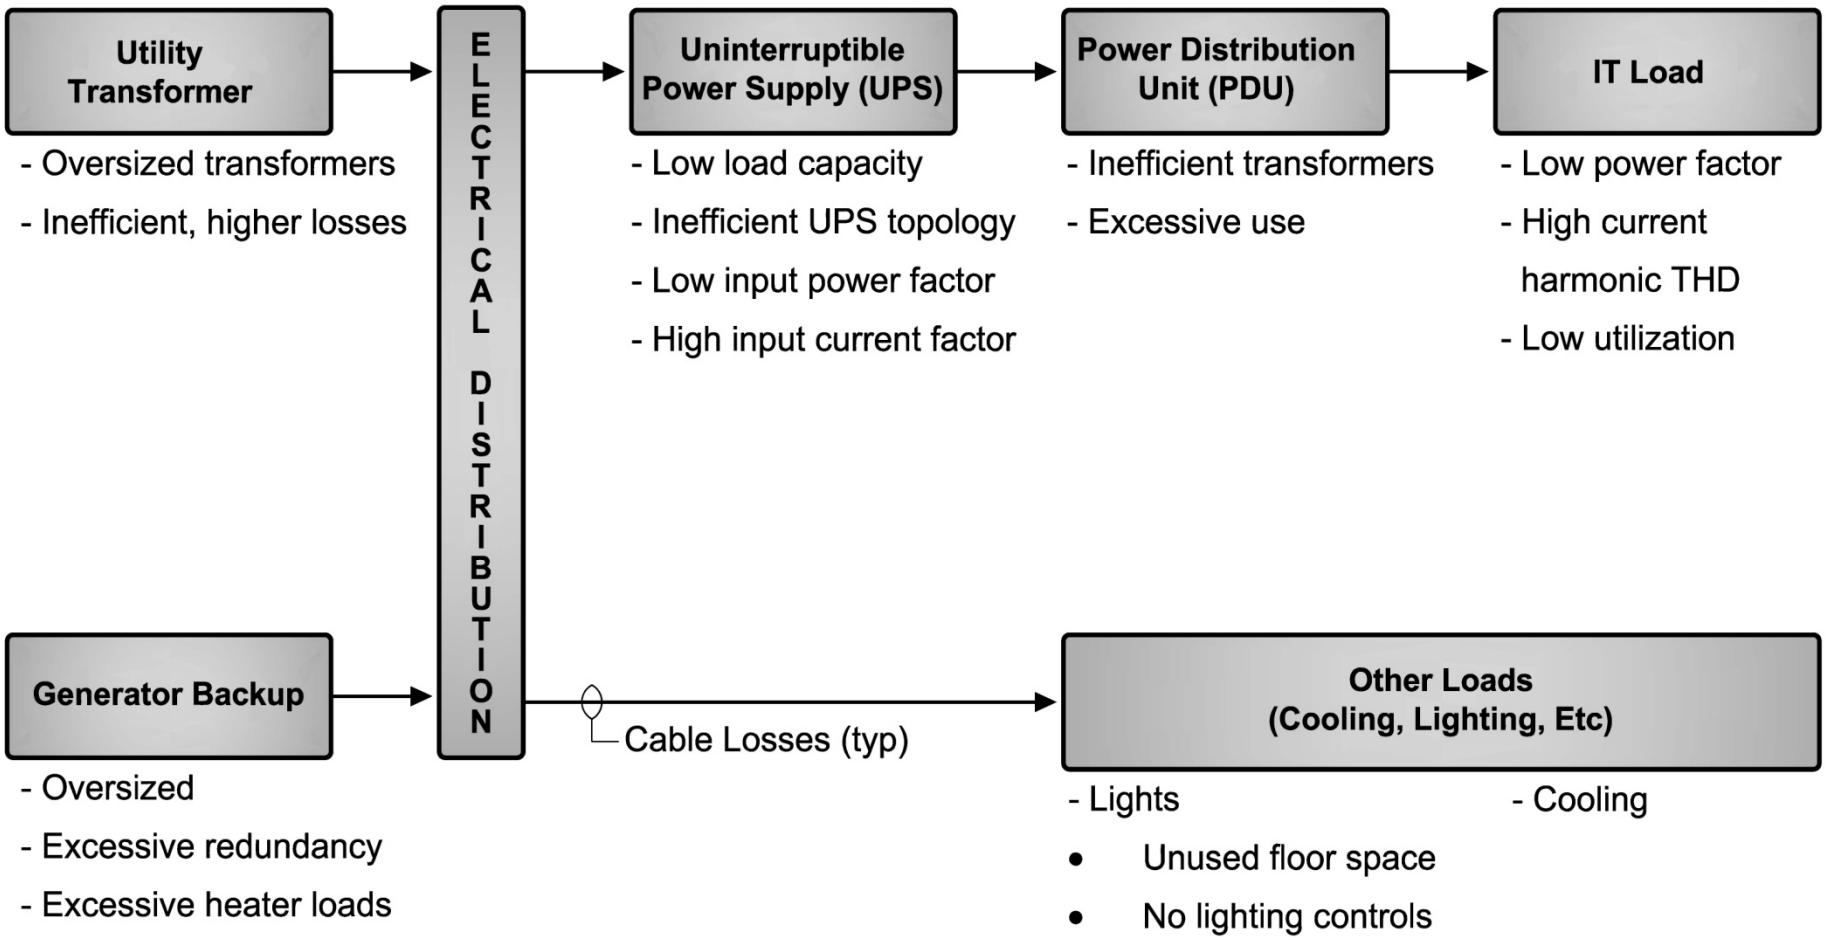

UPS, Transformer, & PDU Efficiency

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Efficiencies vary with system design, equipment, and load
- Redundancies impact efficiency

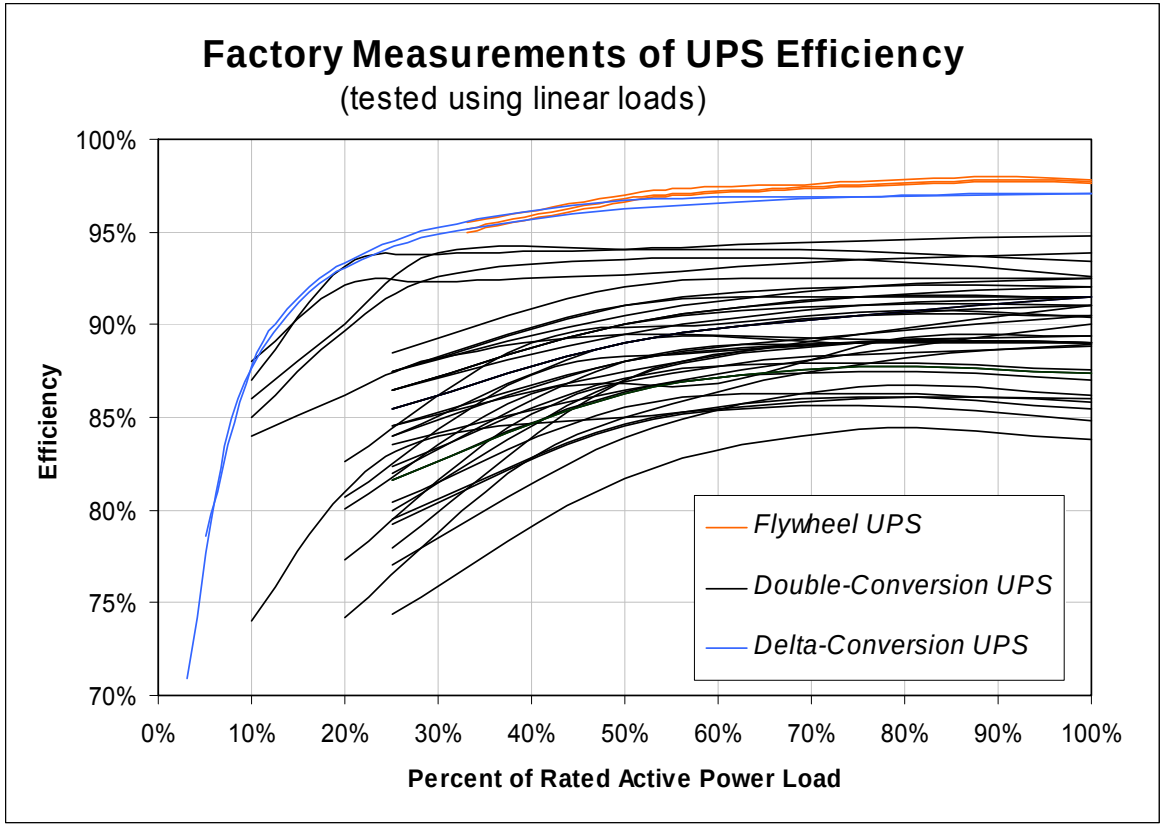

Measured UPS efficiency

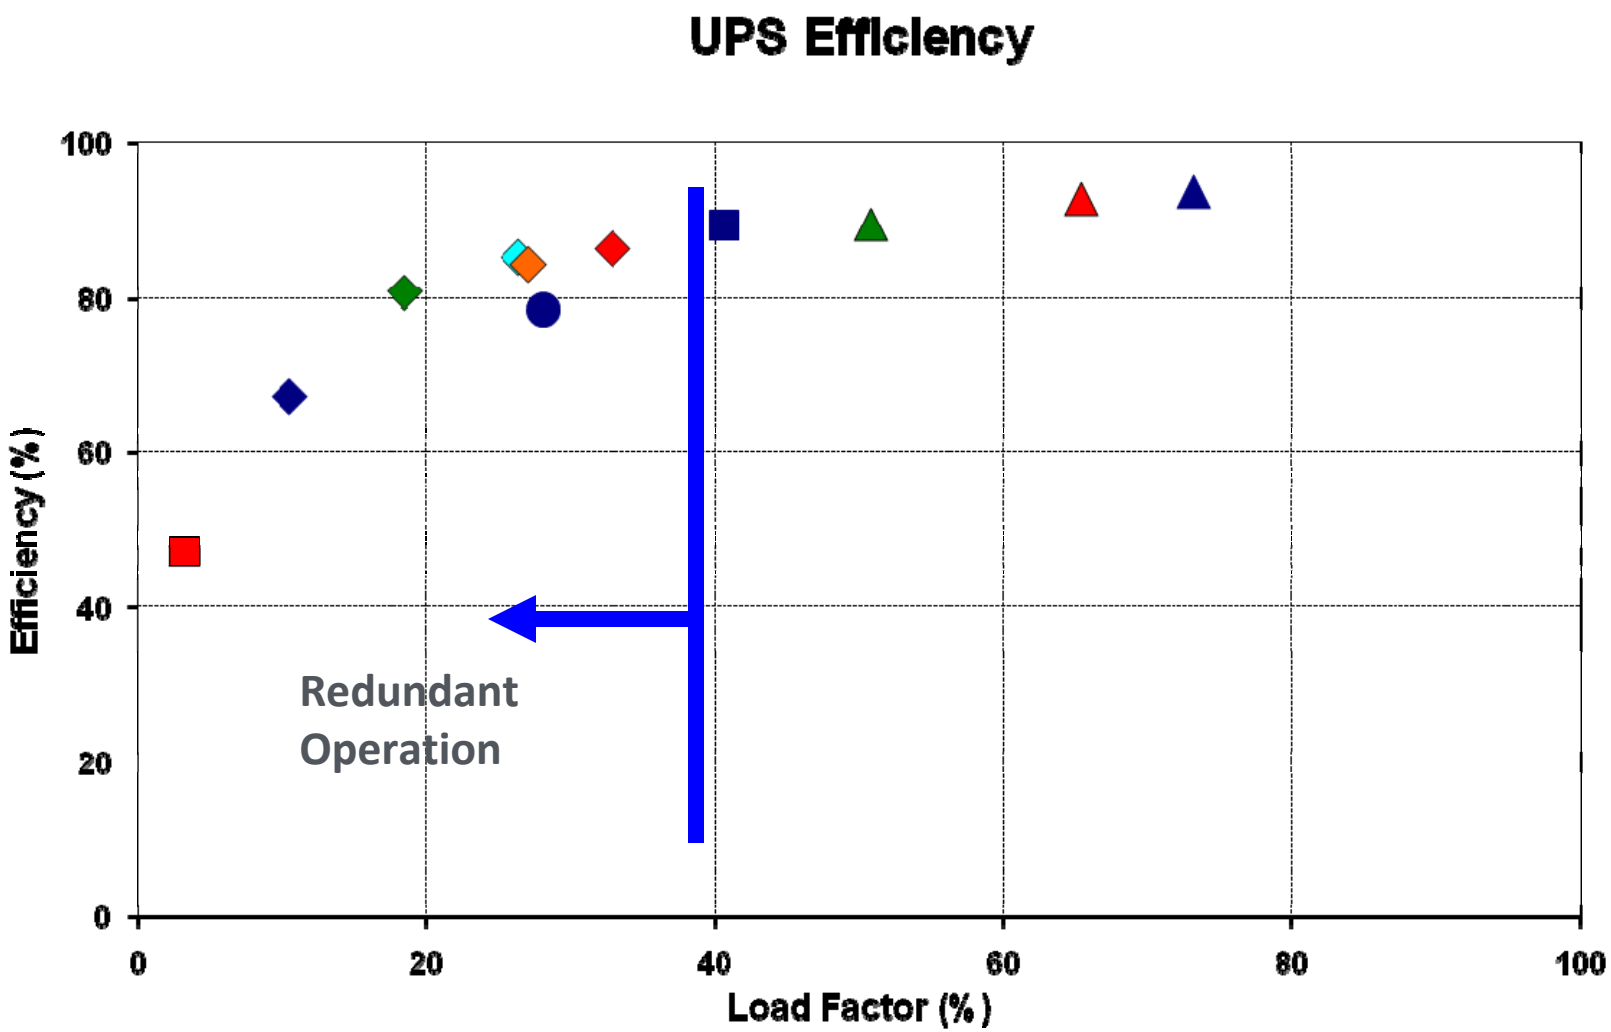

LBNL/EPRI Measured Power Supply Efficiency

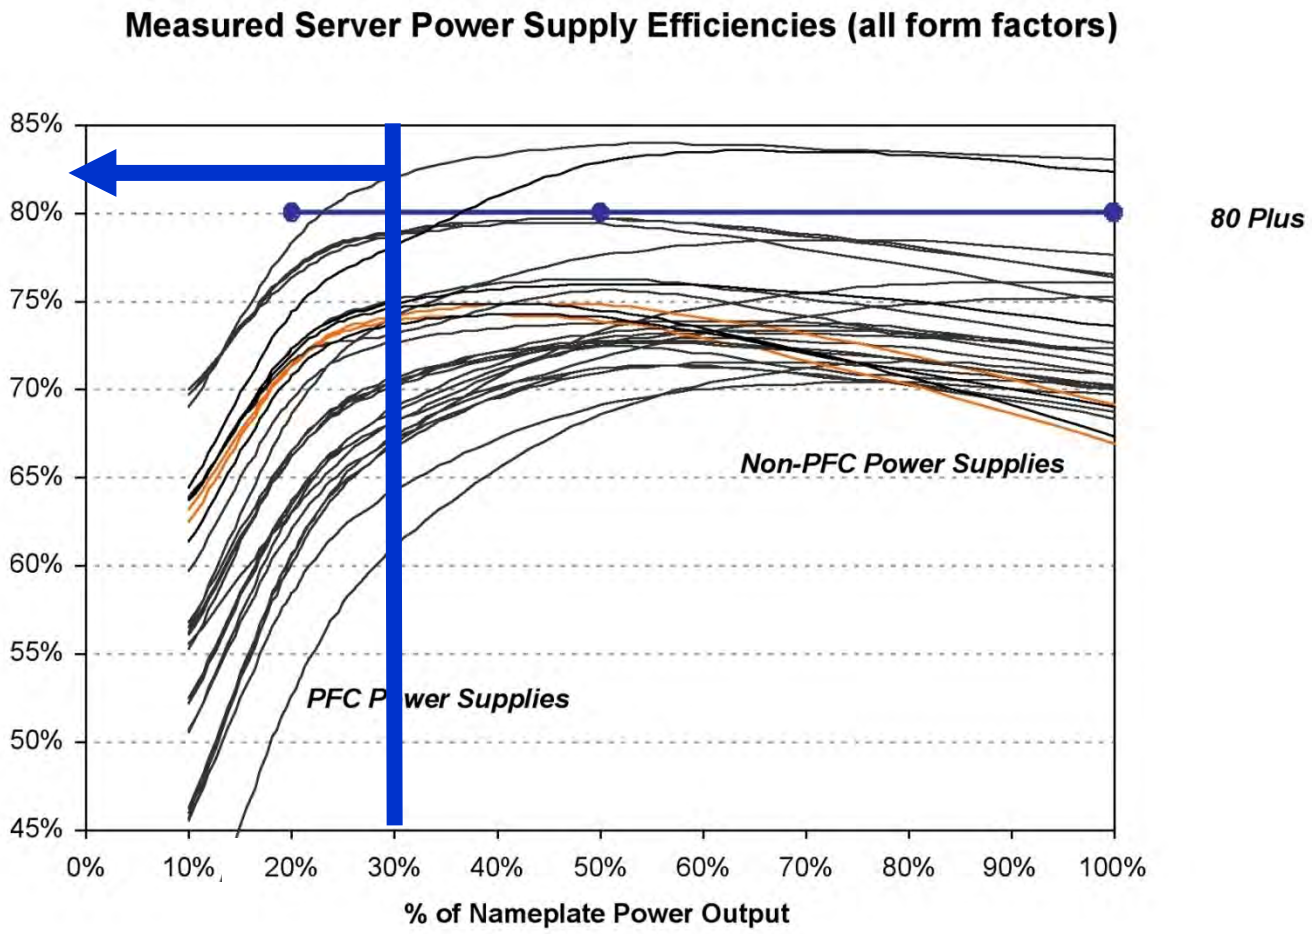

Redundancy

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Understand what redundancy costs and what it gets you – is it worth it?
- Does everything need the same level?
- Different strategies have different energy penalties (e.g. 2N vs. N+1)
- It's possible to more fully load UPS systems and achieve desired redundancy
- Redundancy in electrical distribution puts you down the efficiency curve

From Utility Power to the Chip – Multiple Electrical Power Conversions

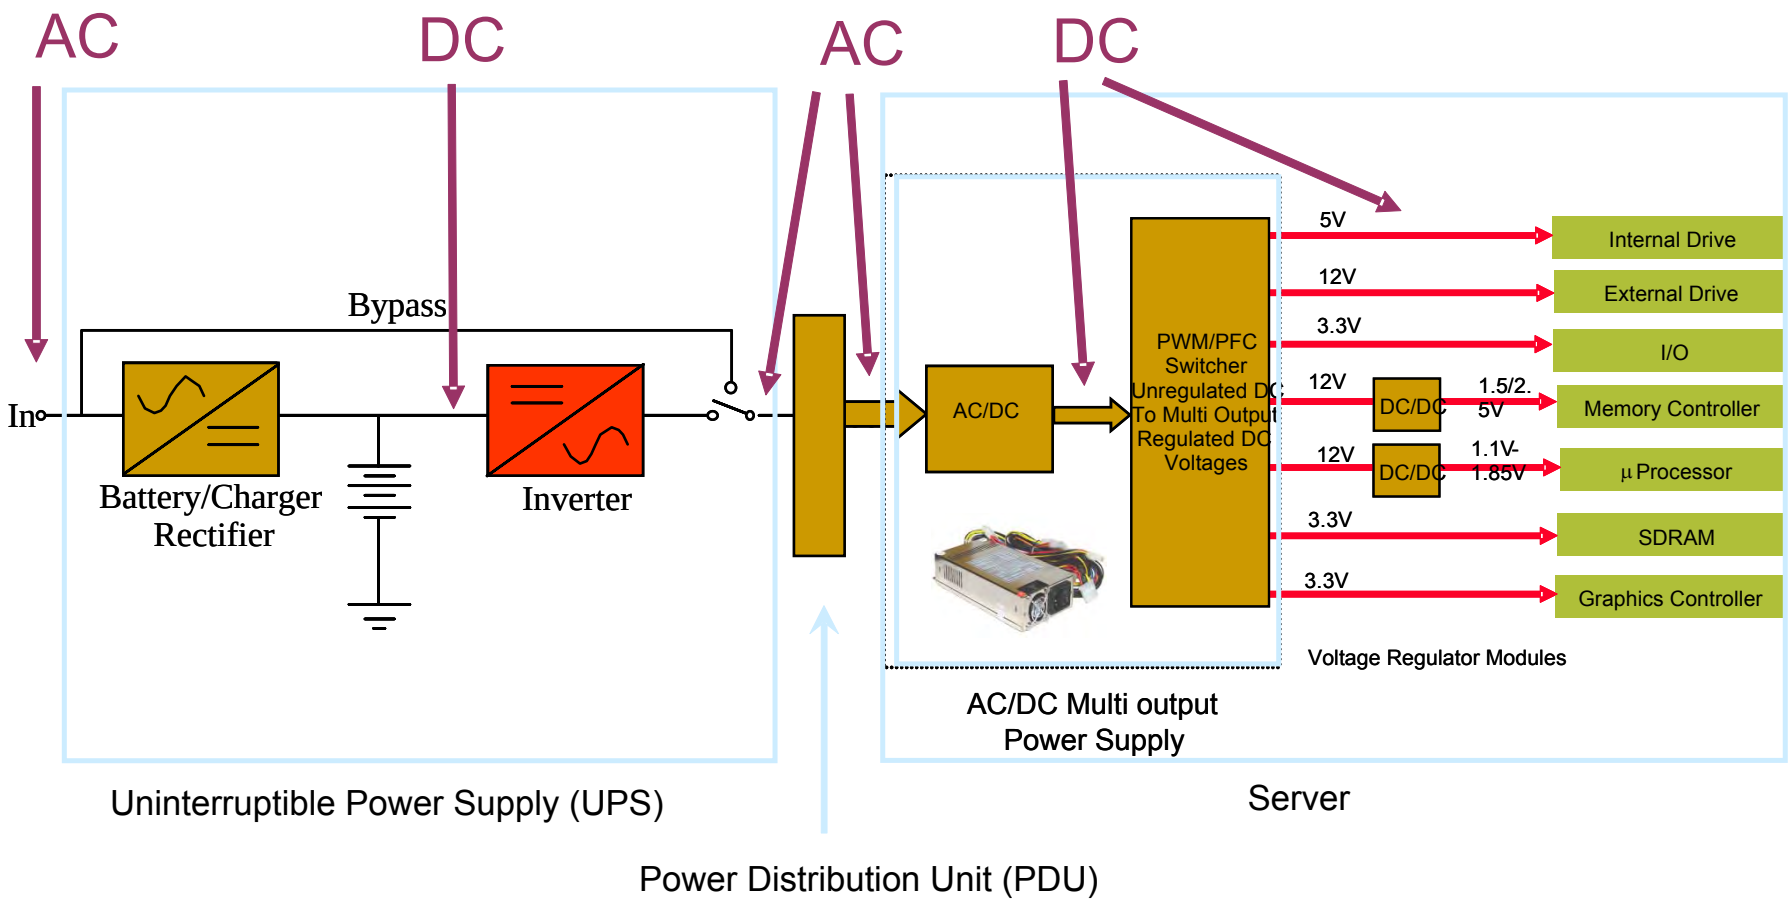

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

380V. DC power distribution

- Eliminate several conversions
- Also use for lighting, and variable speed drives
- Use with on-site generation including renewable energy sources

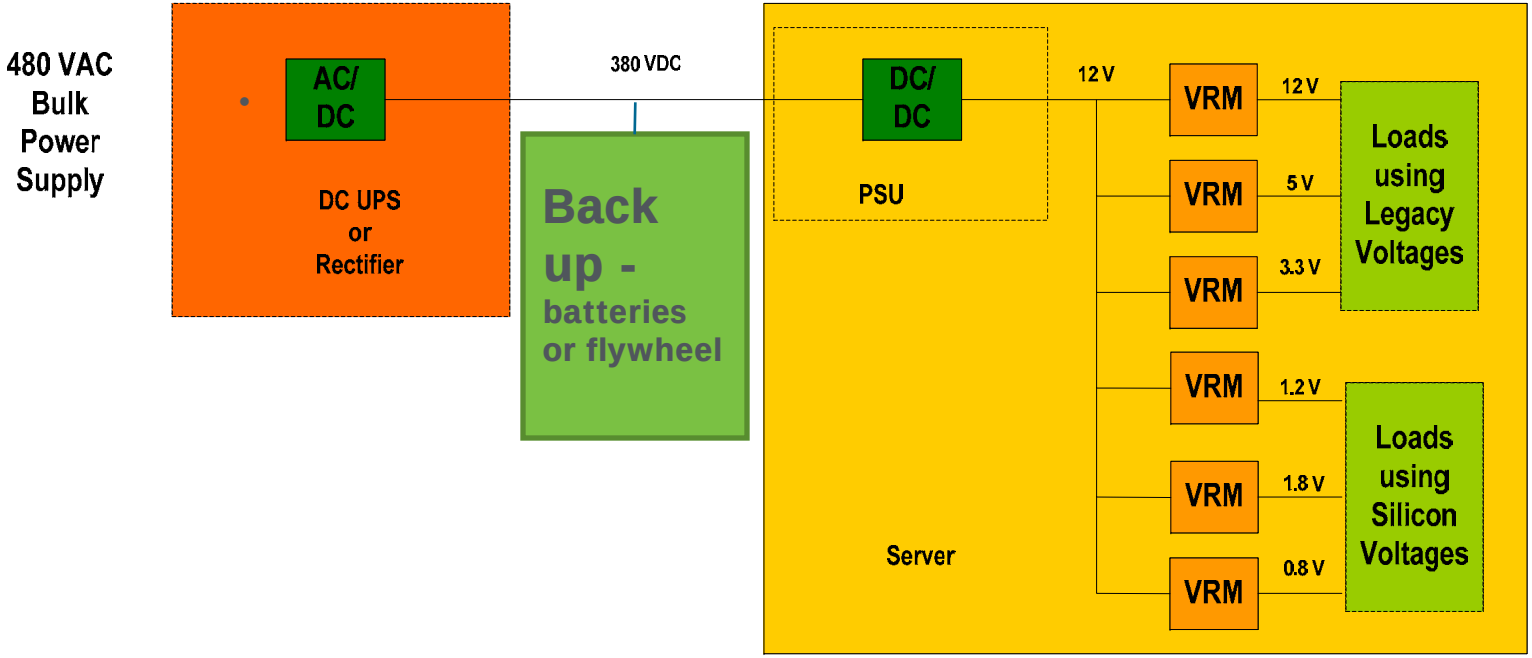

Standby generation loss

- Losses
  - Heaters
  - Battery chargers
  - Transfer switches
  - Fuel management systems
- Opportunities to reduce or eliminate losses
- Heaters (many operating hours) use more electricity than the generator produces (few operating hours)
  - Check with generator manufacturer on how to reduce the energy consumption of block heaters (e.g. temperature settings and control)

Standby generator heater

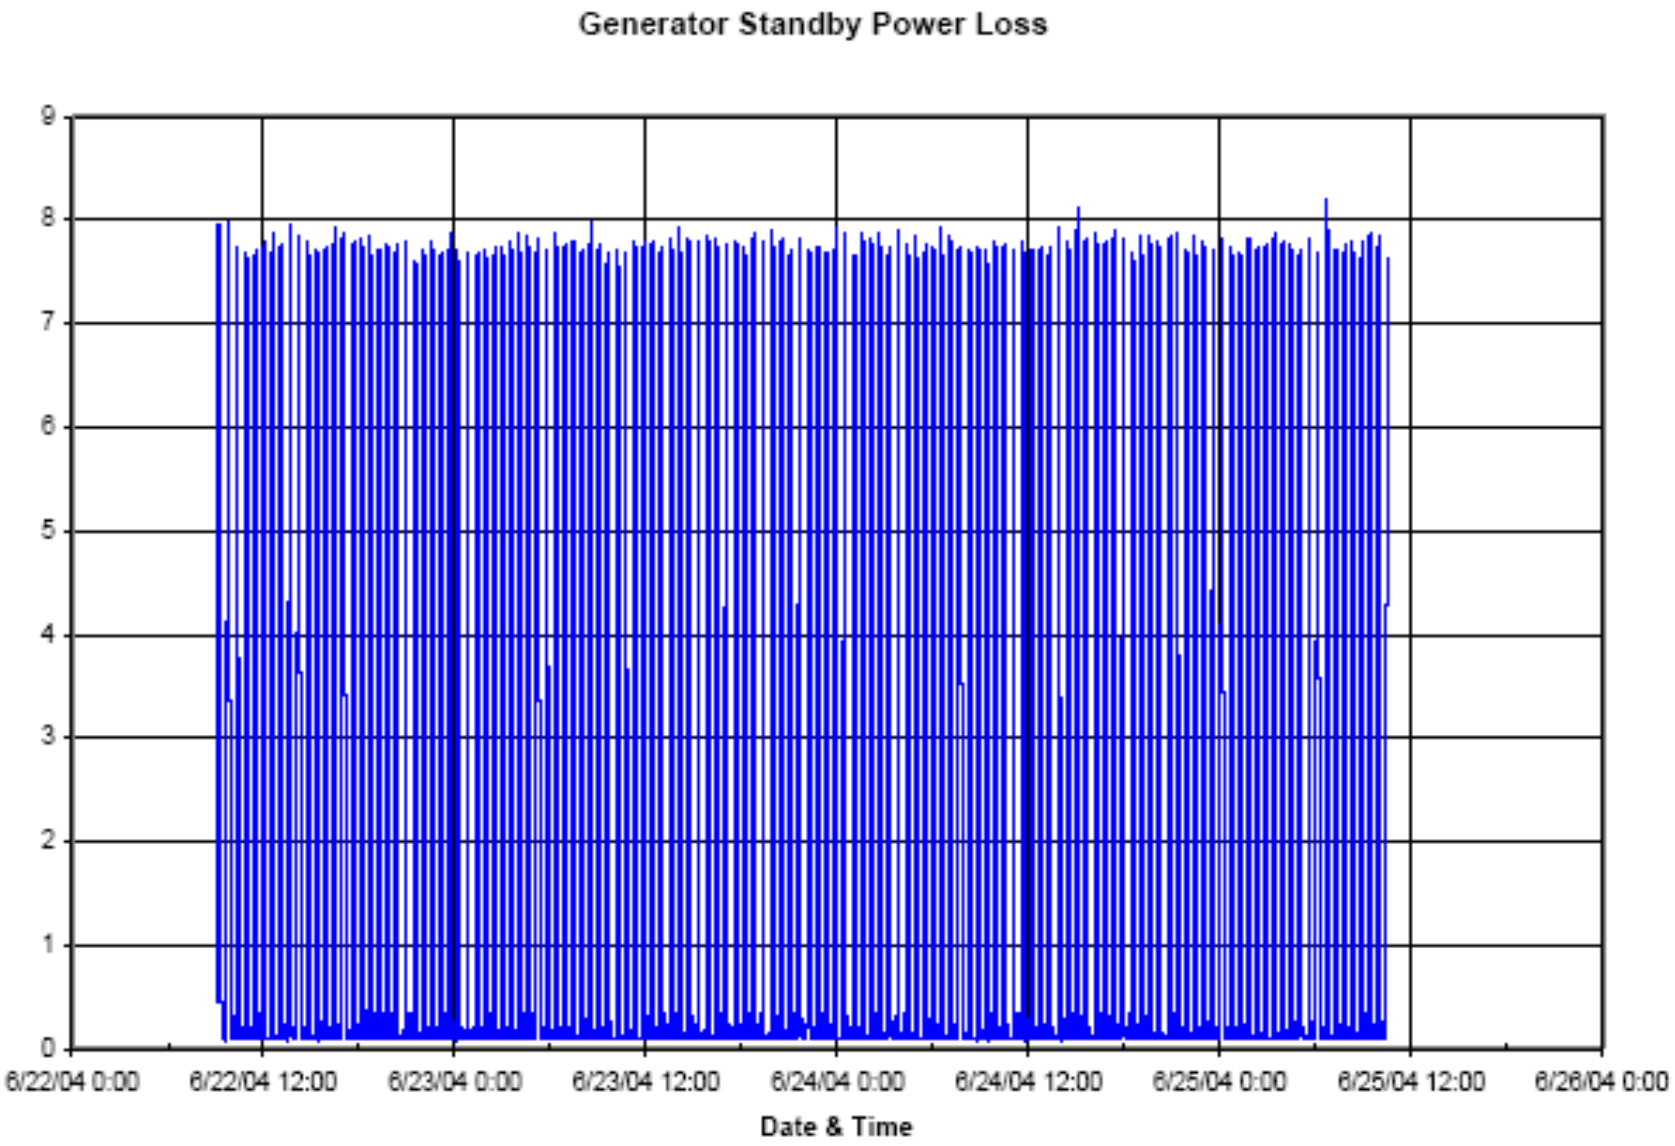

Data center lighting

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Lights are on and nobody's home
  - Switch off lights in unused/unoccupied areas or rooms (UPS, Battery, S/Gear, etc)
  - Lighting controls such as occupancy sensors are well proven
- Small relative benefit but easy to accomplish – also saves HVAC energy
- Use energy efficient lighting
- Lights should be located over the aisles

Motors and Drives

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Since most cooling system equipment operates continuously, premium efficiency motors should be specified everywhere
- Variable speed drives should be used
  - Chillers
  - Pumps
  - Air handler fans
  - Cooling tower fans

Key Electrical Takeaways

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- **Choose highly efficient components and configurations**
- **Reduce power conversion (AC-DC, DC-AC, AC-AC, DC-DC)**
- **Consider the minimum redundancy required as efficiency decreases when systems are lightly loaded**
- **Use higher voltage**

Questions?

Resources

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Resources

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Advanced Manufacturing Office

- Tool suite & metrics for baselining
- Training
- Qualified specialists
- Case studies
- Recognition of high energy savers
- R&D - technology development

Federal Energy Management Program

- Workshops
- Federal case studies
- Federal policy guidance
- Information exchange & outreach
- Access to financing opportunities
- Technical assistance

GSA

- Workshops
- Quick Start Efficiency Guide
- Technical Assistance

EPA

- Metrics
- Server performance rating & ENERGY STAR label
- Data center benchmarking

Industry

- Tools
- Metrics
- Training
- Best practice information
- Best-in-Class guidelines
- IT work productivity standard

Resources from DOE Federal Energy Management Program (FEMP)

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- Best Practices Guide
- Benchmarking Guide
- Data Center Programming Guide
- Technology Case Study Bulletins
- Procurement Specifications
- Report Templates
- Process Manuals
- Quick-Start Guide

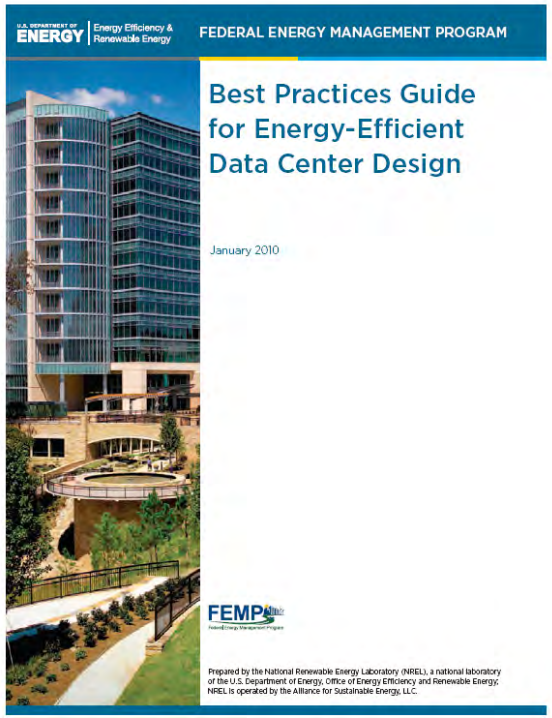

DOE Advanced Manufacturing Office (AMO - was ITP)

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

DOE's AMO data center program provides tools and resources to help owners and operators:

- **DC Pro Software Tool Suite**
  - Tools to define baseline energy use and identify energy-saving opportunities
- **Information products**
  - Manuals, case studies, and other resources
- **End-user awareness training**
  - Workshops in conjunction with ASHRAE
- **Data Center Energy Practitioner (DCEP) certificate program**
  - Qualification of professionals to evaluate energy efficiency opportunities
- **Research, development, and demonstration of advanced technologies**

DOE DC Pro Tool Suite

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

High-Level On-Line Profiling and Tracking Tool

- Overall efficiency (Power Usage Effectiveness [PUE])
- End-use breakout
- Potential areas for energy efficiency improvement
- Overall energy use reduction potential

In-Depth Assessment Tools → Savings

Air Management

- Hot/cold separation
- Environmental conditions
- RCI and RTI

Electrical Systems

- UPS
- PDU
- Transformers
- Lighting
- Standby gen.

IT-Equipment

- Servers
- Storage & networking
- Software

Cooling

- Air handlers/ conditioners
- Chillers, pumps, fans
- Free cooling

Data Center Energy Practitioner (DCEP) Program

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

A certificate process for energy practitioners qualified to evaluate energy consumption and efficiency opportunities in Data Centers.

Key objective:

- Raise the standards of assesors
- Provide greater repeatability and credibility of recommendations.

Target groups include:

- Data Center personnel (in-house experts)
- Consulting professionals (for-fee consultants)

Training & Certificate Disciplines/Levels/Tracks

Level 1 Generalist:
Prequalification, Training and Exam on All Disciplines
+ Assessment Process
+ DC Pro Profiling Tool

Level 2 Specialist:
Prequalification, Training and Exam on Select Disciplines
+ Assessment Process
+ DC Pro System Assessment Tools

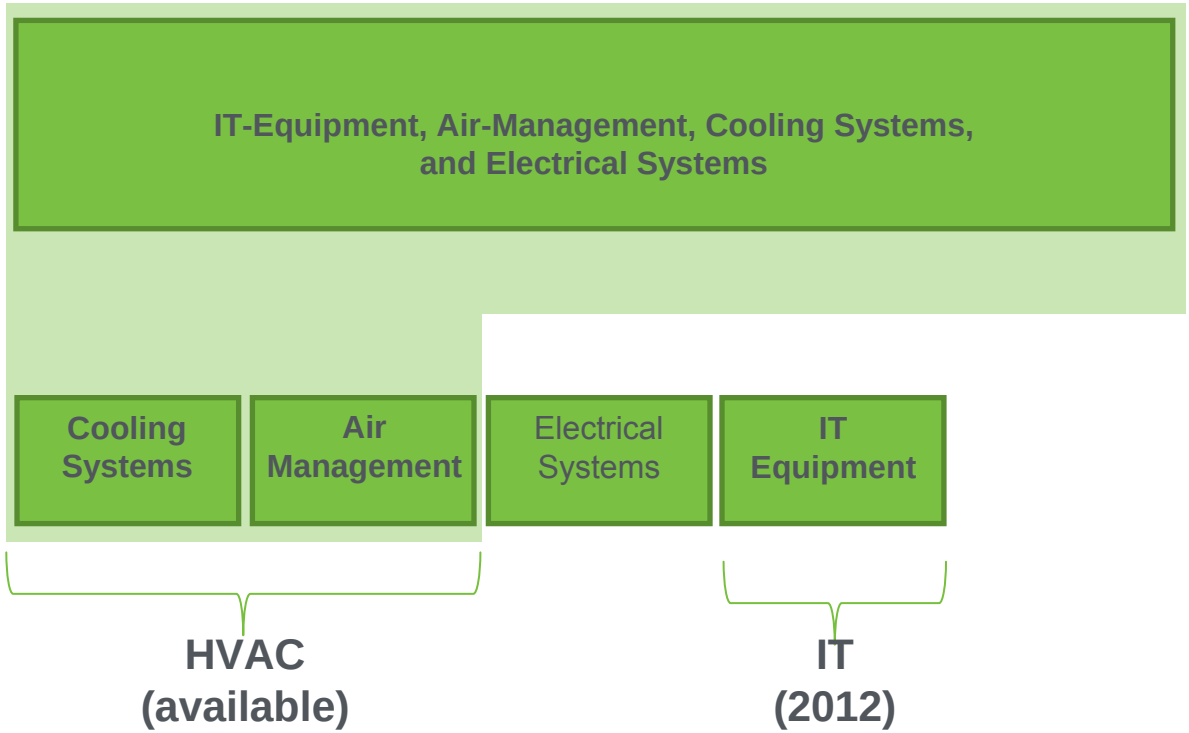

Two Tracks:
- Certificate track (training + exam)
- Training track (training only)

Energy Star

A voluntary public-private partnership program

- Buildings
- Products

Energy Star Data Center Activities

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

- ENERGY STAR Datacenter Rating Tool
  - Build on existing ENERGY STAR platform with similar methodology (1-100 scale)
  - Usable for both stand-alone and data centers housed within another buildings
  - Assess performance at building level to explain how a building performs, not why it performs a certain way
  - ENERGY STAR label to data centers with a rating of 75+
  - Rating based on data center infrastructure efficiency
    - Ideal metric would be measure of useful work/energy use.
    - Industry still discussing how to define useful work.
- Energy STAR specification for servers
- Evaluating enterprise data storage, UPS, and networking equipment for Energy STAR product specs

Resources

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

FEMP Federal Energy Management Program

http://www1.eere.energy.gov/femp/program/data_center.html

BERKELEY LAB

http://hightech.lbl.gov/datacenters.html

ENERGY STAR

http://www.energystar.gov/index.cfm?c=prod_development.server_efficiency

Save ENERGY Now ®

http://www1.eere.energy.gov/industry/datacenters/

Questions?

Workshop Summary

Best Practices

U.S. Department of Energy
Energy Efficiency and Renewable Energy

BERKELEY LAB

Results at LBNL

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

LBNL's Legacy Data Center:

- Increased IT load
  - >50% (~180kW) increase with virtually no increase in infrastructure energy use
- Raised room temperature 8+ degrees
- AC unit turned off
  - (1) 15 ton now used as backup
- Decreased PUE from 1.65 to 1.45
  - 30% reduction in infrastructure energy
- More to come!

More to Come

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

Next Steps for LBNL's Legacy Data Center

- Integrate CRAC controls with wireless monitoring system
- Retrofit CRACs w/ VSD
  - Small VAV turndown, yields big energy savings
- Improve containment (overcome curtain problems)
- Increase liquid cooling (HP in-rack, and APC in-row)
- Increase free cooling (incl. tower upgrade)

Data Center Best Practices Summary

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

1. Measure and Benchmark Energy Use
2. Identify IT Opportunities
3. Use IT to Control IT
4. Manage Airflow
5. Optimize Environmental Conditions
6. Evaluate Cooling Options
7. Improve Electrical Efficiency
8. Implement Energy Efficiency Measures

Data Center Best Practices

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

1. Measure and Benchmark Energy Use
   - Use metrics to measure efficiency
   - Benchmark performance
   - Establish continual improvement goals

Data Center Best Practices

U.S. DEPARTMENT OF ENERGY | Energy Efficiency & Renewable Energy

2. Identify IT Opportunities

- Specify efficient servers (incl. power supplies)
- Virtualize
- Refresh IT equipment
- Turn off unused equipment.

3. Use IT to Control IT Energy

- Evaluate monitoring systems to enhance real-time management and efficiency.
- Use visualization tools (e.g. thermal maps).
- Install dashboards to manage and sustain energy efficiency.

4. Manage Airflow

- Implement hot and cold aisles
- Fix leaks
- Manage floor tiles
- Isolate hot and cold airstreams.

5. Optimize Environmental Conditions

- Follow ASHRAE guidelines or manufacturer specifications
- Operate to maximum ASHRAE recommended range.
- Anticipate servers will occasionally operate in allowable range.
- Minimize or eliminate humidity control

6. Evaluate Cooling Options

- Use centralized cooling system
- Maximize central cooling plant efficiency
- Provide liquid-based heat removal
- Compressorless cooling

7. Improve Electrical Efficiency

- Select efficient UPS systems and topography
- Examine redundancy levels
- Increase voltage distribution and reduce conversions

8. Implement Standard Energy Efficiency Measures

- Install premium efficiency motors
- Upgrade building automation control system
  - Integrate CRAC controls
- Variable speed everywhere
- Optimize cooling tower efficiency

Most importantly…

Get IT and Facilities People Talking and working together as a team!!!

Questions?

Contact Information:

Dale Sartor, P.E.
Lawrence Berkeley National Laboratory
Applications Team
MS 90-3111
University of California
Berkeley, CA 94720
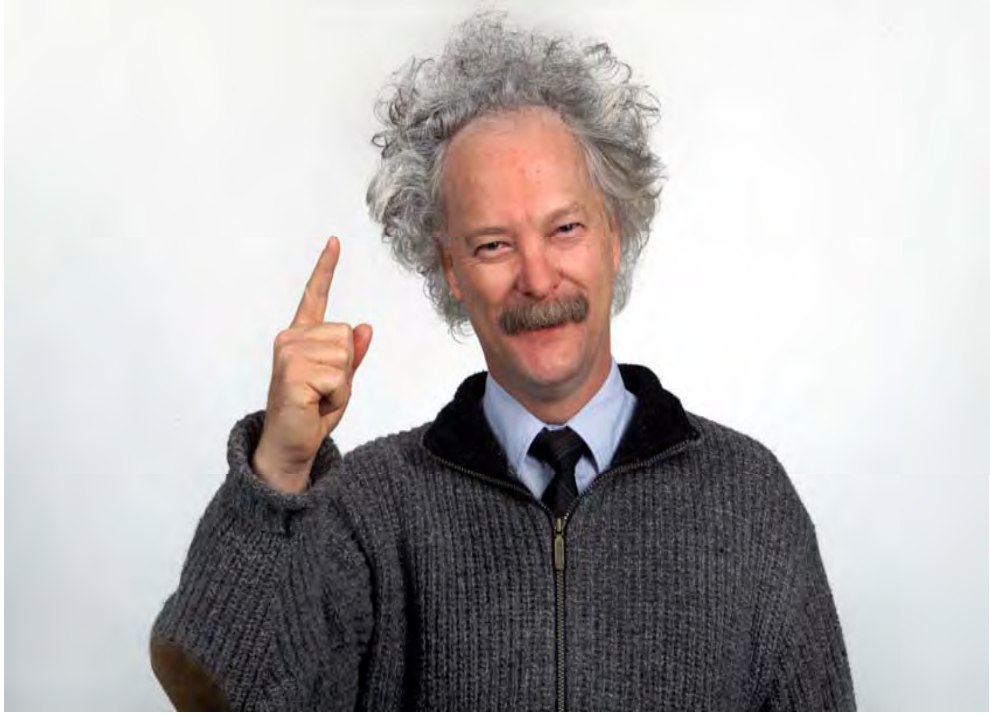
DASartor@LBL.gov
(510) 486-5988
http://Ateam.LBL.gov